



CONTROL CIRCUIT


LED signal from UPS
"OK for operating corresponding MCCB"

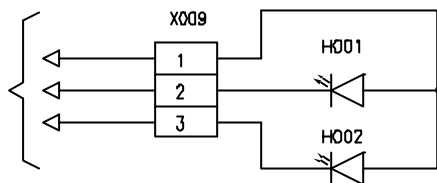

MCCB position signals for UPS

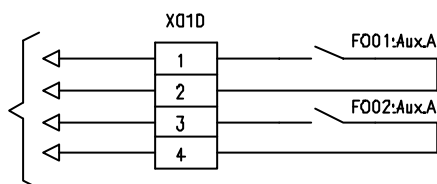

Trip for emergency stop
(220-240V AC)

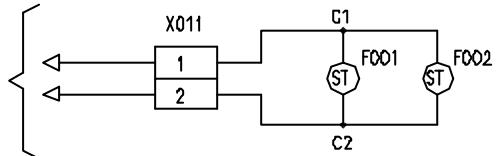


NOTE:

ST : Shunt trip

C1,C2 : Shunt trip coil connections

POWER CIRCUIT

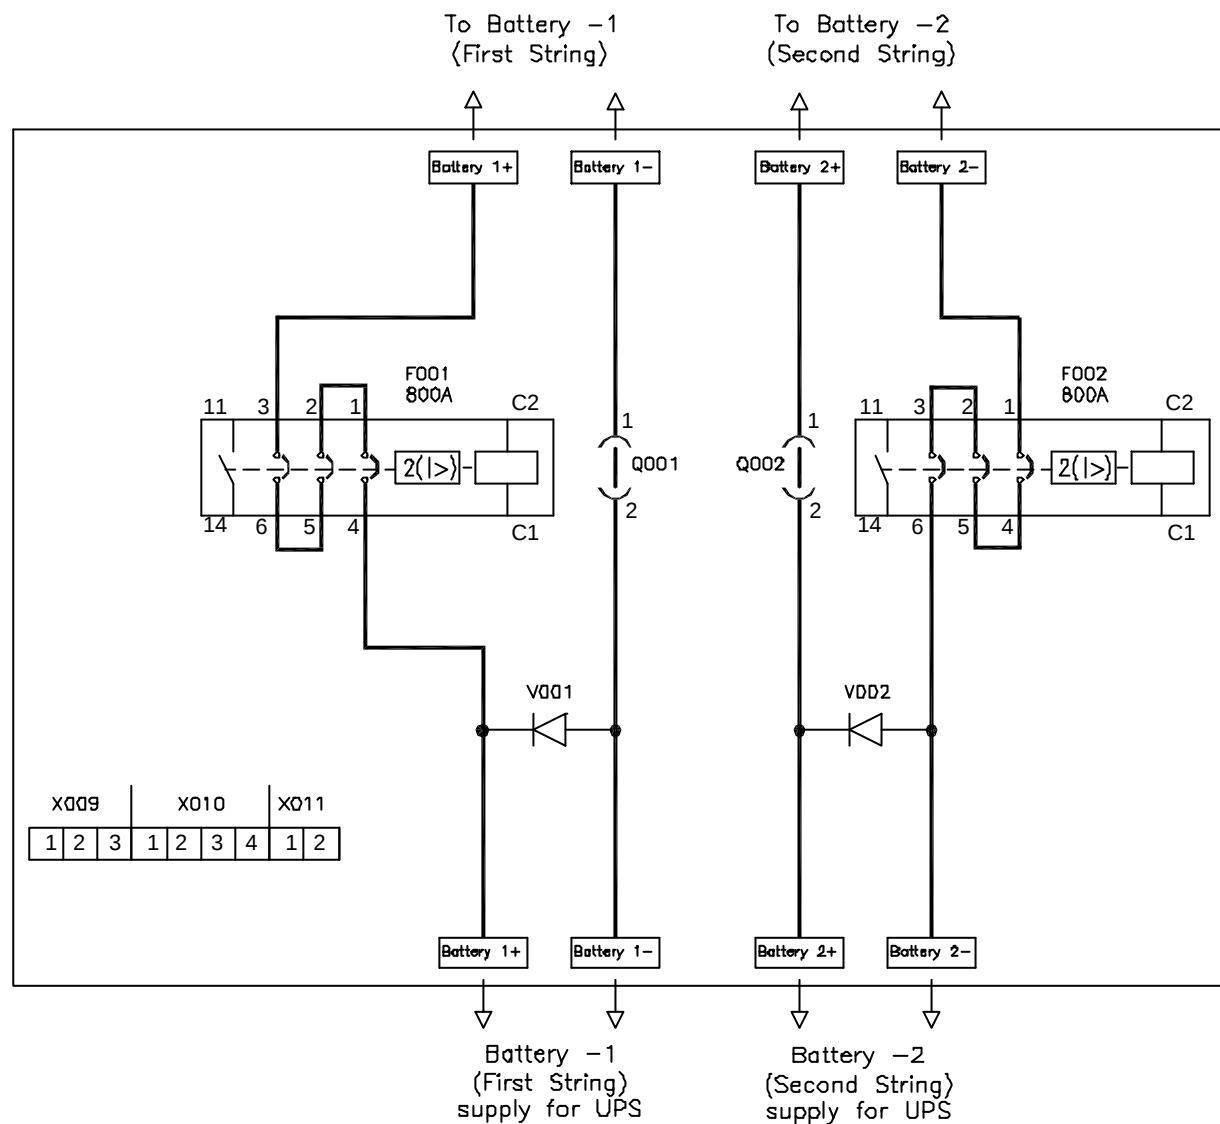

THIS DRAWING AND SPECIFICATIONS HEREIN ARE THE PROPERTY OF AMERICAN POWER CONVERSION AND SHALL NOT BE COPIED, REPRODUCED OR USED IN WHOLE OR IN PART, AS THE BASIS FOR THE MANUFACTURE OR SALE OF ITEMS WITHOUT WRITTEN PERMISSION FROM APC. THIS DRAWING IS BASED UPON LATEST AVAILABLE INFORMATION AND IS SUBJECT TO CHANGE WITHOUT NOTICE.

TITLE: SILICON 480KW UPS
BATTERY BREAKER BOX -
ELECTRICAL SCHEMATIC
480KW, 400V

PROJECT: SUBMITTAL DRAWINGS SHEET 1 OF 1

DWG NO: SBB480KH-ES

DESIGNED: Balamurugan 04/01/02
CHECKED: N.Selvaraj 04/01/02
ENGINEER: C.Radhakrishnan 04/01/02

SCALE: NTS
PROJECTION

REV. -

APC
AMERICAN POWER CONVERSION
1142 FARMINGTON RD.
WEST KINGSTON, RI 02892