


NOTE: ALL OUTLETS ARE VIEWED FROM INSIDE OF THE UNIT AND INPUT PLUGS ARE VIEWED FROM OUTSIDE OF THE UNIT.

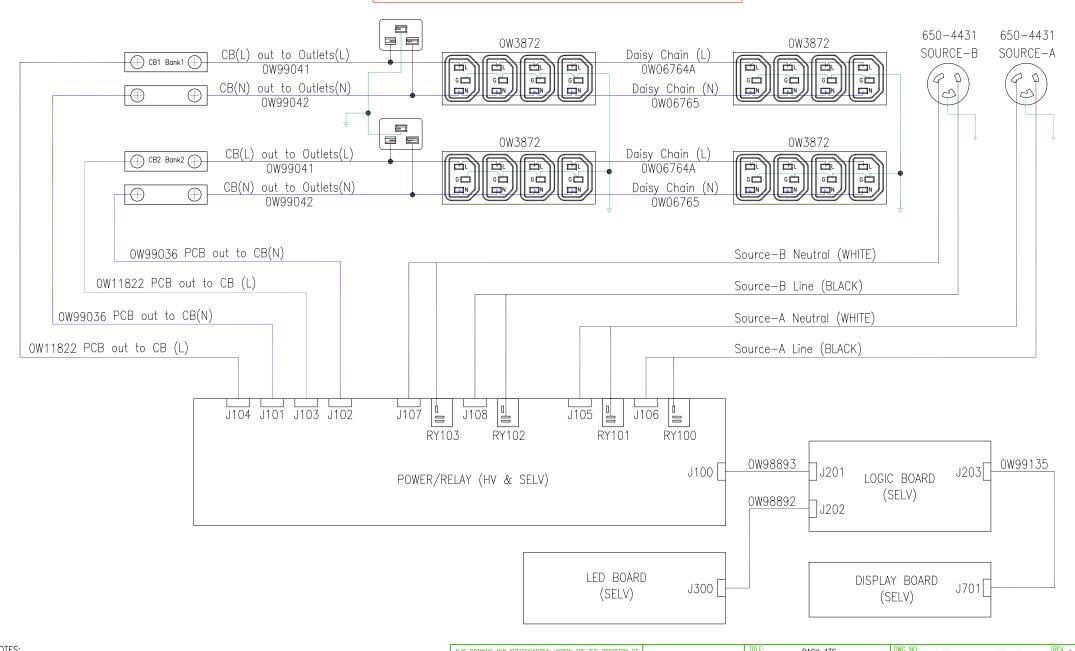

1. INSTALLATION SHALL COMPLY WITH ALL APPLICABLE NATIONAL STATE AND LOCAL ELECTRICAL REGULATIONS

2. REFER TO PRODUCT DOCUMENTATION FOR ADDITIONAL DETAILS PRIOR TO INSTALLATION AND SITE PREPARATION WORK,

3. THIS DRAWING DEPICTS THE POWER SYSTEM CONNECTIONS AND IS NOT REPRESENTATIVE OF THE PHYSICAL LAYOUT. PLEASE REFER TO MECHANICAL DRAWINGS FOR PHYSICAL LAYOUT.

SCHNEIDER ELECTRIC AND SHALL NOT BE COPIED, REPRODUCED OR OR SALE OF ITEMS WITHOUT WRITTEN PERMISSION FROM SCHNEIDE



TLE:	RACK ATS
	30A, 200-208V
	INPUT: (2)NEMA L6-30P (16)IEC 320 C13, (2)IEC 320 C19 GENERAL ARRANGEMENT
	(16)IEC 320 C13, (2)IEC 320 C19
	GENERAL ARRANGEMENT

DWG NO:	REV. O		
DRAWN:	RANJITHA	23-JUN-22	FIRST
ENGINEER:	PETE FISCHER	10-SEP-22	ANGLE

JONATHAN R

10-SEP-22 PROJECTION