


NOTE: ALL OUTLETS AND INPUT PLUGS ARE VIEWED FROM OUTSIDE OF THE UNIT.

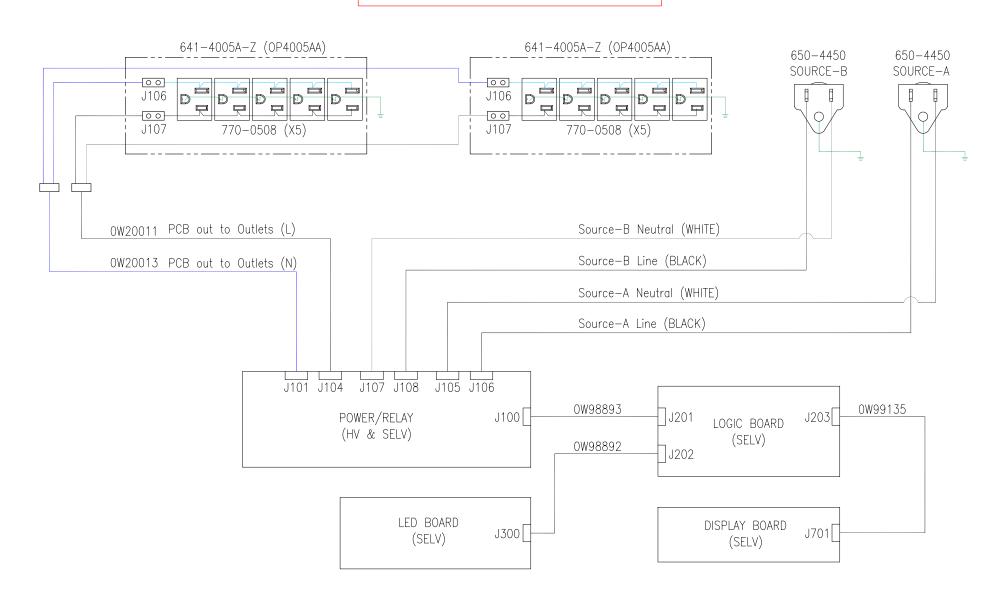

<u>NOTES</u>

1. INSTALLATION SHALL COMPLY WITH ALL APPLICABLE NATIONAL, STATE AND LOCAL ELECTRICAL REGULATIONS.

2. REFER TO PRODUCT DOCUMENTATION FOR ADDITIONAL DETAILS PRIOR TO INSTALLATION AND SITE PREPARATION WORK.

THIS DRAWING DEPICTS THE POWER SYSTEM CONNECTIONS AND IS NOT REPRESENTATIVE OF THE PHYSICAL LAYOUT.
PLEASE REFER TO MECHANICAL DRAWINGS FOR PHYSICAL LAYOUT.

THIS DRAWING AND SPECIFICATIONS HEREIN ARE THE PROPERTY OF SCHNEIDER ELECTRIC AND SHALL NOT BE COPIED, REPRODUCED OR USED IN WHOLE OR IN PART, AS THE BASIS FOR THE MANUFACTURE OR SALE OF ITEMS WITHOUT WRITTEN PERMISSION FROM SCHNEIDER ELECTRIC. THIS DRAWING IS BASED UPON LATEST AVAILABLE INFORMATION AND IS SUBJECT TO CHANGE WITHOUT NOTICE.



RACK ATS	
15A, 100/120V	
10/1, 100/ 1201	
INPUT: (2)NEMA 5-15P OUTPUT: (10)NEMA 5-15R	
CONTRACT CONTRACT CONTRACT	
OUTPUT: (10)NEMA 5-15R	
ELECTRICAL SCHEMATIC	
ELECTRICAL SCHEMATIC	

DWG NO:	P44	50A	REV.
DRAWN:	RANJITHA	24-JUN-22	FIF
ELIGINIEEE	DEEE 5:00:150	07 050 00	1

ELECTRICAL SCHEMATIC ENGINEER: PETE FISCHER 07-SEP-22 ANGLE
PROJECT: SUBMITTAL DRAWINGS SHEET 2 OF 2 APPROVED: JONATHAN R 07-SEP-22 PROJECTION