

SEISMIC TEST CERTIFICATE

The EuT (Equipment under Test): **Converter** (210417-TAF4-as-01); S/N: ATV9B0C20Q6
Firmware: NERA_V2.6IE29_B11

by: **Schneider Electric Power Drives**


has been exposed to triaxial seismic tests according to the

procedures / standards: **IEC 60068-2-57, AC 156**

at IABG LiMAS in: **calendar week 16 2021**

Test level: **Once SE GSTL (A-RIG_h: 1.5 g / A-RIG_v: 0.5 g)**
Once SE level 2 (A-RIG_h: 2.4 g / A-RIG_v: 0.533 g)

Duration: **30 seconds for each seismic load**

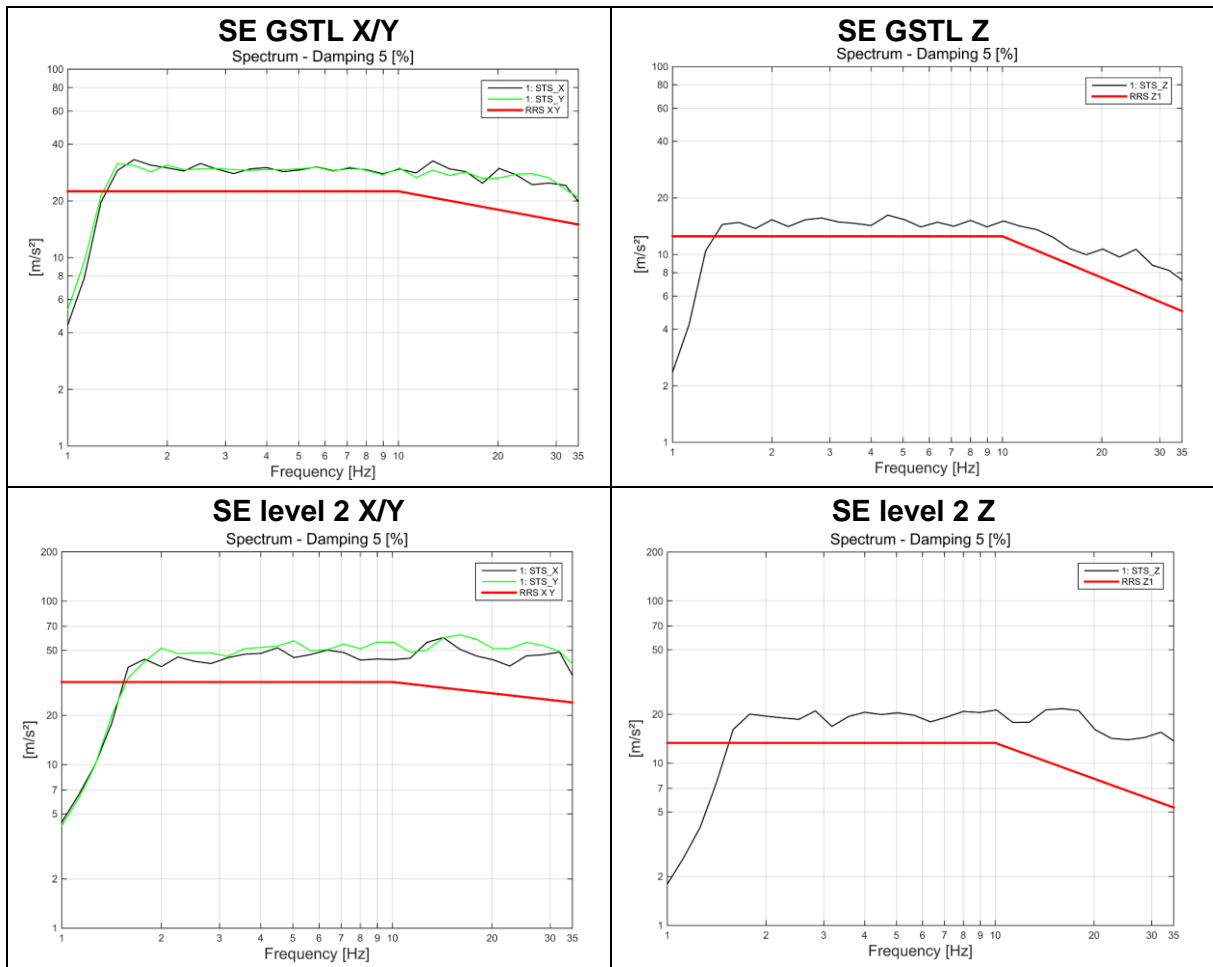


with the result:

The EuT withstood the loads and the functional compliance verification after the test was successful. No visible damage could be detected.

The detailed documentation of the test is given in IABG test report **TAB3-PB-21-078-V2**.

Ottobrunn, 15-06-2021

Florian Bösl
Head of the Dept. TAB3



Muhammed Büyükbas
Test Engineer TAB3