

Wiring Instructions

WIPT Series

10A and 15A, Miniature Series, IP56 Industrial
Plugs recommended for 1.0mm² and 1.5mm²
Ordinary Duty Flexible Cord

- 1 Slip cord grip nut (small end first), screw ring and cover over flexible cord.
- 2 Strip insulation as shown
- 3 *Connect earth wire with green/yellow stripe (or all green) to earth terminal marked 'E' and with green indication.
- 4 *Connect brown (or red) wire to active terminal marked 'A'.
- 5 *Connect blue (or black) wire to neutral terminal marked 'N'.
- 6 Ensure all wires are securely looped under cord grip hooks.
- 7 *Double check earth wire is connected to earth terminal.
- 8 Fit cover, slide screw ring towards cover and tighten cord grip nut.


*For WIPT110-PP and WIPT115-TT (2 pin versions), wiring will differ to the above depending upon the application.

Note: Screw ring must be fitted to provide protection to IP56.


*SAFETY PRECAUTIONS

Ensure earth wire with green/yellow stripes (or all green) is connected to earth terminal marked 'E' and with green indication.

STRIPPING DIMENSIONS

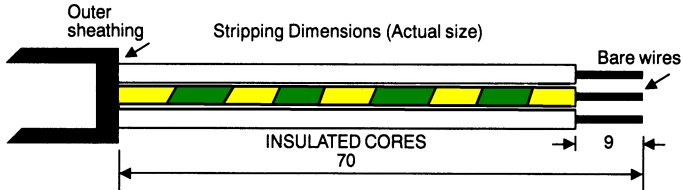

DIAGRAM

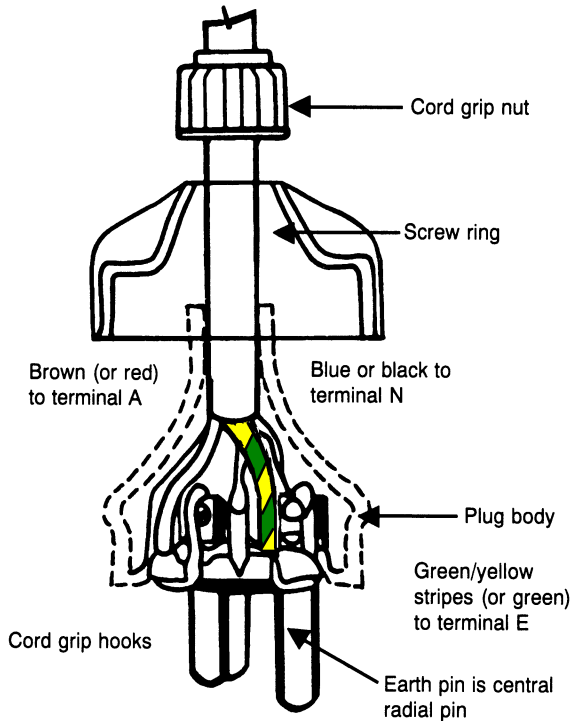

NOTE - WIPT110 SHOWN