

CERTIFICATE OF PRODUCT CERTIFICATION

TYPE II CQC CERTIFICATION

CERTIFICATE NO.: CQC2017010307987848

Valid from: Mar.15,2024

Valid until: Aug.24,2031

NAME AND REGISTERED ADDRESS OF THE APPLICANT Schneider Electric Industries SAS
35 Rue Joseph Monier 92500 Rueil-Malmaison, France

NAME AND REGISTERED ADDRESS OF THE MANUFACTURER Schneider Electric Industries SAS
35 Rue Joseph Monier 92500 Rueil-Malmaison, France

NAME AND LOCATION OF THE FACTORY Schneider Electric Alpes
voie Isaac Newton, ZI Alpespace F-73800 FRANCIN, France

PRODUCT NAME, MODEL AND SPECIFICATION ACB
MTZ2-08/10/12/16/20 N1 , MTZ2-08/10/12/16/20/25 N2 , MTZ2-08/10/12/16/20/25/32/40 H1b/H1/H2/H10 , MTZ2-08/10/12/16/20 L1 , MTZ2-20/25/32/40 H3 ; See the appendix

THE STANDARDS AND TECHNICAL REQUIREMENTS FOR THE PRODUCTS GB/T 14048.2-2020

TYPE OF CERTIFICATION SCHEMES Type Testing of Product + Initial Factory Inspection + Follow up Factory Inspection

This is to certify that the above mentioned product(s) complies with the requirements of certification rules of CQC12-000001-2020.

Date of original issued: Sep.03,2020

The validity of the certificate is subject to positive result of the regular follow up inspection by issuing certification body until the expiry date.

The certificate information is available through the QR code below or CNCA's website: www.cnca.gov.cn



SIGN BY

郑士泉

SIGNATURE

谢肇煦



中国质量认证中心
CHINA QUALITY CERTIFICATION CENTRE

CHINA QUALITY CERTIFICATION CENTRE CO., LTD.
Section 9, No. 188, Nansihuan Xilu, Beijing 100070 P. R. China

Tel: +86 10 83886666
<http://www.cqc.com.cn>

CERTIFICATE OF PRODUCT CERTIFICATION

TYPE II CQC CERTIFICATION

CERTIFICATE NO. : CQC2017010307987848

page 1 of 4

paper:

This certificate and attachments shall be used at the same time, and the verification instructions can be found in the main certificate.

MTZ2-08/10/12/16/20 N1 , MTZ2-08/10/12/16/20/25 N2 , MTZ2-08/10/12/16/20/25/32/40 H1b/H1/H2/H10 ,

MTZ2-08/10/12/16/20 L1 , MTZ2-20/25/32/40 H3 ;

Ue : AC220V/415V/440V , AC525V , AC690V , AC800V (仅 H10) , AC1140V (仅 H10) ; Uimp : 12kV ; Ui : 1000V (N1/N2/
H1b/H1/H2/H3/L1) , 1250V (H10) ;

MTZ2-08/10/12/16/20 N1 :

In : 800A , 1000A , 1250A , 1600A , 2000A ; Ics : 42kA , Icu : 42kA , Icw : 42kA/1s ;

MTZ2-08/10/12/16/20/25 N2 :

In : 800A , 1000A , 1250A , 1600A , 2000A , 2500A ; Ics : 50kA , Icu : 50kA , Icw : 50kA/1s ;

MTZ2-08/10/12/16/20/25/32/40 H1 :

In : 800A , 1000A , 1250A , 1600A , 2000A , 2500A , 3200A , 4000A ; Ics : 66kA , Icu : 66kA , Icw : 66kA/1s (800A , 1000A ,
1250A , 1600A , 2000A) ; 66kA/3s (2500A , 3200A , 4000A) ;

MTZ2-08/10/12/16/20/25/32/40 H1b :

In : 800A , 1000A , 1250A , 1600A , 2000A , 2500A , 3200A , 4000A ; Ics : 85kA , Icu : 85kA , Icw : 85kA/1s

MTZ2-08/10/12/16/20/25/32/40 H2 :

In : 800A , 1000A , 1250A , 1600A , 2000A , 2500A , 3200A , 4000A ; Ics : 100kA (AC220V/415V/440V) , 85kA (AC525V , AC690V) ;

Icu : 100kA (AC220V/415V/440V) , 85kA (AC525V , AC690V) ; Icw : 85kA/1s ;

MTZ2-20/25/32/40 H3 :

In : 2000A , 2500A , 3200A , 4000A ; Ics : 150kA (AC220V/415V/440V) , 130kA (AC525V) , 100kA (AC690V) ; Icu : 150kA

(AC220V/415V/440V) , 130kA (AC525V) , 100kA (AC690V) ; Icw : 65kA/3s ;

MTZ2-08/10/12/16/20/25/32/40 H10 :

In : 800A , 1000A , 1250A , 1600A , 2000A , 2500A , 3200A , 4000A ; Ics : 50kA , Icu : 50kA , Icw : 50kA/3s

MTZ2-08/10/12/16/20 L1 :

In : 800A , 1000A , 1250A , 1600A , 2000A ; Ics : 150kA (AC220V/415V/440V) , 130kA (AC525V) , 100kA (AC690V) ; Icu : 150kA

(AC220V/415V/440V) , 130kA (AC525V) , 100kA (AC690V) ; Icw : 30kA/3s ;



中国质量认证中心
CHINA QUALITY CERTIFICATION CENTRE

CERTIFICATE OF PRODUCT CERTIFICATION

TYPE II CQC CERTIFICATION

CERTIFICATE NO. : CQC2017010307987848

page 2 of 4

paper:

This certificate and attachments shall be used at the same time, and the verification instructions can be found in the main certificate.

Type of overcurrent release :Electronic ;Selectivity category :B ;Poles :3P, 4P ;Frequency rated :50/60Hz ;Applicable for isolation ;

Electronic accessories complying with annex N :

Undervoltage release MN, Shunt release MX, Closing electromagnet XF , See the table below ;

Undervoltage release (MN) , Shunt release (MX) ,Closing electromagnet (XF)

MN		MN Diag.	
Code	Voltage	Code	Voltage
LV833668 LV833668SP	24Vac 50/60Hz, 24-30Vdc	LV836668 LV836668SP	24Vac 50/60Hz, 24-30Vdc
LV833670 LV833670SP	100-130Vac 50/60Hz, 100-130Vdc	LV836670 LV836670SP	100-130Vac 50/60Hz, 100-130Vdc
LV833671 LV833671SP	200-250Vac 50/60Hz, 200-250Vdc	LV836671 LV836671SP	200-250Vac 50/60Hz, 200-250Vdc
LV833673 LV833673SP	380-480Vac 50/60Hz	LV836673 LV836673SP	380-480Vac 50/60Hz
33668	24-30V DC ; 24V AC 50/60 Hz		
33669	48-60V DC ; 48V AC 50/60 Hz		
33670	100-130V DC ; 100-130V AC 50/60 Hz		
33671	200-250V DC ; 200-250V AC 50/60 Hz		
33673	380-480V AC 50/60 Hz		
MX/XF		MX/XF Diag. & COM	
Code	Voltage	Code	Voltage
LV833659 LV833659SP	24Vac 50/60Hz, 24-30Vdc	LV833033 LV833033SP	24Vac 50/60Hz, 24-30Vdc



中国质量认证中心
CHINA QUALITY CERTIFICATION CENTRE

CERTIFICATE OF PRODUCT CERTIFICATION

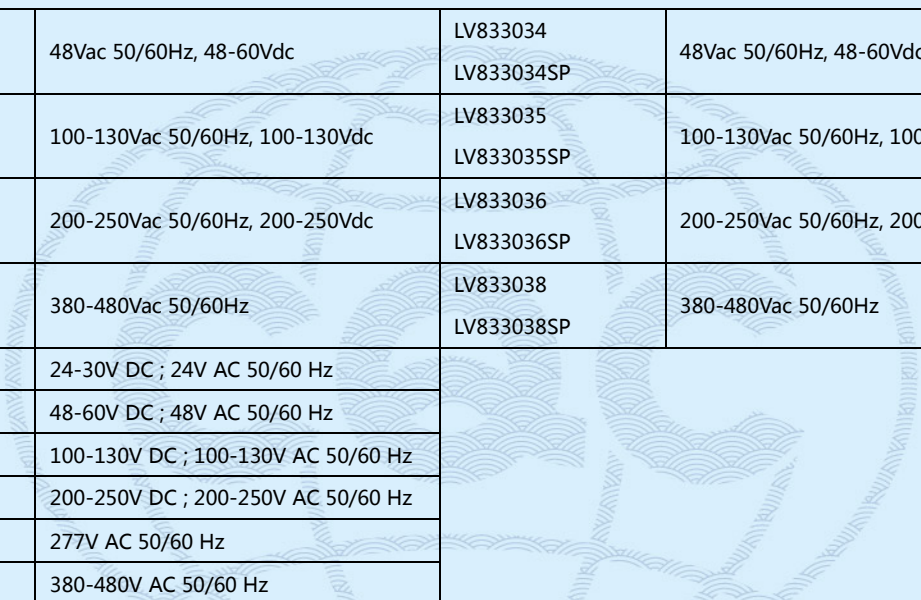
TYPE II CQC CERTIFICATION

CERTIFICATE NO. : CQC2017010307987848

page3of 4

paper:

This certificate and attachments shall be used at the same time, and the verification instructions can be found in the main certificate.

LV833660 LV833660SP	48Vac 50/60Hz, 48-60Vdc	LV833034 LV833034SP	48Vac 50/60Hz, 48-60Vdc
LV833661 LV833661SP	100-130Vac 50/60Hz, 100-130Vdc	LV833035 LV833035SP	100-130Vac 50/60Hz, 100-130Vdc
LV833662 LV833662SP	200-250Vac 50/60Hz, 200-250Vdc	LV833036 LV833036SP	200-250Vac 50/60Hz, 200-250Vdc
LV833664 LV833664SP	380-480Vac 50/60Hz	LV833038 LV833038SP	380-480Vac 50/60Hz
33659	24-30V DC ; 24V AC 50/60 Hz		
33660	48-60V DC ; 48V AC 50/60 Hz		
33661	100-130V DC ; 100-130V AC 50/60 Hz		
33662	200-250V DC ; 200-250V AC 50/60 Hz		
33663	277V AC 50/60 Hz		
33664	380-480V AC 50/60 Hz		



中国质量认证中心
CHINA QUALITY CERTIFICATION CENTRE

CERTIFICATE OF PRODUCT CERTIFICATION

TYPE II CQC CERTIFICATION

CERTIFICATE NO. : CQC2017010307987848

page4of 4

paper:

This certificate and attachments shall be used at the same time, and the verification instructions can be found in the main certificate.

Type Description :

MTZ2 - 40 H2

(1) (2) (3)

(1) Model

(2) Current Ratings :

08-800A

10-1000A

12-1250A

16-1600A

20-2000A

25-2500A

32-3200A

40-4000A

(3) Breaking capacity :

N1, N2 : -General type

H1, H1b, H2, H3, H10- Heavy Duty type

L1-Current-limiting type ;



中国质量认证中心
CHINA QUALITY CERTIFICATION CENTRE