

# CERTIFICATE OF PRODUCT CERTIFICATION

## TYPE II CQC CERTIFICATION

CERTIFICATE NO.: CQC2017010307997627

Valid from: Mar.25,2024

Valid until: Aug.24,2031

**NAME AND REGISTERED ADDRESS OF THE APPLICANT** Schneider Electric Industries SAS  
35 Rue Joseph Monier, 92500 Rueil-Malmaison France

**NAME AND REGISTERED ADDRESS OF THE MANUFACTURER** Schneider Electric Industries SAS  
35 Rue Joseph Monier, 92500 Rueil-Malmaison France

**NAME AND LOCATION OF THE FACTORY** Schneider Electric Alpes  
voie Isaac Newton, ZI Alpespace F-73800 FRANCCIN, France

**PRODUCT NAME, MODEL AND SPECIFICATION** ACB  
MTZ1-06/08/10/12/16 H1/H2/H3,MTZ1-06/08/10 L1; See the Appendix

**THE STANDARDS AND TECHNICAL REQUIREMENTS FOR THE PRODUCTS** GB/T 14048.2-2020

**TYPE OF CERTIFICATION SCHEMES** Type Testing of Product + Initial Factory Inspection + Follow up Factory Inspection

This is to certify that the above mentioned product(s) complies with the requirements of certification rules of CQC12-000001-2020.

Date of original issued: Sep.03,2020

The validity of the certificate is subject to positive result of the regular follow up inspection by issuing certification body until the expiry date.

The certificate information is available through the QR code below or CNCA's website: [www.cnca.gov.cn](http://www.cnca.gov.cn)



SIGN BY

郑士泉

SIGNATURE

谢肇煦



中国质量认证中心  
CHINA QUALITY CERTIFICATION CENTRE

CHINA QUALITY CERTIFICATION CENTRE CO., LTD.  
Section 9, No. 188, Nansihuan Xilu, Beijing 100070 P. R. China

Tel: +86 10 83886666  
<http://www.cqc.com.cn>

# CERTIFICATE OF PRODUCT CERTIFICATION

## TYPE II CQC CERTIFICATION

CERTIFICATE NO. : CQC2017010307997627

page 1 of 5

paper:

This certificate and attachments shall be used at the same time, and the verification instructions can be found in the main certificate.

MTZ1-06/08/10/12/16 H1/H2/H3, MTZ1-06/08/10 L1;

Uimp:12kV;Ui:1000V;

MTZ1-06/08/10/12/16 H1:

Ue:AC220/415/440V, AC525V, AC690V;In: 630A, 800A,1000A,1250A,1600A;

Type of overcurrent release:Electronic;

Ics:42kA;Icu:42kA;Icw:42kA/1s;

Selectivity category: B;Poles: 3P, 4P;Frequency rated:50/60Hz

MTZ1-06/08/10/12/16 H2:

Ue:AC220/415/440V, AC525V, AC690V;In: 630A, 800A,1000A,1250A,1600A;

Type of overcurrent release:Electronic;

Ics: AC220/415/440V/50kA, AC525V/42kA, AC690V/42kA;

Icu: AC220/415/440V/50kA, AC525V/42kA,AC690V/42kA;Icw:42kA/1s;

Selectivity category: B;Poles: 3P, 4P;Frequency rated:50/60Hz

MTZ1-06/08/10/12/16 H3:

Ue:AC220/415/440V;In: 630A, 800A,1000A,1250A,1600A;

Type of overcurrent release:Electronic;

Ics:50kA;Icu:66kA;Icw:50kA/1s;

Selectivity category: B;Poles: 3P, 4P;Frequency rated:50/60Hz

MTZ1-06/08/10 L1:

Ue:AC220/415V, AC440V, AC525V;In: 630A, 800A,1000A;

Type of overcurrent release:Electronic;

Ics: AC220/415V/150kA, AC440V/130kA, AC525V /100kA;

Icu: AC220/415V/150kA, AC440V/130kA,AC525V /100kA;

Selectivity category: A;Poles: 3P, 4P;Frequency rated:50/60Hz



中国质量认证中心  
CHINA QUALITY CERTIFICATION CENTRE

# CERTIFICATE OF PRODUCT CERTIFICATION

## TYPE II CQC CERTIFICATION

**CERTIFICATE NO. : CQC2017010307997627**

page2of 5

paper:

This certificate and attachments shall be used at the same time, and the verification instructions can be found in the main certificate.

Electronic accessories complying with annex N :

Undervoltage release MN、 Shunt release MX、 Closing electromagnet XF , See the table below ;

Undervoltage release ( MN ) , Shunt release ( MX ) ,Closing electromagnet ( XF )

MN		MN Diag.	
Code	Voltage	Code	Voltage
LV833668 LV833668SP	24Vac 50/60Hz, 24-30Vdc	LV836668 LV836668SP	24Vac 50/60Hz, 24-30Vdc
LV833670 LV833670SP	100-130Vac 50/60Hz, 100-130Vdc	LV836670 LV836670SP	100-130Vac 50/60Hz, 100-130Vdc
LV833671 LV833671SP	200-250Vac 50/60Hz, 200-250Vdc	LV836671 LV836671SP	200-250Vac 50/60Hz, 200-250Vdc
LV833673 LV833673SP	380-480Vac 50/60Hz	LV836673 LV836673SP	380-480Vac 50/60Hz
33668	24-30V DC ; 24V AC 50/60 Hz		
33669	48-60V DC ; 48V AC 50/60 Hz		
33670	100-130V DC ; 100-130V AC 50/60 Hz		
33671	200-250V DC ; 200-250V AC 50/60 Hz		
33673	380-480V AC 50/60 Hz		
MX/XF		MX/XF Diag. & COM	
Code	Voltage	Code	Voltage
LV833659 LV833659SP	24Vac 50/60Hz, 24-30Vdc	LV833033 LV833033SP	24Vac 50/60Hz, 24-30Vdc
LV833660	48Vac 50/60Hz, 48-60Vdc	LV833034	48Vac 50/60Hz, 48-60Vdc



**中国质量认证中心**  
CHINA QUALITY CERTIFICATION CENTRE

# CERTIFICATE OF PRODUCT CERTIFICATION


## TYPE II CQC CERTIFICATION

**CERTIFICATE NO. : CQC2017010307997627**

page 3 of 5

paper:

This certificate and attachments shall be used at the same time, and the verification instructions can be found in the main certificate.

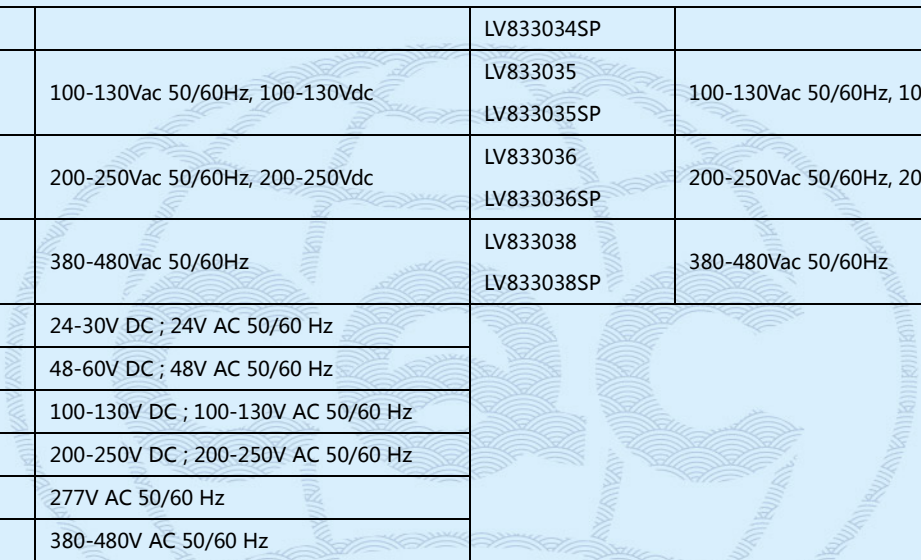LV833660SP		LV833034SP	
LV833661 LV833661SP	100-130Vac 50/60Hz, 100-130Vdc	LV833035 LV833035SP	100-130Vac 50/60Hz, 100-130Vdc
LV833662 LV833662SP	200-250Vac 50/60Hz, 200-250Vdc	LV833036 LV833036SP	200-250Vac 50/60Hz, 200-250Vdc
LV833664 LV833664SP	380-480Vac 50/60Hz	LV833038 LV833038SP	380-480Vac 50/60Hz
33659	24-30V DC ; 24V AC 50/60 Hz		
33660	48-60V DC ; 48V AC 50/60 Hz		
33661	100-130V DC ; 100-130V AC 50/60 Hz		
33662	200-250V DC ; 200-250V AC 50/60 Hz		
33663	277V AC 50/60 Hz		
33664	380-480V AC 50/60 Hz		



**中国质量认证中心**  
CHINA QUALITY CERTIFICATION CENTRE

# CERTIFICATE OF PRODUCT CERTIFICATION


## TYPE II CQC CERTIFICATION

CERTIFICATE NO. : CQC2017010307997627

page4of 5

paper:

This certificate and attachments shall be used at the same time, and the verification instructions can be found in the main certificate.

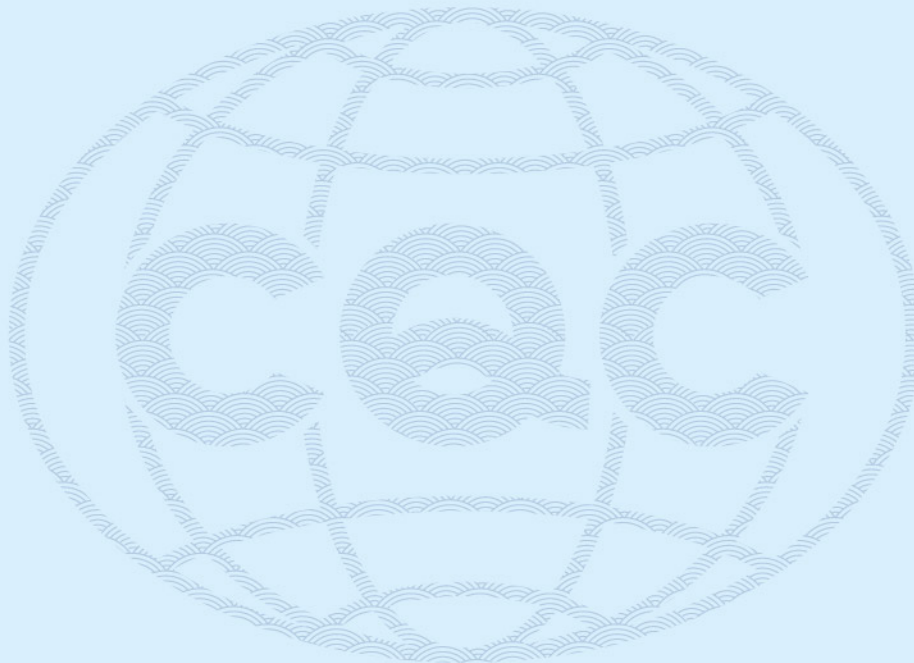

Type Description:

MTZ1 - 16 H2

(1) (2) (3)

(1)Model:

(2)Current rating :

06----630A

08----800A



**中国质量认证中心**  
CHINA QUALITY CERTIFICATION CENTRE

# CERTIFICATE OF PRODUCT CERTIFICATION

## TYPE II CQC CERTIFICATION

CERTIFICATE NO. : CQC2017010307997627

page5of 5

paper:

This certificate and attachments shall be used at the same time, and the verification instructions can be found in the main certificate.

10----1000A


12----1250A

16----1600A

(3)Breaking capacity :

H1, H2, H3-----Heavy duty types

L1-----Current Limiting type

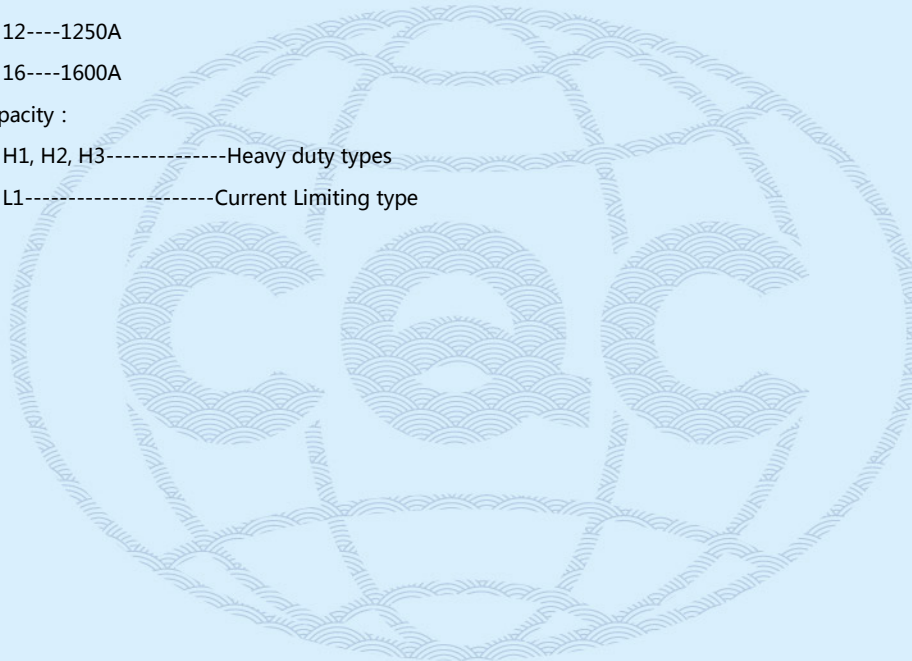

中国质量认证中心  
CHINA QUALITY CERTIFICATION CENTRE