



Ref. Certif. No.

FR_712776/A2

IEC SYSTEM FOR MUTUAL RECOGNITION OF TEST CERTIFICATES FOR ELECTRICAL EQUIPMENT (IECEE) CB SCHEME

CB TEST CERTIFICATE

Product

Circuit-breaker

Name and address of the applicant

SCHNEIDER ELECTRIC INDUSTRIES SAS
31 rue Pierre Mendes France, Eybens
38050 GRENOBLE Cedex 9
FRANCE

Name and address of the manufacturer

SCHNEIDER ELECTRIC INDUSTRIES SAS
31 rue Pierre Mendes France, Eybens
38050 GRENOBLE Cedex 9
FRANCE

Name and address of the factory

Note: When more than one factory, please report on page 2

Additional Information on page 2

Ratings and principal characteristics

See Annex

Trademark / Brand (if any)



Customer's Testing Facility (CTF) Stage used

CTF2

Model / Type Ref.

Series iC60N
See Annex

Additional information (if necessary may also be reported on page 2)

Supersedes CBTC FR_712776/A1 dated 09/02/2022. Editorial correction of the annex

Additional Information on page 2

A sample of the product was tested and found to be in conformity with

IEC 60947-1:2007 +A1:2010 +A2:2014
IEC 60947-2:2016 +A1:2019

As shown in the Test Report Ref. No. which forms part of this Certificate

167882-752710-D-A1

This CB Test Certificate is issued by the National Certification Body




LABORATOIRE CENTRAL DES INDUSTRIES ELECTRIQUES - LCIE
33 avenue du Général Leclerc
92260 Fontenay-aux-Roses, FRANCE

www.lcie.fr



LABORATOIRE CENTRAL DES INDUSTRIES ELECTRIQUES
S.A.S au capital de 15.745.984 €
RCS Nanterre B 408 363 174
33 avenue du Général Leclerc
F - 92266 FONTENAY AUX ROSES

Signature: 
Julien Gauthier
Certification Officer

Date: 18/10/2022

ANNEX

Name and address of the factories:**MERLIN GERIN ALES**

1 Rue Charles Peguy
30319 ALES CEDEX
FRANCE

SCHNEIDER ELECTRIC BULGARIA EOOD

Plovdiv plant
4202 RADINOVO PLOVDIV
BULGARIA

Schneider Electric India Pvt. Ltd.


Plot No - 172, Poonamallee Bye Pass Road, Poonamallee, Tamil Nadu
600056 CHENNAI
INDIA



LABORATOIRE CENTRAL DES INDUSTRIES ELECTRIQUES - LCIE
33 avenue du Général Leclerc
92260 Fontenay-aux-Roses, FRANCE

www.lcie.fr

Date: 18/10/2022

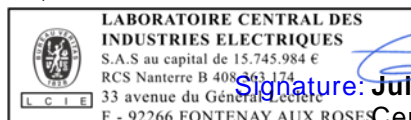


Signature: *Julien Gauthier*
Julien Gauthier
Certification Officer

ANNEX

Generic reference	Icn (A)	Instantaneous tripping current	Number of poles	In (A)	Factory Alès	Factory Plodiv	Factory Chennai
iC60N 1P 0,5A B	6000	B	1	0,5	X (1)	X (2)	X (2)
iC60N 1P 1A B	6000	B	1	1	X (1)	X (2)	X (2)
iC60N 1P 2A B	6000	B	1	2	X (1)	X (2)	X (2)
iC60N 1P 3A B	6000	B	1	3	X (1)	X (2)	X (2)
iC60N 1P 4A B	6000	B	1	4	X (1)	X (2)	X (2)
iC60N 1P 6A B	6000	B	1	6	X (1)	X (2)	X (2)
iC60N 1P 10A B	6000	B	1	10	X (1)	X (2)	X (2)
iC60N 1P 13A B	6000	B	1	13	X (1)	X (1)	X (1)
iC60N 1P 16A B	6000	B	1	16	X (1)	X (2)	X (2)
iC60N 1P 20A B	6000	B	1	20	X (1)	X (2)	X (2)
iC60N 1P 25A B	6000	B	1	25	X (1)	X (2)	X (2)
iC60N 1P 32A B	6000	B	1	32	X (1)	X (2)	X (2)
iC60N 1P 40A B	6000	B	1	40	X (1)	X (2)	X (2)
iC60N 1P 50A B	6000	B	1	50	X (1)	X (2)	X (2)
iC60N 1P 63A B	6000	B	1	63	X (1)	X (2)	X (2)
iC60N 1PPN 0,5A B	6000	B	1+N	0,5	X (1)	X (1)	X (2)
iC60N 1PPN 1A B	6000	B	1+N	1	X (1)	X (1)	X (2)
iC60N 1PPN 2A B	6000	B	1+N	2	X (1)	X (1)	X (2)
iC60N 1PPN 3A B	6000	B	1+N	3	X (1)	X (1)	X (2)
iC60N 1PPN 4A B	6000	B	1+N	4	X (1)	X (1)	X (2)
iC60N 1PPN 6A B	6000	B	1+N	6	X (1)	X (1)	X (2)
iC60N 1PPN 10A B	6000	B	1+N	10	X (1)	X (1)	X (2)
iC60N 1PPN 13A B	6000	B	1+N	13	X (1)	X (1)	X (2)
iC60N 1PPN 16A B	6000	B	1+N	16	X (1)	X (1)	X (2)
iC60N 1PPN 20A B	6000	B	1+N	20	X (1)	X (1)	X (2)
iC60N 1PPN 25A B	6000	B	1+N	25	X (1)	X (1)	X (2)
iC60N 1PPN 32A B	6000	B	1+N	32	X (1)	X (1)	X (2)
iC60N 1PPN 40A B	6000	B	1+N	40	X (1)	X (1)	X (2)
iC60N 1PPN 50A B	6000	B	1+N	50	X (1)	X (1)	X (2)
iC60N 1PPN 63A B	6000	B	1+N	63	X (1)	X (1)	X (2)
iC60N 2P 0,5A B	6000	B	2	0,5	X (1)	X (2)	X (2)
iC60N 2P 1A B	6000	B	2	1	X (1)	X (2)	X (2)
iC60N 2P 2A B	6000	B	2	2	X (1)	X (2)	X (2)
iC60N 2P 3A B	6000	B	2	3	X (1)	X (2)	X (2)
iC60N 2P 4A B	6000	B	2	4	X (1)	X (2)	X (2)
iC60N 2P 6A B	6000	B	2	6	X (1)	X (2)	X (2)
iC60N 2P 10A B	6000	B	2	10	X (1)	X (2)	X (2)
iC60N 2P 13A B	6000	B	2	13	X (1)	X (1)	X (1)
iC60N 2P 16A B	6000	B	2	16	X (1)	X (2)	X (2)
iC60N 2P 20A B	6000	B	2	20	X (1)	X (2)	X (2)
iC60N 2P 25A B	6000	B	2	25	X (1)	X (2)	X (2)
iC60N 2P 32A B	6000	B	2	32	X (1)	X (2)	X (2)
iC60N 2P 40A B	6000	B	2	40	X (1)	X (2)	X (2)
iC60N 2P 50A B	6000	B	2	50	X (1)	X (2)	X (2)



LABORATOIRE CENTRAL DES INDUSTRIES ELECTRIQUES - LCIE
 33 avenue du Général Leclerc
 92260 Fontenay-aux-Roses, FRANCE
www.lcie.fr



Signature: *Julien Gauthier*
 Certification Officer

Date: 18/10/2022


ANNEX


Generic reference	Icn (A)	Instantaneous tripping current	Number of poles	In (A)	Factory Alès	Factory Plovdiv	Factory Chennai
iC60N 2P 63A B	6000	B	2	63	X (1)	X (2)	X (2)
iC60N 3P 0,5A B	6000	B	3	0,5	X (1)	X (2)	X (2)
iC60N 3P 1A B	6000	B	3	1	X (1)	X (2)	X (2)
iC60N 3P 2A B	6000	B	3	2	X (1)	X (2)	X (2)
iC60N 3P 3A B	6000	B	3	3	X (1)	X (2)	X (2)
iC60N 3P 4A B	6000	B	3	4	X (1)	X (2)	X (2)
iC60N 3P 6A B	6000	B	3	6	X (1)	X (2)	X (2)
iC60N 3P 10A B	6000	B	3	10	X (1)	X (2)	X (2)
iC60N 3P 13A B	6000	B	3	13	X (1)	X (1)	X (1)
iC60N 3P 16A B	6000	B	3	16	X (1)	X (2)	X (2)
iC60N 3P 20A B	6000	B	3	20	X (1)	X (2)	X (2)
iC60N 3P 25A B	6000	B	3	25	X (1)	X (2)	X (2)
iC60N 3P 32A B	6000	B	3	32	X (1)	X (2)	X (2)
iC60N 3P 40A B	6000	B	3	40	X (1)	X (2)	X (2)
iC60N 3P 50A B	6000	B	3	50	X (1)	X (2)	X (2)
iC60N 3P 63A B	6000	B	3	63	X (1)	X (2)	X (2)
iC60N 4P 0,5A B	6000	B	4	0,5	X (1)	X (2)	X (2)
iC60N 4P 1A B	6000	B	4	1	X (1)	X (2)	X (2)
iC60N 4P 2A B	6000	B	4	2	X (1)	X (2)	X (2)
iC60N 4P 3A B	6000	B	4	3	X (1)	X (2)	X (2)
iC60N 4P 4A B	6000	B	4	4	X (1)	X (2)	X (2)
iC60N 4P 6A B	6000	B	4	6	X (1)	X (2)	X (2)
iC60N 4P 10A B	6000	B	4	10	X (1)	X (2)	X (2)
iC60N 4P 13A B	6000	B	4	13	X (1)	X (1)	X (1)
iC60N 4P 16A B	6000	B	4	16	X (1)	X (2)	X (2)
iC60N 4P 20A B	6000	B	4	20	X (1)	X (2)	X (2)
iC60N 4P 25A B	6000	B	4	25	X (1)	X (2)	X (2)
iC60N 4P 32A B	6000	B	4	32	X (1)	X (2)	X (2)
iC60N 4P 40A B	6000	B	4	40	X (1)	X (2)	X (2)
iC60N 4P 50A B	6000	B	4	50	X (1)	X (2)	X (2)
iC60N 4P 63A B	6000	B	4	63	X (1)	X (2)	X (2)



LABORATOIRE CENTRAL DES INDUSTRIES ELECTRIQUES - LCIE
 33 avenue du Général Leclerc
 92260 Fontenay-aux-Roses, FRANCE
www.lcie.fr

Date: 18/10/2022

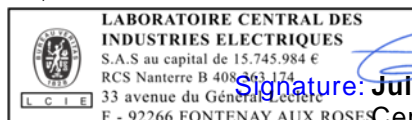

Signature:  Julien Gauthier
 Certification Officer

ANNEX

Generic reference	Icn (A)	Instantaneous tripping current	Number of poles	In (A)	Factory Alès	Factory Plovdiv	Factory Chennai
iC60N 1P 0,5A C	6000	C	1	0,5	X (1)	X (2)	X (2)
iC60N 1P 1A C	6000	C	1	1	X (1)	X (2)	X (2)
iC60N 1P 2A C	6000	C	1	2	X (1)	X (2)	X (2)
iC60N 1P 3A C	6000	C	1	3	X (1)	X (2)	X (2)
iC60N 1P 4A C	6000	C	1	4	X (1)	X (2)	X (2)
iC60N 1P 6A C	6000	C	1	6	X (1)	X (2)	X (2)
iC60N 1P 10A C	6000	C	1	10	X (1)	X (2)	X (2)
iC60N 1P 13A C	6000	C	1	13	X (1)	X (1)	X (1)
iC60N 1P 16A C	6000	C	1	16	X (1)	X (2)	X (2)
iC60N 1P 20A C	6000	C	1	20	X (1)	X (2)	X (2)
iC60N 1P 25A C	6000	C	1	25	X (1)	X (2)	X (2)
iC60N 1P 32A C	6000	C	1	32	X (1)	X (2)	X (2)
iC60N 1P 40A C	6000	C	1	40	X (1)	X (2)	X (2)
iC60N 1P 50A C	6000	C	1	50	X (1)	X (2)	X (2)
iC60N 1P 63A C	6000	C	1	63	X (1)	X (2)	X (2)
iC60N 1PPN 0,5A C	6000	C	1+N	0,5	X (1)	X (1)	X (2)
iC60N 1PPN 1A C	6000	C	1+N	1	X (1)	X (1)	X (2)
iC60N 1PPN 2A C	6000	C	1+N	2	X (1)	X (1)	X (2)
iC60N 1PPN 3A C	6000	C	1+N	3	X (1)	X (1)	X (2)
iC60N 1PPN 4A C	6000	C	1+N	4	X (1)	X (1)	X (2)
iC60N 1PPN 6A C	6000	C	1+N	6	X (1)	X (1)	X (2)
iC60N 1PPN 10A C	6000	C	1+N	10	X (1)	X (1)	X (2)
iC60N 1PPN 13A C	6000	C	1+N	13	X (1)	X (1)	X (2)
iC60N 1PPN 16A C	6000	C	1+N	16	X (1)	X (1)	X (2)
iC60N 1PPN 20A C	6000	C	1+N	20	X (1)	X (1)	X (2)
iC60N 1PPN 25A C	6000	C	1+N	25	X (1)	X (1)	X (2)
iC60N 1PPN 32A C	6000	C	1+N	32	X (1)	X (1)	X (2)
iC60N 1PPN 40A C	6000	C	1+N	40	X (1)	X (1)	X (2)
iC60N 1PPN 50A C	6000	C	1+N	50	X (1)	X (1)	X (2)
iC60N 1PPN 63A C	6000	C	1+N	63	X (1)	X (1)	X (2)
iC60N 2P 0,5A C	6000	C	2	0,5	X (1)	X (2)	X (2)
iC60N 2P 1A C	6000	C	2	1	X (1)	X (2)	X (2)
iC60N 2P 2A C	6000	C	2	2	X (1)	X (2)	X (2)
iC60N 2P 3A C	6000	C	2	3	X (1)	X (2)	X (2)
iC60N 2P 4A C	6000	C	2	4	X (1)	X (2)	X (2)
iC60N 2P 6A C	6000	C	2	6	X (1)	X (2)	X (2)
iC60N 2P 10A C	6000	C	2	10	X (1)	X (2)	X (2)
iC60N 2P 13A C	6000	C	2	13	X (1)	X (1)	X (1)
iC60N 2P 16A C	6000	C	2	16	X (1)	X (2)	X (2)
iC60N 2P 20A C	6000	C	2	20	X (1)	X (2)	X (2)
iC60N 2P 25A C	6000	C	2	25	X (1)	X (2)	X (2)
iC60N 2P 32A C	6000	C	2	32	X (1)	X (2)	X (2)
iC60N 2P 40A C	6000	C	2	40	X (1)	X (2)	X (2)
iC60N 2P 50A C	6000	C	2	50	X (1)	X (2)	X (2)
iC60N 2P 63A C	6000	C	2	63	X (1)	X (2)	X (2)



LABORATOIRE CENTRAL DES INDUSTRIES ELECTRIQUES - LCIE
 33 avenue du Général Leclerc
 92260 Fontenay-aux-Roses, FRANCE
www.lcie.fr



LABORATOIRE CENTRAL DES
 INDUSTRIES ELECTRIQUES
 S.A.S au capital de 15.745.984 €
 RCS Nanterre B 408 263 174
 33 avenue du Général Leclerc
 F - 92266 FONTENAY AUX ROSES

Signature:  Julien Gauthier
 Certification Officer

Date: 18/10/2022

ANNEX

Generic reference	Icn (A)	Instantaneous tripping current	Number of poles	In (A)	Factory Alès	Factory Plovdiv	Factory Chennai
iC60N 3P 0,5A C	6000	C	3	0,5	X (1)	X (2)	X (2)
iC60N 3P 1A C	6000	C	3	1	X (1)	X (2)	X (2)
iC60N 3P 2A C	6000	C	3	2	X (1)	X (2)	X (2)
iC60N 3P 3A C	6000	C	3	3	X (1)	X (2)	X (2)
iC60N 3P 4A C	6000	C	3	4	X (1)	X (2)	X (2)
iC60N 3P 6A C	6000	C	3	6	X (1)	X (2)	X (2)
iC60N 3P 10A C	6000	C	3	10	X (1)	X (2)	X (2)
iC60N 3P 13A C	6000	C	3	13	X (1)	X (1)	X (1)
iC60N 3P 16A C	6000	C	3	16	X (1)	X (2)	X (2)
iC60N 3P 20A C	6000	C	3	20	X (1)	X (2)	X (2)
iC60N 3P 25A C	6000	C	3	25	X (1)	X (2)	X (2)
iC60N 3P 32A C	6000	C	3	32	X (1)	X (2)	X (2)
iC60N 3P 40A C	6000	C	3	40	X (1)	X (2)	X (2)
iC60N 3P 50A C	6000	C	3	50	X (1)	X (2)	X (2)
iC60N 3P 63A C	6000	C	3	63	X (1)	X (2)	X (2)
iC60N 4P 0,5A C	6000	C	4	0,5	X (1)	X (2)	X (2)
iC60N 4P 1A C	6000	C	4	1	X (1)	X (2)	X (2)
iC60N 4P 2A C	6000	C	4	2	X (1)	X (2)	X (2)
iC60N 4P 3A C	6000	C	4	3	X (1)	X (2)	X (2)
iC60N 4P 4A C	6000	C	4	4	X (1)	X (2)	X (2)
iC60N 4P 6A C	6000	C	4	6	X (1)	X (2)	X (2)
iC60N 4P 10A C	6000	C	4	10	X (1)	X (2)	X (2)
iC60N 4P 13A C	6000	C	4	13	X (1)	X (1)	X (1)
iC60N 4P 16A C	6000	C	4	16	X (1)	X (2)	X (2)
iC60N 4P 20A C	6000	C	4	20	X (1)	X (2)	X (2)
iC60N 4P 25A C	6000	C	4	25	X (1)	X (2)	X (2)
iC60N 4P 32A C	6000	C	4	32	X (1)	X (2)	X (2)
iC60N 4P 40A C	6000	C	4	40	X (1)	X (2)	X (2)
iC60N 4P 50A C	6000	C	4	50	X (1)	X (2)	X (2)
iC60N 4P 63A C	6000	C	4	63	X (1)	X (2)	X (2)




LABORATOIRE CENTRAL DES INDUSTRIES ELECTRIQUES - LCIE
 33 avenue du Général Leclerc
 92260 Fontenay-aux-Roses, FRANCE

www.lcie.fr

Date: 18/10/2022



LABORATOIRE CENTRAL DES
 INDUSTRIES ELECTRIQUES
 S.A.S au capital de 15.745.984 €
 RCS Nanterre B 408 363 174
 33 avenue du Général Leclerc
 F - 92266 FONTENAY AUX ROSES

Signature:  Julien Gauthier
 Certification Officer

ANNEX

Generic reference	Icn (A)	Instantaneous tripping current	Number of poles	In (A)	Factory Alès	Factory Plovdiv	Factory Chennai
iC60N 1P 0,5A D	6000	D	1	0,5	X (1)	X (2)	-
iC60N 1P 1A D	6000	D	1	1	X (1)	X (2)	-
iC60N 1P 2A D	6000	D	1	2	X (1)	X (2)	-
iC60N 1P 3A D	6000	D	1	3	X (1)	X (2)	-
iC60N 1P 4A D	6000	D	1	4	X (1)	X (2)	-
iC60N 1P 6A D	6000	D	1	6	X (1)	X (2)	-
iC60N 1P 10A D	6000	D	1	10	X (1)	X (2)	-
iC60N 1P 13A D	6000	D	1	13	X (1)	X (1)	-
iC60N 1P 16A D	6000	D	1	16	X (1)	X (2)	-
iC60N 1P 20A D	6000	D	1	20	X (1)	X (2)	-
iC60N 1P 25A D	6000	D	1	25	X (1)	X (2)	-
iC60N 1P 32A D	6000	D	1	32	X (1)	X (2)	-
iC60N 1P 40A D	6000	D	1	40	X (1)	X (2)	-
iC60N 1P 50A D	6000	D	1	50	X (1)	X (2)	-
iC60N 1P 63A D	6000	D	1	63	X (1)	X (2)	-
iC60N 1PPN 0,5A D	6000	D	1+N	0,5	X (1)	X (1)	-
iC60N 1PPN 1A D	6000	D	1+N	1	X (1)	X (1)	-
iC60N 1PPN 2A D	6000	D	1+N	2	X (1)	X (1)	-
iC60N 1PPN 3A D	6000	D	1+N	3	X (1)	X (1)	-
iC60N 1PPN 4A D	6000	D	1+N	4	X (1)	X (1)	-
iC60N 1PPN 6A D	6000	D	1+N	6	X (1)	X (1)	-
iC60N 1PPN 10A D	6000	D	1+N	10	X (1)	X (1)	-
iC60N 1PPN 13A D	6000	D	1+N	13	X (1)	X (1)	-
iC60N 1PPN 16A D	6000	D	1+N	16	X (1)	X (1)	-
iC60N 1PPN 20A D	6000	D	1+N	20	X (1)	X (1)	-
iC60N 1PPN 25A D	6000	D	1+N	25	X (1)	X (1)	-
iC60N 1PPN 32A D	6000	D	1+N	32	X (1)	X (1)	-
iC60N 1PPN 40A D	6000	D	1+N	40	X (1)	X (1)	-
iC60N 1PPN 50A D	6000	D	1+N	50	X (1)	X (1)	-
iC60N 1PPN 63A D	6000	D	1+N	63	X (1)	X (1)	-
iC60N 2P 0,5A D	6000	D	2	0,5	X (1)	X (2)	-
iC60N 2P 1A D	6000	D	2	1	X (1)	X (2)	-
iC60N 2P 2A D	6000	D	2	2	X (1)	X (2)	-
iC60N 2P 3A D	6000	D	2	3	X (1)	X (2)	-
iC60N 2P 4A D	6000	D	2	4	X (1)	X (2)	-
iC60N 2P 6A D	6000	D	2	6	X (1)	X (2)	-
iC60N 2P 10A D	6000	D	2	10	X (1)	X (2)	-
iC60N 2P 13A D	6000	D	2	13	X (1)	X (1)	-
iC60N 2P 16A D	6000	D	2	16	X (1)	X (2)	-




LABORATOIRE CENTRAL DES INDUSTRIES ELECTRIQUES - LCIE
 33 avenue du Général Leclerc
 92260 Fontenay-aux-Roses, FRANCE
www.lcie.fr

Date: 18/10/2022



LABORATOIRE CENTRAL DES
 INDUSTRIES ELECTRIQUES
 S.A.S au capital de 15.745.984 €
 RCS Nanterre B 408 263 174
 33 avenue du Général Leclerc
 F - 92266 FONTENAY AUX ROSES

Signature:  Julien Gauthier
 Certification Officer


ANNEX

Generic reference	Icn (A)	Instantaneous tripping current	Number of poles	In (A)	Factory Alès	Factory Plovdiv	Factory Chennai
iC60N 2P 20A D	6000	D	2	20	X (1)	X (2)	-
iC60N 2P 25A D	6000	D	2	25	X (1)	X (2)	-
iC60N 2P 32A D	6000	D	2	32	X (1)	X (2)	-
iC60N 2P 40A D	6000	D	2	40	X (1)	X (2)	-
iC60N 2P 50A D	6000	D	2	50	X (1)	X (2)	-
iC60N 2P 63A D	6000	D	2	63	X (1)	X (2)	-
iC60N 3P 0,5A D	6000	D	3	0,5	X (1)	X (2)	-
iC60N 3P 1A D	6000	D	3	1	X (1)	X (2)	-
iC60N 3P 2A D	6000	D	3	2	X (1)	X (2)	-
iC60N 3P 3A D	6000	D	3	3	X (1)	X (2)	-
iC60N 3P 4A D	6000	D	3	4	X (1)	X (2)	-
iC60N 3P 6A D	6000	D	3	6	X (1)	X (2)	-
iC60N 3P 10A D	6000	D	3	10	X (1)	X (2)	-
iC60N 3P 13A D	6000	D	3	13	X (1)	X (1)	-
iC60N 3P 16A D	6000	D	3	16	X (1)	X (2)	-
iC60N 3P 20A D	6000	D	3	20	X (1)	X (2)	-
iC60N 3P 25A D	6000	D	3	25	X (1)	X (2)	-



LABORATOIRE CENTRAL DES INDUSTRIES ELECTRIQUES - LCIE
 33 avenue du Général Leclerc
 92260 Fontenay-aux-Roses, FRANCE
www.lcie.fr

Date: 18/10/2022

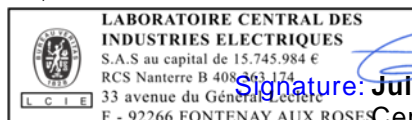

Signature: **Julien Gauthier**
 Certification Officer

ANNEX

Generic reference	Icn (A)	Instantaneous tripping current	Number of poles	In (A)	Factory Alès	Factory Plovdiv	Factory Chennai
iC60N 3P 32A D	6000	D	3	32	X (1)	X (2)	-
iC60N 3P 40A D	6000	D	3	40	X (1)	X (2)	-
iC60N 3P 50A D	6000	D	3	50	X (1)	X (2)	-
iC60N 3P 63A D	6000	D	3	63	X (1)	X (2)	-
iC60N 4P 0,5A D	6000	D	4	0,5	X (1)	X (2)	-
iC60N 4P 1A D	6000	D	4	1	X (1)	X (2)	-
iC60N 4P 2A D	6000	D	4	2	X (1)	X (2)	-
iC60N 4P 3A D	6000	D	4	3	X (1)	X (2)	-
iC60N 4P 4A D	6000	D	4	4	X (1)	X (2)	-
iC60N 4P 6A D	6000	D	4	6	X (1)	X (2)	-
iC60N 4P 10A D	6000	D	4	10	X (1)	X (2)	-
iC60N 4P 13A D	6000	D	4	13	X (1)	X (1)	-
iC60N 4P 16A D	6000	D	4	16	X (1)	X (2)	-
iC60N 4P 20A D	6000	D	4	20	X (1)	X (2)	-
iC60N 4P 25A D	6000	D	4	25	X (1)	X (2)	-
iC60N 4P 32A D	6000	D	4	32	X (1)	X (2)	-
iC60N 4P 40A D	6000	D	4	40	X (1)	X (2)	-
iC60N 4P 50A D	6000	D	4	50	X (1)	X (2)	-
iC60N 4P 63A D	6000	D	4	63	X (1)	X (2)	-

X (1) : When the factory produces the reference without alternative solutions


X (2) : When the factory produces the reference with and without alternative solutions


- : When the factory does not produce the reference



LABORATOIRE CENTRAL DES INDUSTRIES ELECTRIQUES - LCIE
 33 avenue du Général Leclerc
 92260 Fontenay-aux-Roses, FRANCE
www.lcie.fr

Date: 18/10/2022

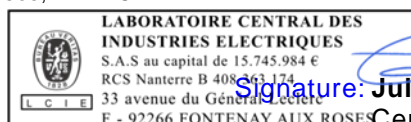

Signature:  Julien Gauthier
 Certification Officer

ANNEX

1 Pole				
Ue (V)	In (A)	Icu (kA)	Ics (kA)	Icm (kA)
133	0,5 – 4	50	50	105
	6 – 63	20	15	40
240	0,5 – 4	50	50	105
	6 – 63	10	7,5	17
2, 3, 4 Poles				
Ue (V)	In (A)	Icu (kA)	Ics (kA)	Icm (kA)
133	0,5 – 4	50	50	105
	6 – 63	20	15	40
240	0,5 – 4	50	50	105
	6 – 63	20	15	40
412	0,5 – 4	50	50	105
	6 – 63	10	7,5	17
440	0,5 – 4	25	25	52,5
	6 – 63	6	4,5	9


Selectivity category	A
Interruption medium	Air
Method of controlling the operating mechanism	Independent manual
Suitability for isolation	Suitable
Provision for maintenance	Non maintainable
Method of installation	Fixed
Protection degree :	IP20
Rated operational voltage Ue : (V)	133/240/415/440
Rated insulation voltage Ui : (V)	500
Rated impulse withstand voltage Uimp : (V)	6000
Rated current Ie : (A)	0,5 up to 63
Conventional free air thermal current Ith : (A)	0,5 up to 63
Rated current for four pole circuit-breakers : (A)	0,5 up to 63
Rated frequency : (Hz)	50/60
Nature of supply :	AC ~
Total number of poles :	1P, 1P+N, 2P, 3P, 4P
Number of protected poles :	all
Rated duty	ininterrupted
Rated short-time making capacity Icm : (A)	See above table
Rated ultimate short-circuit breaking capacity : Icu (A)	See above table
Rated short-time withstand current : Icw (A)	See above table
Electromagnetic compatibility	
Instantaneous tripping current :	B/C/D
Reference ambient calibration air temperature : (°C)	50°C
Pollution degree	3
Material group :	II
Safety distance (short-circuit tests) :	20mm



LABORATOIRE CENTRAL DES INDUSTRIES ELECTRIQUES - LCIE
 33 avenue du Général Leclerc
 92260 Fontenay-aux-Roses, FRANCE
www.lcie.fr



LABORATOIRE CENTRAL DES
 INDUSTRIES ELECTRIQUES
 S.A.S au capital de 15.745.984 €
 RCS Nanterre B 408 263 174
 33 avenue du Général Leclerc
 F - 92266 FONTENAY AUX ROSES

Signature:  Julien Gauthier
 Certification Officer

Date: 18/10/2022