

Product Environmental Profile

Tesys Tera - Electronic motor Temperature sensor unit




General information

Reference product	Tesys Tera - Electronic motor Temperature sensor unit - LTMTPTC
Description of the product	The Tesys Tera system effectively manages the measurement of 3-phase current using integral current transformers, covering a range from 0.3 to 100 A. Additionally, it can handle currents up to 810 A by utilizing external current transformers. The module is powered by a voltage of 100 to 240V AC/DC or 24Vdc. Notably, it is capable of measuring ground current using internal or external ground sensors, as well as motor temperature. Furthermore, it oversees the inputs and outputs for various motor control modes, fault detection, and other associated functions. Temperature module for motor protection, RTD and PTC temperature sensors complaint with IEC 61000-4
Functional unit	Temperature sensor module has Additional PTC for motor protection relays, during 10 years. Module has the following certifications: IEC, UL, cUL.

Constituent materials

Reference product mass	180 g including the product, its packaging and additional elements and accessories
------------------------	--

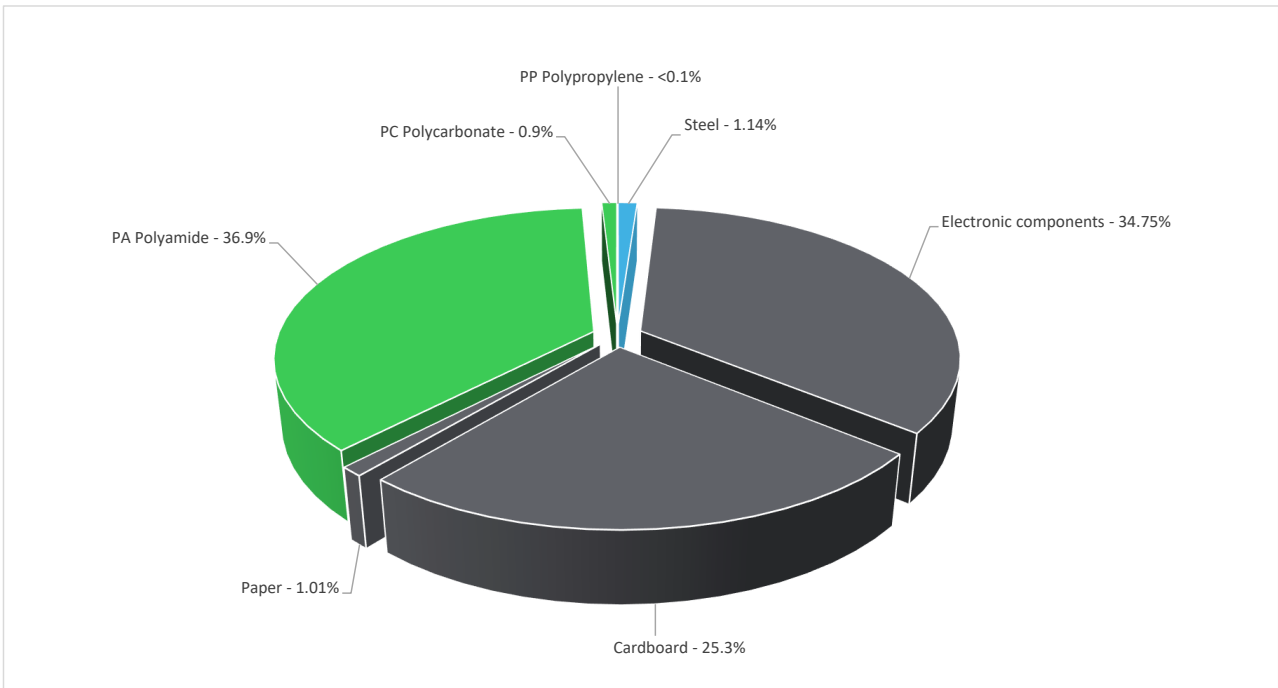

Plastics	37.80%
Metals	1.14%
Others	61.06%

Substance assessment

Details of ROHS and REACH substances information are available on the Schneider-Electric Green Premium website
<https://www.se.com/ww/en/work/support/green-premium/>

Additional environmental information

End Of Life	Recyclability potential:	1%	Recyclability rate has been calculated based on REEECYLAB tool developed by Ecosystem, for components/materials not covered by the tool, data from the "ECO'DEEE recyclability and recoverability calculation method" was taken. If no data was found a conservative assumption was used (0% recyclability).
-------------	--------------------------	----	--

Environmental impacts

Reference service life time	10 years			
Product category	Other equipments - Active product			
Installation elements	No special components needed during installation phase. The disposal of the packaging material is accounted for during this phase (Including transport to disposal).			
Use scenario	The product is in active mode 100% of the time with power use of 0.1038W for 10 years			
Technological representativeness	The Modules of Technologies such as material production, manufacturing process and transport technology used in this PEP analysis (LCA-EIME in this case) are Similar and representative of the actual type of technologies used to make the product in production.			
Geographical representativeness	Europe, Asia & America			
Energy model used	[A1 - A3]	[A5]	[B6]	[C1 - C4]
	Electricity Mix; Production mix; Low voltage; IN	Electricity Mix; Production mix; Low voltage; APAC	Electricity Mix; Production mix; Low voltage; APAC	Electricity Mix; Production mix; Low voltage; APAC
		Electricity Mix; Production mix; Low voltage; US	Electricity Mix; Production mix; Low voltage; US	Electricity Mix; Production mix; Low voltage; US
		Electricity Mix; Production mix; Low voltage; UE-27	Electricity Mix; Production mix; Low voltage; UE-27	Electricity Mix; Production mix; Low voltage; UE-27
		Electricity Mix; Production mix; Low voltage; BR	Electricity Mix; Production mix; Low voltage; BR	Electricity Mix; Production mix; Low voltage; BR

Detailed results, including all the optional indicators mentioned in PCRred4, and the split of the Use Phase (B1 to B7), are available in the LCA report and on demand in a digital format - Country Customer Care Center - <http://www.schneider-electric.com/contact>

Mandatory Indicators			Tesys Tera - Electronic motor Temperature sensor unit - LTMPTC					
Impact indicators	Unit	Total	Manufacturing	Distribution	Installation	Use	End of Life	Loads and Benefits
			[A1 - A3]	[A4]	[A5]	[B1 - B7]	[C1 - C4]	[D]
Contribution to climate change	kg CO2 eq	1.32E+01	6.48E+00	2.35E-02	8.15E-02	6.33E+00	3.01E-01	-3.04E-02
Contribution to climate change-fossil	kg CO2 eq	1.32E+01	6.47E+00	2.35E-02	7.79E-02	6.33E+00	2.96E-01	-2.97E-02
Contribution to climate change-biogenic	kg CO2 eq	1.64E-02	2.99E-03	0*	3.62E-03	4.05E-03	5.78E-03	-7.46E-04
Contribution to climate change-land use and land use change	kg CO2 eq	3.31E-09	3.31E-09	0*	0*	0*	0*	0.00E+00
Contribution to ozone depletion	kg CFC-11 eq	7.75E-07	7.31E-07	0*	5.39E-09	3.06E-08	7.91E-09	-2.18E-09
Contribution to acidification	mol H+ eq	8.88E-02	4.35E-02	1.51E-04	3.23E-04	4.19E-02	2.98E-03	-1.52E-04
Contribution to eutrophication, freshwater	kg (PO4) ³⁻ eq	2.74E-05	2.03E-05	8.82E-09	5.89E-07	4.49E-06	2.03E-06	-2.29E-07
Contribution to eutrophication marine	kg N eq	1.23E-02	5.48E-03	7.11E-05	8.57E-05	4.58E-03	2.12E-03	-3.12E-05
Contribution to eutrophication, terrestrial	mol N eq	1.20E-01	5.87E-02	7.80E-04	6.47E-04	5.87E-02	1.12E-03	-2.77E-04
Contribution to photochemical ozone formation - human health	kg COVNM eq	3.47E-02	1.88E-02	1.97E-04	1.73E-04	1.51E-02	4.34E-04	-7.82E-05
Contribution to resource use, minerals and metals	kg Sb eq	1.90E-03	1.90E-03	0*	0*	2.02E-07	0*	-2.40E-06
Contribution to resource use, fossils	MJ	1.95E+02	7.89E+01	3.28E-01	8.48E-01	1.13E+02	1.61E+00	-3.77E-01
Contribution to water use	m3 eq	3.94E+01	1.28E+00	0*	3.48E-02	2.48E-01	3.78E+01	-1.66E-02

Additional indicators for the French regulation are available as well

Inventory flows Indicators	Tesys Tera - Electronic motor Temperature sensor unit - LTMTPC								
	Inventory flows	Unit	Total	Manufact.	Distribution	Installation	Use	End of Life	Loads and Benefits
				[A1 - A3]	[A4]	[A5]	[B1 - B7]	[C1 - C4]	[D]
Contribution to use of renewable primary energy excluding renewable primary energy used as raw material	MJ	2.50E+01	2.23E+00	0*	6.09E-02	2.25E+01	1.65E-01	1.03E-01	
Contribution to use of renewable primary energy resources used as raw material	MJ	2.19E-01	2.19E-01	0*	0*	0*	0*	-1.75E-01	
Contribution to total use of renewable primary energy resources	MJ	2.52E+01	2.45E+00	0*	6.09E-02	2.25E+01	1.65E-01	-7.17E-02	
Contribution to use of non renewable primary energy excluding non renewable primary energy used as raw material	MJ	1.92E+02	7.65E+01	3.28E-01	8.48E-01	1.13E+02	1.61E+00	-3.77E-01	
Contribution to use of non renewable primary energy resources used as raw material	MJ	2.46E+00	2.46E+00	0*	0*	0*	0*	0.00E+00	
Contribution to total use of non-renewable primary energy resources	MJ	1.95E+02	7.89E+01	3.28E-01	8.48E-01	1.13E+02	1.61E+00	-3.77E-01	
Contribution to use of secondary material	kg	3.87E-02	3.87E-02	0*	0*	0*	0*	0.00E+00	
Contribution to use of renewable secondary fuels	MJ	0.00E+00	0*	0*	0*	0*	0*	0.00E+00	
Contribution to use of non renewable secondary fuels	MJ	0.00E+00	0*	0*	0*	0*	0*	0.00E+00	
Contribution to net use of freshwater	m³	1.03E+00	2.97E-02	0*	8.10E-04	5.78E-03	9.89E-01	-3.87E-04	
Contribution to hazardous waste disposed	kg	2.60E+01	2.57E+01	0*	0*	1.54E-01	1.33E-01	-1.90E-01	
Contribution to non hazardous waste disposed	kg	2.99E+00	1.64E+00	8.25E-04	2.65E-01	1.01E+00	7.24E-02	-2.60E-01	
Contribution to radioactive waste disposed	kg	8.31E-04	6.80E-04	5.88E-07	3.56E-05	1.12E-04	3.22E-06	-1.58E-05	
Contribution to components for reuse	kg	0.00E+00	0*	0*	0*	0*	0*	0.00E+00	
Contribution to materials for recycling	kg	4.67E-02	0*	0*	4.48E-02	0*	1.96E-03	0.00E+00	
Contribution to materials for energy recovery	kg	0.00E+00	0*	0*	0*	0*	0*	0.00E+00	
Contribution to exported energy	MJ	0.00E+00	0*	0*	0*	0*	0*	0.00E+00	
Contribution to biogenic carbon content of the product	kg de C	0.00E+00	0*	0*	0*	0*	0*	0.00E+00	
Contribution to biogenic carbon content of the associated packaging	kg de C	0.00E+00	0*	0*	0*	0*	0*	0.00E+00	

* represents less than 0.01% of the total life cycle of the reference flow

Life cycle assessment performed with EIME version v5.9.4, database version 2022-01 in compliance with ISO14044.

Detailed results, including all the optional indicators mentioned in PCRed4, and the split of the Use Phase (B1 to B7), are available in the LCA report and on demand in a digital format - Country Customer Care Center - <http://www.schneider-electric.com/contact>

Please note that the values given above are only valid within the context specified and cannot be used directly to draw up the environmental assessment of an installation.

Registration number :	ENVPEP2311050_V1-EN	Drafting rules	PEP-PCR-ed4-2021 09 06
Date of issue	02/2024	Supplemented by	PSR-0005-ed2-2016 03 29
		Information and reference documents	www.pep-ecopassport.org
		Validity period	5 years
Independent verification of the declaration and data, in compliance with ISO 14021 : 2016			
Internal <input checked="" type="checkbox"/> External <input type="checkbox"/>			
The PCR review was conducted by a panel of experts chaired by Julie ORGELET (DDemain)			
PEP are compliant with XP C08-100-1 :2016 or EN 50693:2019			
The elements of the present PEP cannot be compared with elements from another program.			
Document in compliance with ISO 14021 : 2016 « Environmental labels and declarations. Type II environmental declarations »			

Schneider Electric Industries SAS

Country Customer Care Center
<http://www.se.com/contact>

35, rue Joseph Monier

CS 30323

F- 92500 Rueil Malmaison Cedex

RCS Nanterre 954 503 439

Capital social 928 298 512 €

www.se.com

Published by Schneider Electric

ENVPEP2311050_V1-EN

©2023 - Schneider Electric – All rights reserved

02/2024