

Product Environmental Profile

389 Series Power Relay




General information

Reference product	389 Series Power Relay - 389FXCXC-120A
Description of the product	The product is an electrically operated switch which enables current to flow through it on one circuit and can switch a current on and off on a second circuit.
Functional unit	389 series power relay offers high contact rating of 20 A at 150 VAC with ability to hold motor loads up to 0.5 hp at 120 to 240 VAC with nominal coil voltage 120 VAC . Maximum switching voltage 300 V makes relay suitable for high-power switching applications. This product will be in active mode at 29% in overall power consumption of 2.38 W with life span of 10 years

Constituent materials

Reference product mass	102.855 g including the product, its packaging and additional elements and accessories
------------------------	--

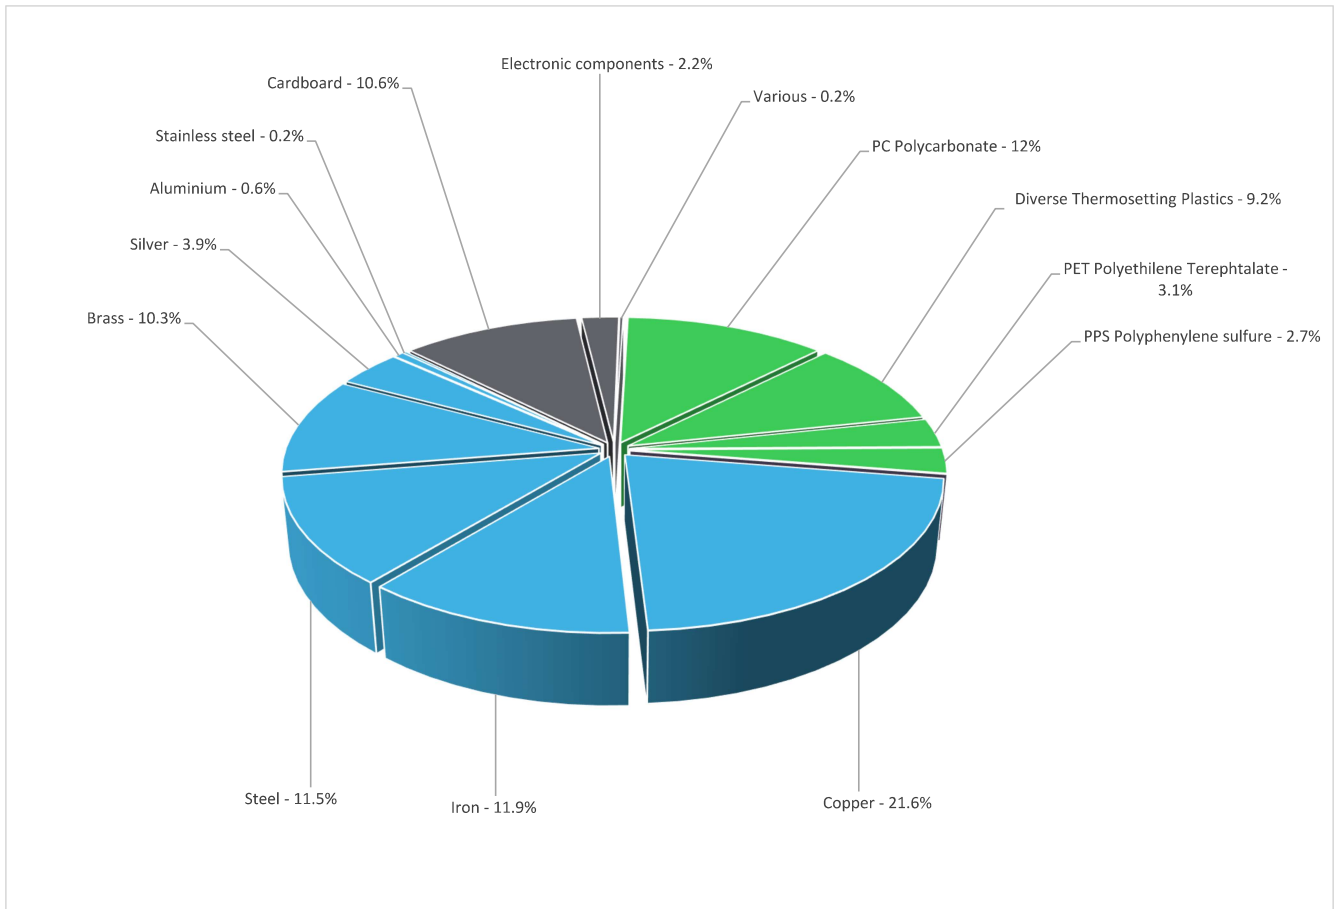

Metals	60.0%
Plastics	27.0%
Others	13.0%

Substance assessment

Details of ROHS and REACH substances information are available on the Schneider-Electric Green Premium website <https://www.se.com/ww/en/work/support/green-premium/>



Additional environmental information

End Of Life	Recyclability potential:	65%	Recyclability rate has been calculated based on REEECYLAB tool developed by Ecosystem, for components/materials not covered by the tool, data from the "ECO'DEEE recyclability and recoverability calculation method" was taken. If no data was found a conservative assumption was used (0% recyclability).
-------------	--------------------------	-----	--



Environmental impacts

Reference service life time	10 years		
Product category	Other equipments - Active product		
Installation elements	No special installation components need during installation phase		
Use scenario	The product is in active mode 29% of the time with a power use of 2.38 W and in off mode 71% of the time with a power use of 0 W for 10 years		
Technological representativeness	The Modules of Technologies such as material production, manufacturing process and transport technology used in this PEP analysis (LCA-EIME in this case) are Similar and representative of the actual type of technologies used to make the product in production		
Geographical representativeness	USA		
Energy model used	[A1 - A3]	[A5]	[B6]
	Electricity Mix; Production mix; Low voltage; CN	Electricity Mix; Production mix; Low voltage; US	Electricity Mix; Production mix; Low voltage; US
			[C1 - C4]
			Electricity Mix; Production mix; Low voltage; US

Detailed results, including all the optional indicators mentioned in PCRred4, and the split of the Use Phase (B1 to B7), are available in the LCA report and on demand in a digital format - Country Customer Care Center - <http://www.schneider-electric.com/contact>

Mandatory Indicators			389 Series Power Relay - 389FXCXC-120A					
Impact indicators	Unit	Total	Manufacturing	Distribution	Installation	Use	End of Life	Loads and Benefits
			[A1 - A3]	[A4]	[A5]	[B1 - B7]	[C1 - C4]	[D]
Contribution to climate change	kg CO2 eq	3.40E+01	7.34E-01	3.59E-02	1.98E-02	3.31E+01	1.90E-01	-2.49E-01
Contribution to climate change-fossil	kg CO2 eq	3.40E+01	7.25E-01	3.59E-02	1.90E-02	3.30E+01	1.86E-01	-2.43E-01
Contribution to climate change-biogenic	kg CO2 eq	4.88E-02	8.43E-03	0*	8.82E-04	3.49E-02	4.59E-03	-5.53E-03
Contribution to climate change-land use and land use change	kg CO2 eq	7.66E-08	0*	0*	0*	0*	7.66E-08	0.00E+00
Contribution to ozone depletion	kg CFC-11 eq	2.95E-07	1.18E-07	3.17E-08	1.31E-09	1.40E-07	3.12E-09	-6.17E-08
Contribution to acidification	mol H+ eq	1.91E-01	1.45E-02	1.57E-04	7.88E-05	1.75E-01	9.94E-04	-4.80E-03
Contribution to eutrophication, freshwater	kg (PO4) ³⁻ eq	2.21E-04	6.86E-06	0*	1.43E-07	5.09E-05	1.63E-04	-7.67E-07
Contribution to eutrophication marine	kg N eq	2.26E-02	1.53E-03	7.21E-05	2.09E-05	2.08E-02	1.63E-04	-1.81E-04
Contribution to eutrophication, terrestrial	mol N eq	2.64E-01	1.67E-02	7.81E-04	1.57E-04	2.44E-01	1.94E-03	-1.98E-03
Contribution to photochemical ozone formation - human health	kg COVNM eq	7.51E-02	5.31E-03	2.56E-04	4.20E-05	6.89E-02	5.49E-04	-8.90E-04
Contribution to resource use, minerals and metals	kg Sb eq	3.40E-03	3.40E-03	0*	0*	1.33E-06	4.60E-06	-6.20E-05
Contribution to resource use, fossils	MJ	7.22E+02	1.12E+01	4.36E-01	2.07E-01	7.01E+02	8.53E+00	-3.81E+00
Contribution to water use	m3 eq	1.76E+00	3.97E-01	1.82E-03	8.47E-03	1.19E+00	1.64E-01	-2.65E-01

Additional indicators for the French regulation are available as well

Inventory flows Indicators		389 Series Power Relay - 389FXCXC-120A						
Inventory flows	Unit	Total	Manufact.	Distribution	Installation	Use	End of Life	Loads and Benefits
			[A1 - A3]	[A4]	[A5]	[B1 - B7]	[C1 - C4]	[D]
Contribution to use of renewable primary energy excluding renewable primary energy used as raw material	MJ	8.87E+01	6.06E-01	0*	1.48E-02	8.80E+01	1.10E-01	4.80E-03
Contribution to use of renewable primary energy resources used as raw material	MJ	2.17E-01	2.17E-01	0*	0*	0*	0*	-1.96E-01
Contribution to total use of renewable primary energy resources	MJ	8.89E+01	8.23E-01	0*	1.48E-02	8.80E+01	1.10E-01	-1.91E-01
Contribution to use of non renewable primary energy excluding non renewable primary energy used as raw material	MJ	7.21E+02	1.03E+01	4.36E-01	2.07E-01	7.01E+02	8.53E+00	-3.81E+00
Contribution to use of non renewable primary energy resources used as raw material	MJ	8.92E-01	8.92E-01	0*	0*	0*	0*	0.00E+00
Contribution to total use of non-renewable primary energy resources	MJ	7.22E+02	1.12E+01	4.36E-01	2.07E-01	7.01E+02	8.53E+00	-3.81E+00
Contribution to use of secondary material	kg	0.00E+00	0*	0*	0*	0*	0*	0.00E+00
Contribution to use of renewable secondary fuels	MJ	0.00E+00	0*	0*	0*	0*	0*	0.00E+00
Contribution to use of non renewable secondary fuels	MJ	0.00E+00	0*	0*	0*	0*	0*	0.00E+00
Contribution to net use of freshwater	m³	4.09E-02	9.24E-03	4.24E-05	1.97E-04	2.76E-02	3.82E-03	-6.17E-03
Contribution to hazardous waste disposed	kg	1.39E+01	1.31E+01	0*	0*	6.47E-01	1.11E-01	-5.16E+00
Contribution to non hazardous waste disposed	kg	5.52E+00	5.65E-01	0*	6.46E-02	4.88E+00	1.37E-02	-3.69E-01
Contribution to radioactive waste disposed	kg	1.11E-03	1.77E-04	7.14E-06	8.67E-06	9.20E-04	1.07E-06	-5.59E-05
Contribution to components for reuse	kg	0.00E+00	0*	0*	0*	0*	0*	0.00E+00
Contribution to materials for recycling	kg	7.09E-02	0*	0*	1.09E-02	0*	6.00E-02	0.00E+00
Contribution to materials for energy recovery	kg	0.00E+00	0*	0*	0*	0*	0*	0.00E+00
Contribution to exported energy	MJ	0.00E+00	0*	0*	0*	0*	0*	0.00E+00
Contribution to biogenic carbon content of the product	kg de C	0.00E+00	0*	0*	0*	0*	0*	0.00E+00
Contribution to biogenic carbon content of the associated packaging	kg de C	0.00E+00	0*	0*	0*	0*	0*	0.00E+00

* represents less than 0.01% of the total life cycle of the reference flow

Life cycle assessment performed with EIME version v5.9.4, database version 2022-01 in compliance with ISO14044.

Detailed results, including all the optional indicators mentioned in PCR_{ed4}, and the split of the Use Phase (B1 to B7), are available in the LCA report and on demand in a digital format - Country Customer Care Center - <http://www.schneider-electric.com/contact>

Please note that the values given above are only valid within the context specified and cannot be used directly to draw up the environmental assessment of an installation.

Registration number :	ENVPEP2312024_V1	Drafting rules	PEP-PCR-ed4-2021 09 06
Date of issue	10/2023	Supplemented by Information and reference documents	PSR-0005-ed2-2016 03 29 www.pep-ecopassport.org
		Validity period	5 years
Independent verification of the declaration and data, in compliance with ISO 14021 : 2016			
Internal	X	External	
The PCR review was conducted by a panel of experts chaired by Julie ORGELET (DDemain)			
PEP are compliant with XP C08-100-1 :2016 or EN 50693:2019			
The elements of the present PEP cannot be compared with elements from another program.			
Document in compliance with ISO 14021 : 2016 « Environmental labels and declarations. Type II environmental declarations »			

Schneider Electric Industries SAS
Country Customer Care Center
<http://www.se.com/contact>
35, rue Joseph Monier
CS 30323
F- 92500 Rueil Malmaison Cedex
RCS Nanterre 954 503 439
Capital social 928 298 512 €

www.se.com

ENVPEP2312024_V1

Published by Schneider Electric

©2023 - Schneider Electric – All rights reserved

10/2023