


Product Environmental Profile

Canalis KTC 1000 to 6300A



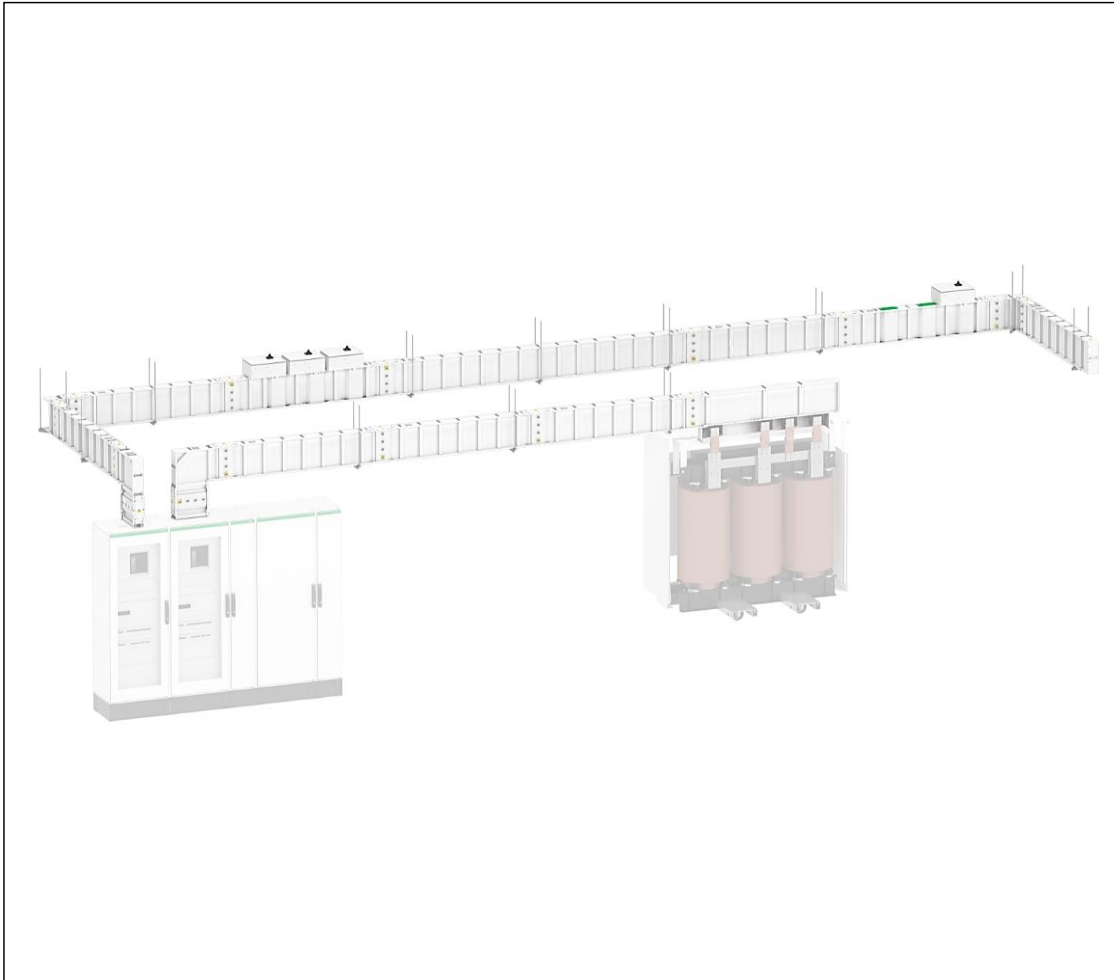


General information

Reference product	Canalis KTC 1000 to 6300A - Canalis KTC 3200A
Product Configuration	<p>Canalis KTC 3200A which consists of the following Configuration:</p> <ul style="list-style-type: none"> • 2 x 3200 A Power Feed Boxes (cat. no. KTC3200ER41) • 8 x 4 m Transport Components (cat. no. KTC3200ET440) • 8 x 4 m Distribution Components (cat. no. KTC3200EP4403) • 2 Components in each for changing Direction (cat. no. KTC3200LP4A1 - KTC3200LP4B2 - KTC3200LC4A - KTC3200LC4B) • 1 Component in each for changing Direction (cat. no. KTC3200TC4 - KTC3200ZP4 - KTC3200ZC41) • 5 Tap OFF Units in each (cat. no. KSB400DC4 - KSB160DC4 - KSB160SF4 - KSB400SE4)
Description of the product	<ul style="list-style-type: none"> • Canalis is part of a comprehensive offering of Schneider Electric products designed to operate together. This concept covers all low and medium voltage electrical distribution components. • The result is an optimised electrical installation with even higher performance through full electrical, mechanical and communication compatibility. • With the Canalis, we get complete type tested distribution solution that complies with IEC61439-1 & IEC 61439-6. • It is perfectly suited to traditional applications (factories, warehouses, etc.) and to the distribution of electrical power from transformer to all types of loads in offices, commercial premises, laboratories, etc.
Description of the range	Single product
Functional unit	<p>To transport and distribute electrical energy for high power applications for 20 years with following technical characteristics,</p> <ul style="list-style-type: none"> • IP degree of protection: IP55 conforming to IEC 60529 • IK degree of protection : IK08 conforming to IEC 62262 • Regulations: Compliant with IEC 61439-1 & IEC 61439-6
Specifications are:	<ul style="list-style-type: none"> • Tap-off units rated current: 25 to 1250A • Number of active conductors: 3L+PE, 3L+N+PE, 3L+N+PER (PER = reinforced PE) • Length of busbar trunking sections: 4m



Constituent materials

Reference product mass 6313379 g including the product, its packaging and additional elements and accessories

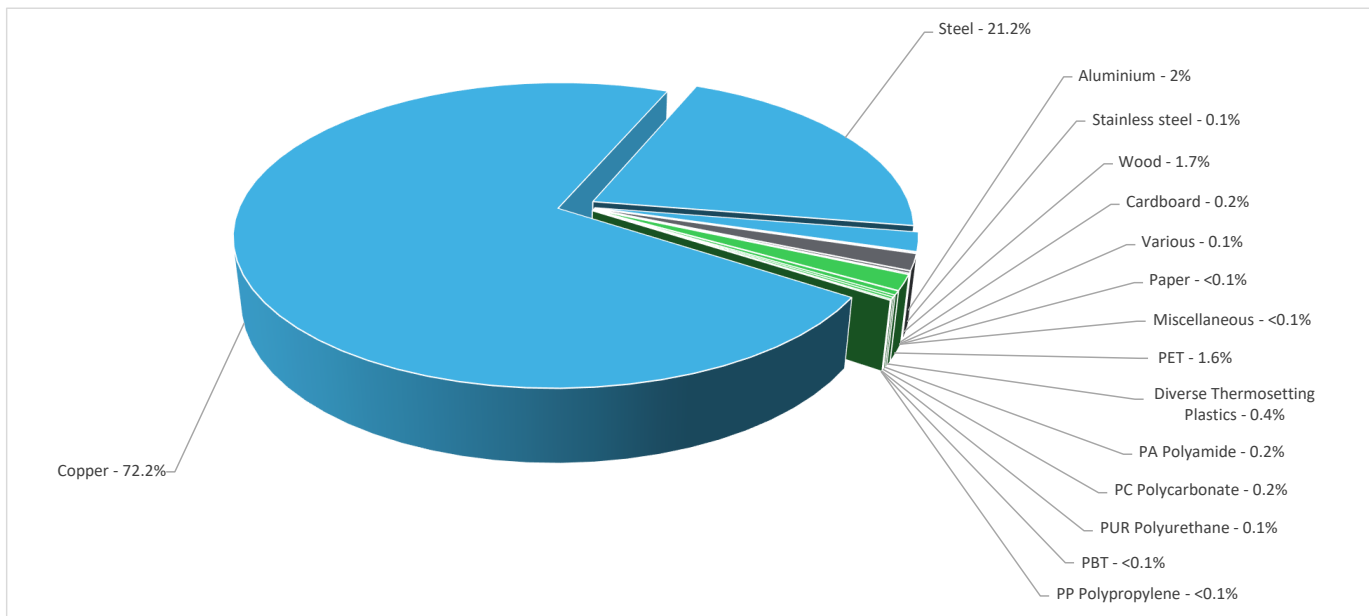

Plastics	2.5%
Metals	95.5%
Others	2.0%

Substance assessment

Details of ROHS and REACH substances information are available on the Schneider-Electric Green Premium website

<https://www.se.com/ww/en/work/support/green-premium/>

Additional environmental information

End Of Life	Recyclability potential:	97%	The recyclability rate was calculated from the recycling rates of each material making up the product with the exception of data using the ESR database. For materials or components using the ESR database or the absence of data the conservative hypothesis "0% recyclability" was used.
-------------	--------------------------	-----	---

Environmental impacts

Reference service life time	20 years			
Product category	Other equipments - Passive product - continuous operation			
Installation elements	The product does not require special installation operation.			
Use scenario	As Per PSR @ Load rate 30% and RLT 100%, The power dissipated by the Canalis KTC 1000 to 6300A is 19660 W for 20 years			
Time representativeness	The collected data are representative of the year 2023			
Technological representativeness	The Modules of Technologies such as material production, manufacturing processes and transport technology used in the PEP analysis (LCA EIME in the case) are Similar and representative of the actual type of technologies used to make the product.			
Geographical representativeness	Europe			
Energy model used	[A1 - A3]	[A5]	[B6]	[C1 - C4]
	Electricity Mix; Low voltage; 2018; Hungary, HU	Electricity Mix; Low voltage; 2018; Europe, EU-27	Electricity Mix; Low voltage; 2018; Europe, EU-27	Electricity Mix; Low voltage; 2018; Europe, EU-27

Detailed results of the optional indicators mentioned in PCRed4 are available in the LCA report and on demand in a digital format - Country Customer Care Center - <http://www.schneider-electric.com/contact>

Mandatory Indicators		Canalis KTC 1000 to 6300A - Canalis KTC 3200A						
Impact indicators	Unit	Total (without Module D)	[A1 - A3] - Manufacturing	[A4] - Distribution	[A5] - Installation	[B1 - B7] - Use	[C1 - C4] - End of life	[D] - Benefits and loads
Contribution to climate change	kg CO2 eq	1.69E+05	2.78E+04	1.23E+03	1.48E+02	1.27E+05	1.31E+04	-1.74E+04
Contribution to climate change-fossil	kg CO2 eq	1.67E+05	2.64E+04	1.23E+03	9.43E+01	1.27E+05	1.22E+04	-1.65E+04
Contribution to climate change-biogenic	kg CO2 eq	2.54E+03	1.38E+03	0*	5.33E+01	1.69E+02	9.32E+02	-9.36E+02
Contribution to climate change-land use and land use change	kg CO2 eq	3.47E-02	1.85E-02	0*	0*	0*	1.62E-02	0.00E+00
Contribution to ozone depletion	kg CFC-11 eq	5.21E-03	4.17E-03	1.88E-06	0*	5.43E-04	4.90E-04	-3.99E-03
Contribution to acidification	mol H+ eq	1.84E+03	9.84E+02	7.78E+00	0*	7.25E+02	1.25E+02	-7.94E+02
Contribution to eutrophication, freshwater	kg (PO4) ³⁻ eq	3.39E+01	4.40E+00	0*	0*	3.48E-01	2.91E+01	-2.82E-02
Contribution to eutrophication marine	kg N eq	1.31E+02	3.00E+01	3.65E+00	3.86E-02	8.24E+01	1.50E+01	-1.51E+01
Contribution to eutrophication, terrestrial	mol N eq	1.82E+03	3.44E+02	4.00E+01	3.36E-01	1.24E+03	1.98E+02	-1.77E+02
Contribution to photochemical ozone formation - human health	kg COVNM eq	4.79E+02	1.54E+02	1.01E+01	9.87E-02	2.64E+02	4.96E+01	-1.00E+02
Contribution to resource use, minerals and metals	kg Sb eq	8.71E+00	7.77E+00	0*	0*	9.20E-03	9.27E-01	-7.58E+00
Contribution to resource use, fossils	MJ	4.45E+06	8.02E+05	1.71E+04	0*	3.24E+06	3.92E+05	-3.06E+05
Contribution to water use	m3 eq	8.04E+04	5.01E+04	0*	8.79E+00	4.50E+03	2.58E+04	-3.79E+04

Inventory flows Indicators		Canalis KTC 1000 to 6300A - Canalis KTC 3200A						
Inventory flows	Unit	Total (without Module D)	[A1 - A3] - Manufacturing	[A4] - Distribution	[A5] - Installation	[B1 - B7] - Use	[C1 - C4] - End of life	[D] - Benefits and loads
Contribution to use of renewable primary energy excluding renewable primary energy used as raw material	MJ	6.80E+05	3.52E+04	0*	4.94E+02	6.22E+05	2.23E+04	-2.08E+04
Contribution to use of renewable primary energy resources used as raw material	MJ	2.41E+03	2.41E+03	0*	0*	0*	0*	-6.52E+02
Contribution to total use of renewable primary energy resources	MJ	6.82E+05	3.76E+04	0*	4.94E+02	6.22E+05	2.23E+04	-2.14E+04
Contribution to use of non renewable primary energy excluding non renewable primary energy used as raw material	MJ	4.44E+06	7.97E+05	1.71E+04	0*	3.24E+06	3.92E+05	-3.06E+05
Contribution to use of non renewable primary energy resources used as raw material	MJ	4.98E+03	4.98E+03	0*	0*	0*	0*	-2.49E+01
Contribution to total use of non-renewable primary energy resources	MJ	4.45E+06	8.02E+05	1.71E+04	0*	3.24E+06	3.92E+05	-3.06E+05
Contribution to use of secondary material	kg	1.07E+01	1.07E+01	0*	0*	0*	0*	0.00E+00
Contribution to use of renewable secondary fuels	MJ	0.00E+00	0*	0*	0*	0*	0*	0.00E+00
Contribution to use of non renewable secondary fuels	MJ	0.00E+00	0*	0*	0*	0*	0*	0.00E+00
Contribution to net use of freshwater	m³	1.87E+03	1.17E+03	0*	2.05E-01	1.05E+02	6.01E+02	-8.83E+02
Contribution to hazardous waste disposed	kg	6.76E+05	6.74E+05	0*	0*	2.37E+03	0*	-6.76E+05
Contribution to non hazardous waste disposed	kg	2.85E+04	9.77E+03	4.31E+01	8.71E+01	1.83E+04	2.92E+02	-7.90E+03
Contribution to radioactive waste disposed	kg	1.10E+01	7.14E+00	3.07E-02	3.56E-03	3.83E+00	5.23E-02	-5.04E+00
Contribution to components for reuse	kg	0.00E+00	0*	0*	0*	0*	0*	0.00E+00
Contribution to materials for recycling	kg	6.96E+03	8.89E+02	0*	3.33E+01	0*	6.04E+03	0.00E+00
Contribution to materials for energy recovery	kg	0.00E+00	0*	0*	0*	0*	0*	0.00E+00
Contribution to exported energy	MJ	1.13E+02	1.91E+01	0*	3.56E+01	0*	5.84E+01	0.00E+00

* represents less than 0.01% of the total life cycle of the reference flow

Contribution to biogenic carbon content of the product kg de C 0.00E+00

Contribution to biogenic carbon content of the associated packaging kg de C 4.59E+01

Mandatory Indicators		Canalis KTC 1000 to 6300A - Canalis KTC 3200A							
Impact indicators	Unit	[B1 - B7] - Use	[B1]	[B2]	[B3]	[B4]	[B5]	[B6]	[B7]
Contribution to climate change	kg CO2 eq	1.27E+05	0*	0*	0*	0*	0*	1.27E+05	0*
Contribution to climate change-fossil	kg CO2 eq	1.27E+05	0*	0*	0*	0*	0*	1.27E+05	0*
Contribution to climate change-biogenic	kg CO2 eq	1.69E+02	0*	0*	0*	0*	0*	1.69E+02	0*
Contribution to climate change-land use and land use change	kg CO2 eq	0*	0*	0*	0*	0*	0*	0*	0*
Contribution to ozone depletion	kg CFC-11 eq	5.43E-04	0*	0*	0*	0*	0*	5.43E-04	0*
Contribution to acidification	mol H+ eq	7.25E+02	0*	0*	0*	0*	0*	7.25E+02	0*
Contribution to eutrophication, freshwater	kg (PO4) ³⁻ eq	3.48E-01	0*	0*	0*	0*	0*	3.48E-01	0*
Contribution to eutrophication marine	kg N eq	8.24E+01	0*	0*	0*	0*	0*	8.24E+01	0*
Contribution to eutrophication, terrestrial	mol N eq	1.24E+03	0*	0*	0*	0*	0*	1.24E+03	0*
Contribution to photochemical ozone formation - human health	kg COVNM eq	2.64E+02	0*	0*	0*	0*	0*	2.64E+02	0*
Contribution to resource use, minerals and metals	kg Sb eq	9.20E-03	0*	0*	0*	0*	0*	9.20E-03	0*
Contribution to resource use, fossils	MJ	3.24E+06	0*	0*	0*	0*	0*	3.24E+06	0*
Contribution to water use	m3 eq	4.50E+03	0*	0*	0*	0*	0*	4.50E+03	0*

Inventory flows Indicators		Canalis KTC 1000 to 6300A - Canalis KTC 3200A							
Inventory flows	Unit	[B1 - B7] - Use	[B1]	[B2]	[B3]	[B4]	[B5]	[B6]	[B7]
Contribution to use of renewable primary energy excluding renewable primary energy used as raw material	MJ	6.22E+05	0*	0*	0*	0*	0*	6.22E+05	0*
Contribution to use of renewable primary energy resources used as raw material	MJ	0*	0*	0*	0*	0*	0*	0*	0*
Contribution to total use of renewable primary energy resources	MJ	6.22E+05	0*	0*	0*	0*	0*	6.22E+05	0*
Contribution to use of non renewable primary energy excluding non renewable primary energy used as raw material	MJ	3.24E+06	0*	0*	0*	0*	0*	3.24E+06	0*
Contribution to use of non renewable primary energy resources used as raw material	MJ	0*	0*	0*	0*	0*	0*	0*	0*
Contribution to total use of non-renewable primary energy resources	MJ	3.24E+06	0*	0*	0*	0*	0*	3.24E+06	0*
Contribution to use of secondary material	kg	0*	0*	0*	0*	0*	0*	0*	0*
Contribution to use of renewable secondary fuels	MJ	0*	0*	0*	0*	0*	0*	0*	0*
Contribution to use of non renewable secondary fuels	MJ	0*	0*	0*	0*	0*	0*	0*	0*
Contribution to net use of freshwater	m³	1.05E+02	0*	0*	0*	0*	0*	1.05E+02	0*
Contribution to hazardous waste disposed	kg	2.37E+03	0*	0*	0*	0*	0*	2.37E+03	0*
Contribution to non hazardous waste disposed	kg	1.83E+04	0*	0*	0*	0*	0*	1.83E+04	0*
Contribution to radioactive waste disposed	kg	3.83E+00	0*	0*	0*	0*	0*	3.83E+00	0*
Contribution to components for reuse	kg	0*	0*	0*	0*	0*	0*	0*	0*
Contribution to materials for recycling	kg	0*	0*	0*	0*	0*	0*	0*	0*
Contribution to materials for energy recovery	kg	0*	0*	0*	0*	0*	0*	0*	0*
Contribution to exported energy	MJ	0*	0*	0*	0*	0*	0*	0*	0*

* represents less than 0.01% of the total life cycle of the reference flow

Life cycle assessment performed with EIME version v6.2, database version 2024-04 in compliance with ISO14044, EF 3.0 method is applied, for biogenic carbon storage, assessment methodology 0/0 is used

Please note that the values given above are only valid within the context specified and cannot be used directly to draw up the environmental assessment of an installation.

Registration number :	SCHN-01177-V01.01-EN	Drafting rules	PCR-4-ed4-EN-2021 09 06
		Supplemented by	PSR-0005-ed3.1-EN-2023 12 08
Verifier accreditation N°	VH08	Information and reference documents	www.pep-ecopassport.org
Date of issue	05/2024	Validity period	5 years
Independent verification of the declaration and data, in compliance with ISO 14025 : 2006			
Internal External X			
The PCR review was conducted by a panel of experts chaired by Julie Orgelet (DDemain)			
PEPs are compliant with XP C08-100-1:2016 and EN 50693:2019 or NF E38-500 :2022			
The components of the present PEP may not be compared with components from any other program.			
Document complies with ISO 14025:2006 "Environmental labels and declarations. Type III environmental declarations"			



Schneider Electric Industries SAS
Country Customer Care Center
<http://www.se.com/contact>
35, rue Joseph Monier
CS 30323
F- 92500 Rueil Malmaison Cedex
RCS Nanterre 954 503 439
Capital social 928 298 512 €

www.se.com

SCHN-01177-V01.01-EN

Published by Schneider Electric

©2024 - Schneider Electric – All rights reserved

05/2024