



# Process Expert

## Supervision Participant Services

### User Guide

Original instructions

EIO0000001525.15  
08/2023



# Legal Information

The information provided in this document contains general descriptions, technical characteristics and/or recommendations related to products/solutions.

This document is not intended as a substitute for a detailed study or operational and site-specific development or schematic plan. It is not to be used for determining suitability or reliability of the products/solutions for specific user applications. It is the duty of any such user to perform or have any professional expert of its choice (integrator, specifier or the like) perform the appropriate and comprehensive risk analysis, evaluation and testing of the products/solutions with respect to the relevant specific application or use thereof.

The Schneider Electric brand and any trademarks of Schneider Electric SE and its subsidiaries referred to in this document are the property of Schneider Electric SE or its subsidiaries. All other brands may be trademarks of their respective owner.

This document and its content are protected under applicable copyright laws and provided for informative use only. No part of this document may be reproduced or transmitted in any form or by any means (electronic, mechanical, photocopying, recording, or otherwise), for any purpose, without the prior written permission of Schneider Electric.

Schneider Electric does not grant any right or license for commercial use of the document or its content, except for a non-exclusive and personal license to consult it on an "as is" basis.

Schneider Electric reserves the right to make changes or updates with respect to or in the content of this document or the format thereof, at any time without notice.

**To the extent permitted by applicable law, no responsibility or liability is assumed by Schneider Electric and its subsidiaries for any errors or omissions in the informational content of this document, as well as any non-intended use or misuse of the content thereof.**

As part of a group of responsible, inclusive companies, we are updating our communications that contain non-inclusive terminology. Until we complete this process, however, our content may still contain standardized industry terms that may be deemed inappropriate by our customers.

© 2023 – Schneider Electric. All rights reserved.

# Table of Contents

Safety Information.....	4
About the Book.....	5
Participant Language Settings.....	8
AVEVA Plant SCADA Language Setting .....	8
Presentation.....	9
AVEVA Plant SCADA as Supervision Participant.....	9
Using AVEVA Plant SCADA Separately .....	10
Performance Considerations .....	11
Supervision Participant Services in the System Engineering Life	
Cycle .....	12
General Information .....	12
Working Inside Plant SCADA .....	12
Data Conversion .....	12
Refinement Stage.....	13
Refining the Supervision Project .....	13
Editing Supervision Pages .....	16
Editing Advanced Project Settings.....	20
Deploying Supervision Projects.....	21
Preparing for Deployment .....	21
Restoring Supervision Projects.....	25
Executing Supervision Projects .....	26
Executing the Deployed Supervision Project.....	26
Troubleshooting .....	29
Unable to Use Supervision Participant Services .....	29
Unable to Open Supervision Project <b>Advanced Settings</b> .....	29
Glossary .....	30
Index .....	39

# Safety Information

## Important Information




Read these instructions carefully, and look at the equipment to become familiar with the device before trying to install, operate, service, or maintain it. The following special messages may appear throughout this documentation or on the equipment to warn of potential hazards or to call attention to information that clarifies or simplifies a procedure.



The addition of this symbol to a “Danger” or “Warning” safety label indicates that an electrical hazard exists which will result in personal injury if the instructions are not followed.



This is the safety alert symbol. It is used to alert you to potential personal injury hazards. Obey all safety messages that follow this symbol to avoid possible injury or death.

 <b>DANGER</b>
<b>DANGER</b> indicates a hazardous situation which, if not avoided, <b>will result in</b> death or serious injury.
 <b>WARNING</b>
<b>WARNING</b> indicates a hazardous situation which, if not avoided, <b>could result in</b> death or serious injury.
 <b>CAUTION</b>
<b>CAUTION</b> indicates a hazardous situation which, if not avoided, <b>could result in</b> minor or moderate injury.
<b>NOTICE</b>
<b>NOTICE</b> is used to address practices not related to physical injury.

## Please Note

Electrical equipment should be installed, operated, serviced, and maintained only by qualified personnel. No responsibility is assumed by Schneider Electric for any consequences arising out of the use of this material.

A qualified person is one who has skills and knowledge related to the construction and operation of electrical equipment and its installation, and has received safety training to recognize and avoid the hazards involved.

# About the Book

## Document Scope

This document describes how to use AVEVA Plant SCADA, the Supervision Participant, when open within EcoStruxure Process Expert for the engineering and maintenance of systems.

It is written for users who are familiar with EcoStruxure Process Expert and AVEVA Plant SCADA.

## Validity Note

This document has been updated for the release of EcoStruxure Process Expert 2023.

The characteristics that are described in the present document, as well as those described in the documents included in the Related Documents section below, can be found online. To access the information online, go to the Schneider Electric home page [www.se.com/ww/en/download/](http://www.se.com/ww/en/download/).

The characteristics that are described in the present document should be the same as those characteristics that appear online. In line with our policy of constant improvement, we may revise content over time to improve clarity and accuracy. If you see a difference between the document and online information, use the online information as your reference.

## Related Documents

Title of documentation	Reference number
EcoStruxure™ Process Expert, Security Deployment Guide	EIO0000004234 (ENG)
EcoStruxure™ Process Expert, Installation and Configuration Guide	EIO0000001255 (ENG)
EcoStruxure™ Process Expert, User Guide	EIO0000001114 (ENG)
EcoStruxure™ Process Expert, Runtime Navigation Services, User Guide	EIO0000001574 (ENG)
EcoStruxure™ Process Expert, Global Templates, Reference Manual	EIO0000001986 (ENG)
EcoStruxure™ Process Expert, General Purpose Library, Process Templates, Reference Manual	EIO0000004043 (ENG)

## mySchneider Support Portal

Visit <https://www.se.com/myschneider> for support, software updates, and latest information on EcoStruxure Process Expert.

## Product Related Information

### **⚠ WARNING**

#### **LOSS OF CONTROL**

- Perform a Failure Mode and Effects Analysis (FMEA), or equivalent risk analysis, of your application, and apply preventive and detective controls before implementation.
- Provide a fallback state for undesired control events or sequences.
- Provide separate or redundant control paths wherever required.
- Supply appropriate parameters, particularly for limits.
- Review the implications of transmission delays and take actions to mitigate them.
- Review the implications of communication link interruptions and take actions to mitigate them.
- Provide independent paths for control functions (for example, emergency stop, over-limit conditions, and error conditions) according to your risk assessment, and applicable codes and regulations.
- Apply local accident prevention and safety regulations and guidelines.<sup>1</sup>
- Test each implementation of a system for proper operation before placing it into service.

**Failure to follow these instructions can result in death, serious injury, or equipment damage.**

<sup>1</sup> For additional information, refer to NEMA ICS 1.1 (latest edition), *Safety Guidelines for the Application, Installation, and Maintenance of Solid State Control* and to NEMA ICS 7.1 (latest edition), *Safety Standards for Construction and Guide for Selection, Installation and Operation of Adjustable-Speed Drive Systems* or their equivalent governing your particular location.

### **⚠ WARNING**

#### **UNINTENDED EQUIPMENT OPERATION**

- Only use software approved by Schneider Electric for use with this equipment.
- Update your application program every time you change the physical hardware configuration.

**Failure to follow these instructions can result in death, serious injury, or equipment damage.**

The examples in this manual are given for information only.

### **⚠ WARNING**

#### **UNINTENDED EQUIPMENT OPERATION**

Adapt examples that are given in this manual to the specific functions and requirements of your industrial application before you implement them.

**Failure to follow these instructions can result in death, serious injury, or equipment damage.**

## Terminology Derived from Standards

The technical terms, terminology, symbols and the corresponding descriptions in this manual, or that appear in or on the products themselves, are generally derived from the terms or definitions of international standards.

In the area of functional safety systems, drives and general automation, this may include, but is not limited to, terms such as *safety*, *safety function*, *safe state*, *fault*, *fault reset*, *malfunction*, *failure*, *error*, *error message*, *dangerous*, etc.

Among others, these standards include:

Standard	Description
IEC 61131-2:2007	Programmable controllers, part 2: Equipment requirements and tests.
ISO 13849-1:2015	Safety of machinery: Safety related parts of control systems. General principles for design.
EN 61496-1:2013	Safety of machinery: Electro-sensitive protective equipment. Part 1: General requirements and tests.
ISO 12100:2010	Safety of machinery - General principles for design - Risk assessment and risk reduction
EN 60204-1:2006	Safety of machinery - Electrical equipment of machines - Part 1: General requirements
ISO 14119:2013	Safety of machinery - Interlocking devices associated with guards - Principles for design and selection
ISO 13850:2015	Safety of machinery - Emergency stop - Principles for design
IEC 62061:2015	Safety of machinery - Functional safety of safety-related electrical, electronic, and electronic programmable control systems
IEC 61508-1:2010	Functional safety of electrical/electronic/programmable electronic safety-related systems: General requirements.
IEC 61508-2:2010	Functional safety of electrical/electronic/programmable electronic safety-related systems: Requirements for electrical/electronic/programmable electronic safety-related systems.
IEC 61508-3:2010	Functional safety of electrical/electronic/programmable electronic safety-related systems: Software requirements.
IEC 61784-3:2016	Industrial communication networks - Profiles - Part 3: Functional safety fieldbuses - General rules and profile definitions.
2006/42/EC	Machinery Directive
2014/30/EU	Electromagnetic Compatibility Directive
2014/35/EU	Low Voltage Directive

In addition, terms used in the present document may tangentially be used as they are derived from other standards such as:

Standard	Description
IEC 60034 series	Rotating electrical machines
IEC 61800 series	Adjustable speed electrical power drive systems
IEC 61158 series	Digital data communications for measurement and control – Fieldbus for use in industrial control systems

Finally, the term zone of operation may be used in conjunction with the description of specific hazards, and is defined as it is for a hazard zone or danger zone in the Machinery Directive (2006/42/EC) and ISO 12100:2010.

**NOTE:** The aforementioned standards may or may not apply to the specific products cited in the present documentation. For more information concerning the individual standards applicable to the products described herein, see the characteristics tables for those product references.

# Participant Language Settings

## AVEVA Plant SCADA Language Setting

When Plant SCADA is used as Supervision Participant of EcoStruxure Process Expert, its language must be set to the same language as EcoStruxure Process Expert.

If this language is not supported, select English.

If another language is selected when Plant SCADA is opened from EcoStruxure Process Expert (herein, the software), it may prevent you from completing the system engineering life cycle.



# Presentation

## AVEVA Plant SCADA as Supervision Participant

### Interacting With Plant SCADA

AVEVA Plant SCADA can be opened from within EcoStruxure Process Expert and it acts as the Supervision Participant.

Generally, the software automatically manages interactions between the platform and Plant SCADA. However, in the refinement stage, the Plant SCADA user interface is displayed, allowing you to manually perform the necessary tasks to complete the system engineering life cycle.

In addition, during the deployment and execution stages, you work with Plant SCADA to complete the deployment started with the software and access runtime services.

**NOTE:** After you close a Supervision Participant window, it may take a few moments for the corresponding processes to end in the background. During this time, a busy icon is shown in the notification panel and/or **Supervision Project Browser** and you cannot use the Participant.

### Working With Several Clients

When one or more users work on components of the same system (for example, Participant projects, the application, project containers, topological entities), locking mechanisms may restrict certain concurrent actions (see *EcoStruxure Process Expert, User Guide*). In this case, refer to the **Notification Panel** (see *EcoStruxure Process Expert, User Guide*) for details.

### Opening the Plant SCADA Help

Plant SCADA help can be accessed by selecting **Help** from the menu bar.

In addition, when Plant SCADA is closed, you can access its helps by clicking the **?** icon (see *EcoStruxure Process Expert, User Guide*) in the EcoStruxure Process Expert client toolbar.

# Using AVEVA Plant SCADA Separately

## Overview

You can use AVEVA Plant SCADA that is installed by EcoStruxure Process Expert as a standalone application once you have released it.


While AVEVA Plant SCADA standalone is open, you cannot open Supervision Participant windows in EcoStruxure Process Expert.

**NOTE:** The Supervision Participant projects that are managed by EcoStruxure Process Expert are not visible when you open AVEVA Plant SCADA in standalone mode. You only see those that you have deployed to the computer.

**NOTE:** From the engineering client, you can also [launch the runtime, page 27](#) on the local computer with the Supervision project that is active.

## Opening AVEVA Plant SCADA Standalone

Only one instance of AVEVA Plant SCADA can run at a time on the computer. The following table describes the steps to open Plant SCADA as a standalone application on a computer on which an engineering client is installed.

Engineering client state	How to open AVEVA Plant SCADA standalone
Open	<p>Click the <b>Release Supervision Participant</b> button in the toolbar of the engineering client and wait for the action to complete.</p>  <p>Then, open AVEVA Plant SCADA by using the Windows Start menu.</p> <p><b>NOTE:</b> Supervision Participant windows must be closed (for example, Supervision project refinement or page editing windows).</p>
Closed	Use the AVEVA Plant SCADA entries in the Windows Start menu.

**NOTE:** On a computer on which only the system server is installed, you cannot release AVEVA Plant SCADA. You can open it as a standalone application only when the system server is not running.

## Changes to Include Projects Managed by EcoStruxure Process Expert

If you make changes to an **Include** project that is present in the content repository of EcoStruxure Process Expert by using AVEVA Plant SCADA in standalone mode, the changes are discarded when you perform an action on the Supervision project by using the engineering client.

# Performance Considerations

## Improving Data Acquisition Performance

To help improve performance, subscribe data that is accessed from Cicode by using the *TagSubscribe* and *SubscriptionGetValue* functions rather than acquiring data with direct reads.

Plant SCADA automatically subscribes tags needed by the Supervision project components, such as pages, alarm servers, and trend servers.

Refer to the Plant SCADA help for more information.

**NOTE:** If you do not use subscription-based data access, you can configure the *BLOCK* parameter to help improve data throughput between the I/O server and the I/O device. Refer to the Plant SCADA help for more information.

## OFS Server Configuration Parameters

In the OPC Factory Server (OFS) configuration file (see *EcoStruxure Process Expert, User Guide*) that the software creates, the *QuickSetActive* communication parameter is set to *TRUE* to help improve performance.

For information on setting values of other parameters, refer to *OFS Server Configuration* in the Plant SCADA help.

# Supervision Participant Services in the System Engineering Life Cycle

## Overview

This chapter contains information that helps you use Plant SCADA in general and more specifically when performing tasks during the refinement stage.

## General Information

## Working Inside Plant SCADA

### Menus and Commands

When working inside Plant SCADA acting as a software Participant, some menus and commands may be disabled or cannot be used.

### Floating Window Mode

The Plant SCADA windows open as floating, independent windows. You can embed (see *EcoStruxure Process Expert, User Guide*) them in the client by using the **Restore** button.

## Data Conversion

### Conversion of the Duration Data Type

The software converts the *D* (days) component of the Duration data type into hours and adds the value to the *hh* (hours) component so that the duration can be processed by Plant SCADA.

For example, EcoStruxure Process Expert converts *1.5:10:25.00* into *29:10:25.00*.

**NOTE:** For information on the Duration data type that the software uses, refer to *Software Capabilities, Supported Data Types* (see *EcoStruxure Process Expert, User Guide*).

# Refinement Stage

## Refining the Supervision Project

### Overview


The refinement of a Supervision project by using Plant SCADA Studio allows you to view project data created by the generation process and modify elements of the project. For example, you can add users and roles, page 14, which will be deployed to workstations as part of the Supervision project rather than creating them locally after deployment.

**NOTE:** Save changes in Plant SCADA Studio before closing the Participant window and saving changes. Otherwise, your changes are not retained.

For information on the refinement stage, refer to *Refining the Supervision Project* (see *EcoStruxure Process Expert, User Guide*).

### Plant SCADA User Interface

The following figure shows an example of the Plant SCADA Studio window which opens after selecting the **Refine** command for project *Supervision\_1*.

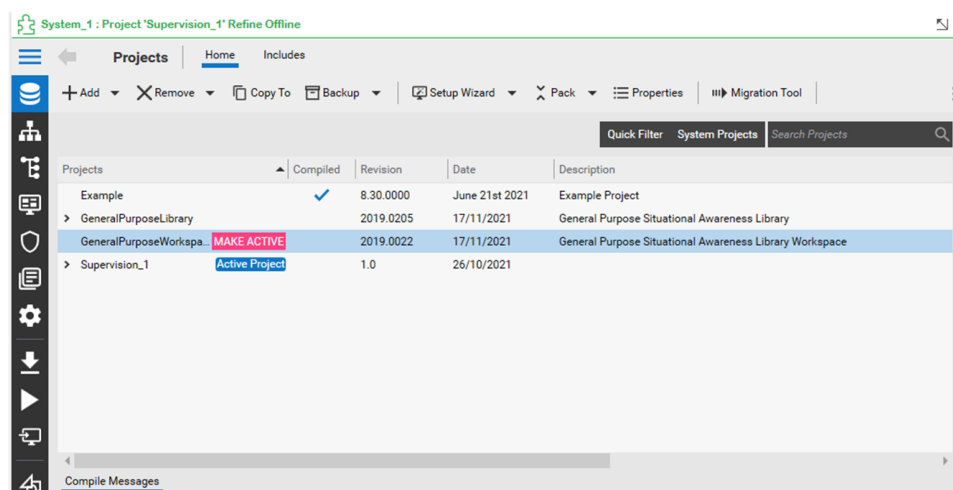

### Limitations

Refining a Supervision project makes the project inconsistent at the platform level. For example, a variable tag that you add cannot be seen in the tag container of the Supervision Participant project in the **Project Explorer**.

Modifications to project data that was generated by facets assigned to this Supervision project may be overwritten when you generate these facets again if their status is **Out Of Date**. For example, if you modify an advanced alarm tag that is generated by a Supervision facet assigned to the Supervision Participant project and later, the status of this facet changes to **Out Of Date**, when you generate the project in the **Project Explorer**, your modification is lost.

## NOTICE

### LOSS OF DATA

Do not modify project data that was generated by facets.

**Failure to follow these instructions can result in equipment damage.**

Modifying project data needs to be done in the **Project Explorer** of EcoStruxure Process Expert.

This applies to data that you modify in Plant SCADA Studio by using the following menus and submenus:

- **Projects > Includes**
- **Equipment**
- **Variables**
- **Trends**
- **Alarms >**
  - **Digital Alarms**
  - **Time Stamped Alarms**
  - **Advanced Alarms**
- **Vizualization >**
  - **Reports**
  - **Runtime Parameters**
- **Security >**
  - **Roles**
  - **Users**
- **Topology >**
  - **I/O Devices** (applies only to properties (see *EcoStruxure Process Expert, User Guide*) that are exposed in the **Project Explorer**)
  - **Boards**
  - **Ports**
  - **Clusters**
  - **Network Addresses**
  - **Alarm Servers**
  - **Trend Servers**
  - **Report Servers**
  - **I/O Servers**

Modifications in the UIMessag.dbf data base file may also be overwritten by a subsequent generation.

The software does not save the following:

- Changes to **Include** projects. Changes are discarded once you stop the system server. You must perform changes outside of the software by using Plant SCADA.
- New projects that you create.

## Access Control Management

By default, the software creates one user for the Supervision project with the following properties:

- **User Name:** *viewonly*
- **Role Name:** *EsxViewer*
- **Password:** not applicable (for this role, the password is an empty string)
- **Comment:** *password is not set*

The *EsxViewer* role is configured with the following properties:

- **Privileges:** 0
- **View Areas:** 1..250
- **Allow RPC:** *True*

- **Allow Exec:** *False*
- **Manage Users:** *False*

For more information, refer to chapter *Access Control* (see *EcoStruxure Process Expert, General Purpose Library, Process Templates, Reference Manual*).

## Integrating Changes to Include Projects

After modifying an **Include** project and adding/replacing the **Include** project in the content repository, you must integrate the changes made to the **Include** project to the Supervision project so that they are available from the runtime. Proceed as follows:

Step	Action
1	Right-click the Supervision project that uses the <b>Include</b> project and select <b>Refine</b> .
2	In the Plant SCADA Studio window, click <b>Visualization &gt; Pages &gt; Update Pages</b> and click <b>OK</b> .
3	Once the update is complete, save changes and close the Participant window.

**NOTE:** To perform small changes in an **Include** project (for example, a Genie), you can use the **Templatize Genie** command (see *EcoStruxure Process Expert, Global Templates Reference Manual*) in the **Facet Editor** instead.

## Exporting and Importing Tags

Before importing a comma-separated value (CSV) file that you have created by using the **Export All** command during Supervision project refinement, you must remove the tags that were created by the Supervision facets that are assigned to the tag container of this project. Otherwise, when you import the CSV file (**Import All** command), these software-generated tags will be created as duplicates and when you generate and build the Supervision project thereafter, an error is detected.

## Editing Supervision Pages

### Overview

When you edit a Supervision page, you can:

- add Genies to the page
- Add graphical objects to the page to represent the process.
- Copy-paste, page 18 graphical objects and Genies on the same or different pages that you open for editing one after the other.

**NOTE:** Limitations apply to Genies that you paste, page 17.

- Add, remove, and configure Wonderware InBatch ActiveX controls, page 18.

**NOTE:** You can edit several pages of a same Supervision project simultaneously. The pages open in the same Supervision Participant window.

You can also in runtime:


- Monitor the associated instance.
- Open the faceplate associated to the Genie, for example, to view maintenance information, acknowledge alarms, or control the process.
- View alarms by equipment hierarchy.
- Use runtime navigation services (see *EcoStruxure Process Expert, Runtime Navigation Services, User Guide*).

For information on how to access the Plant SCADA user interface, refer to *Editing Supervision Project Pages* (see *EcoStruxure Process Expert, User Guide*).

## Plant SCADA Graphics Builder

The following figure shows an example of the Plant SCADA Graphics Builder and the EcoStruxure Process Expert **Instances** browser pane, which open after selecting the **Edit** command for a Supervision page.

**NOTE:** Depending on the chosen page template, a different page may appear.

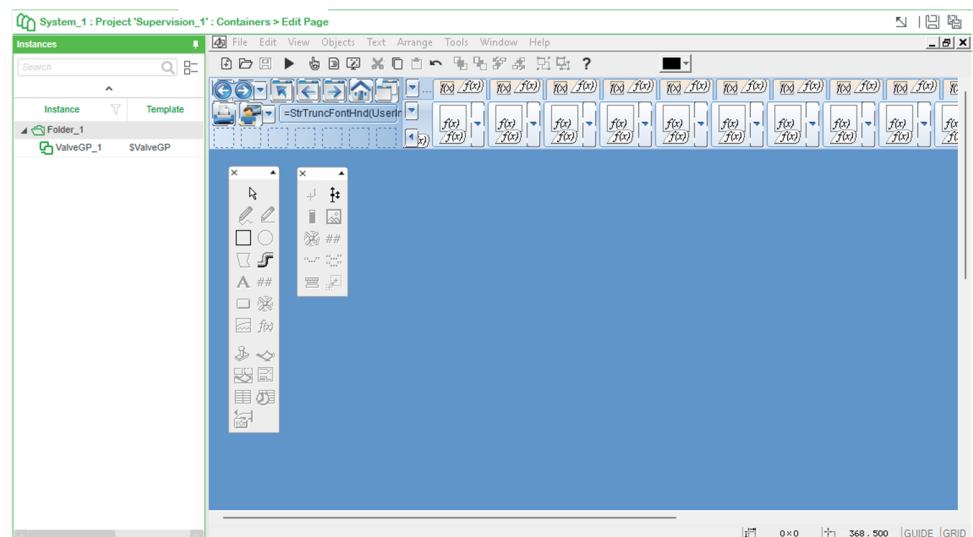



## Limitations

- After you add a Genie to a page, you can edit Genie parameters and metadata (properties). Doing so may have an impact when you interact with the Genie during operation and/or when you use runtime navigation services (see *EcoStruxure Process Expert, Runtime Navigation Services, User Guide*).

Before editing Genie data, refer to the EcoStruxure Process Expert help on libraries.

- Work only in pages that you open from the **Containers** pane.

## Viewing the Equipment Hierarchy

Settings that you need to configure to view the equipment hierarchy on a page vary depending on the library that you are using.

Refer to the EcoStruxure Process Expert help on libraries for details.

## Instances Browser Pane

The **Instances** browser pane lets you select the instances whose Genies you want to add to the page.

Instances are shown with the same folder structure as in the application of the system. Alternatively, you can switch to grid view, which shows instances in a list.

The Genies that are included with each application template are described in the EcoStruxure Process Expert help on libraries.



You can refine the display of instances by using the following filters.

Filter	Description
<b>Assigned</b> (check box)	When selected, displays only the instances that are assigned to the Supervision project. Otherwise, displays the instances that exist in the application and contain at least one Genie.  The check box is selected by default.
Search field	Enter an instance, a folder name or a partial name to limit the list of displayed instances and folders to those having an identifier that contains your entry.

## Adding Genies

To add a Genie to a page that you are editing, proceed as follows:

Step	Action
1	If several pages are open, make the page that you want to work on the active page. <b>NOTE:</b> When several pages are open and maximized, you can check the name of the page that is active and make another page active by using the <b>Window</b> menu.
2	From the <b>Instances</b> pane, drag the selected instance to the page. <b>Result:</b> A list opens, which shows the Genies that are available for this instance.
3	Select a Genie from the list. <b>Result:</b> The Genie is shown on the page. <b>NOTE:</b> Adding the first Genie to a page the first time may take a moment.
4	Reposition the Genie by dragging it, if required.

Step	Action
5	<p>Click either button in the toolbar of the Supervision Participant window:</p> <p> to save changes in the active window.</p> <p> to save changes in the open windows.</p> <p><b>NOTE:</b> If you made changes in several pages, clicking the <b>Save All</b> button completes the save operation faster.</p>
6	Close the Supervision Participant window.

**NOTE:** If you add the same Genie of one instance several times to the same page:

- the Genie appears on the page as many times as you added it.
- the Supervision facet encapsulating the Genie appears only once in the **Assignments** pane of the corresponding page of the Supervision project.

## Pasting Genies On a Page

To paste a Genie on the same or a different page, proceed as follows:

Step	Action
1	<p>Open the page, or pages if you want to paste the Genie in a different page from its source, by using the <b>Edit</b> context menu command in the <b>Containers</b> pane.</p> <p><b>Result:</b> The second page opens in the same Supervision Participant window.</p> <p><b>NOTE:</b> When several pages are open and maximized, you can check the name of the page that is active and make another page active by using the <b>Window</b> menu in the Supervision Participant window.</p>
2	<p>Right-click the Genie on the page and select <b>Copy</b>.</p> <p><b>NOTE:</b> Save the page before copying the Genie so that its metadata is up-to-date.</p>
3	<p>Right-click the page and select <b>Paste</b>.</p> <p><b>Result:</b> The Genie appears on the page.</p>
4	<p>If you wish to associate the pasted Genie to a different instance:</p> <ul style="list-style-type: none"> <li>• Right-click the pasted Genie and select <b>Properties...</b></li> <li>• In the <b>Metadata</b> tab, edit the <code>_PSX_InstID</code> property with the identifier of the instance that you want the Genie to be associated to</li> </ul> <p><b>NOTE:</b> If you do not want to associate the Genie to another instance, do not edit the property.</p>
5	<p>Save your changes by clicking the <b>Save</b> or <b>Save All</b> button in the Supervision Participant window and close the window.</p> <p><b>Result:</b> The facet encapsulating the Genie that you have pasted appears in the <b>Assignments</b> pane of the corresponding page in the <b>Project Explorer</b>.</p> <p><b>NOTE:</b> If you made changes to several pages, clicking the <b>Save All</b> button completes the save operation faster.</p>

**NOTE:** The limitations that apply to Genies that you add also apply to Genies that you paste, page 17.

**NOTE:** If you paste the Genie of the same instance several times on the same page without editing its metadata:

- The Genie appears on the page as many times as you paste it.
- The Supervision facet encapsulating the Genie appears only once in the **Assignments** pane of the corresponding page of the Supervision project.


## Using Wonderware InBatch ActiveX Controls

The InBatch ActiveX controls let you exchange data between the Supervision client and the InBatch server in runtime.

To access these controls while you are editing a Supervision page, click **Edit > Insert ActiveX Control...** in the menu bar of the Graphics Builder.

To use these controls in runtime, you must install them on the computer where you deploy the Supervision project. You can do this by installing the Wonderware InBatch Remote Runtime Client. Further, you need to configure the InBatch server separately. Refer to the help of Wonderware InBatch for more information.

The following figure shows a selection of InBatch ActiveX controls that are available when you edit a Supervision page.

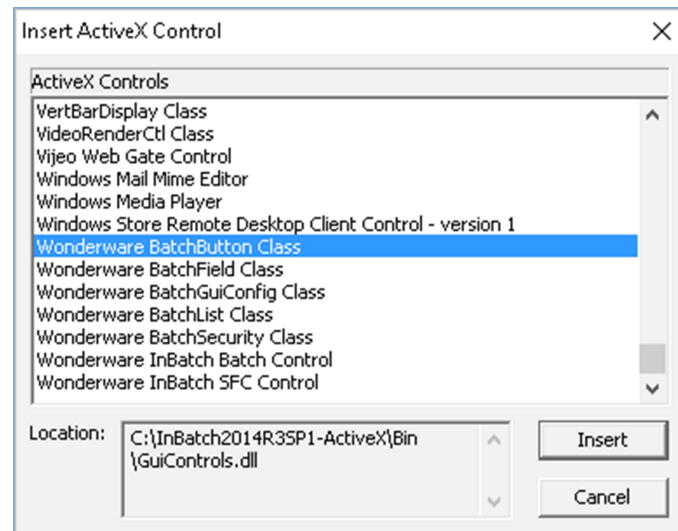

**NOTE:** InBatch ActiveX needs to be selected during installation of the engineering client (see *EcoStruxure Process Expert, Installation and Configuration Guide*).

**NOTE:** You must enter the server name (**Host**) manually in the properties of the control. For information on other configurations that are required for InBatch ActiveX controls, refer to their help. The help is accessible from the properties window of the controls.

## Editing Advanced Project Settings

### Overview

The command allows you to modify parameters of the *citect.ini* file, page 26 by using the **Computer Setup Editor** tool of Plant SCADA.


This is the file that is copied to the %SoCoDeploy%\Users\<Project identifier> folder when you deploy the Supervision Participant project. For details about the folder location, refer to the topic describing how to prepare for deployment, page 21.

This step is optional.

For information on how to access the Plant SCADA user interface, refer to *Editing Advanced Supervision Project Settings* (see *EcoStruxure Process Expert, User Guide*).

### Plant SCADA User Interface

The following figure shows an example of the **Computer Setup Editor** tool, which opens after selecting the **Advanced Settings** command for a Supervision project.

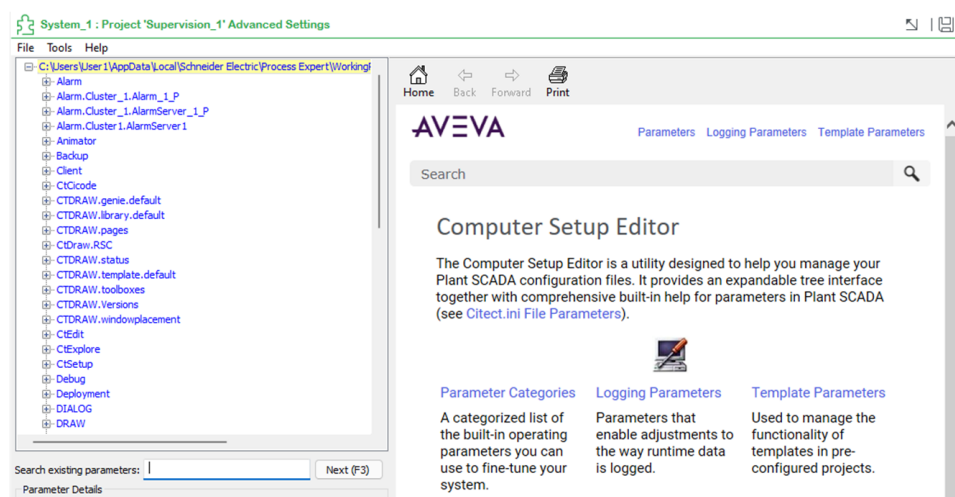

# Deploying Supervision Projects

## Overview

This chapter describes how to prepare the computer for deployment and restore the deployed Supervision Participant project.

## Preparing for Deployment

### Target Computer Setup

Before deploying, set up each target computer as follows:

- Install the necessary software (see *EcoStruxure Process Expert, Installation and Configuration Guide*) according to the configuration of the workstation that models the computer.

For example, if you created the **OFS** and Supervision services on the workstation that models the computer running the operation server and you are using the OPCUA driver, install on it OPC UA Server Expert and the Plant SCADA runtime servers.

- Create the following shared folders on computers modeled by workstations depending on their configuration in the topology:

Shared folder	Service present in the workstation
<i>SoCoDeploy</i>	<b>Supervision</b>
<i>SoCoOfsDeploy</i>	<b>OFS</b> (with OFSOPC driver)
<i>SoCoOpcUaDeploy</i>	<b>OFS</b> (with OPCUA driver)

## Enabling the Connection to the Shared Folders

The system server must connect to each target computer via the Ethernet network so that the software can copy the necessary files to the target computers.

To enable this connection, after creating the shared folders and allowing only local users to access them, you must connect to each target computer manually from the computer on which the system server is installed.

Enter the IP address of the target computer in the address bar of Windows **File Explorer** (for example, 192.168.0.90). Enter the appropriate credentials for the target computer when prompted. Verify that you can access the *SoCoDeploy* and *SoCoOfsDeploy* or *SoCoOpcUaDeploy* shared folders in read/write mode.

**NOTE:** When sharing a folder, restrict access by giving permissions only to the user who needs to access the folder. For example, the user who is logged into the system server computer.

## Creating the SoCoDeploy Shared Folder

By sharing the *AVEVA Plant SCADA X* folder (where *X* represents the version that is installed, for example, 2020 R2) with *SoCoDeploy* as shared name, you only need to restore Plant SCADA project files the first time you deploy them. When you deploy a project file again, it is extracted automatically to the folder of the same name inside the *User* subfolder, page 25.

To create the *SoCoDeploy* shared folder on a computer, proceed as follows:

Step	Action
1	Verify that AVEVA Plant SCADA software is installed on the computer. <b>NOTE:</b> On a computer on which only the system server is installed, you cannot release, page 10 AVEVA Plant SCADA. Therefore, you can open it as a standalone application only when the system server is not running.
2	Browse to the <i>AVEVA Plant SCADA X</i> folder. The folder is located at the path <i>C:\ProgramData</i> (for a default Windows 10 installation). <b>NOTE:</b> <i>ProgramData</i> is a hidden folder.
3	Right-click the folder and select <b>Properties</b> . <b>Result:</b> The <b>Properties</b> dialog box of the folder opens.
4	Click the <b>Sharing</b> tab.
5	Click <b>Advanced Sharing</b> .
6	In the <b>Advanced Sharing</b> dialog box, select <b>Share this folder</b> .
7	In the field <b>Share name</b> , enter <i>SoCoDeploy</i> .
8	Click <b>Permissions</b> . <b>Result:</b> The <b>Permissions for SoCoDeploy</b> dialog box opens.
9	Select the appropriate settings to grant read/write permission only to the user who needs to access it. This is the user who is logged into the system server computer. <b>NOTE:</b> The user who is granted permission needs to be in the same or a linked domain. <b>NOTE:</b> Additional steps are required and restrictions apply, page 24 when the system server startup mode is set to <i>Auto</i> .
10	Click <b>OK</b> .
11	Click <b>Apply</b> and <b>OK</b> in the <b>Properties</b> dialog box. <b>Result:</b> The <i>SoCoDeploy</i> folder is shared.

## Creating the *SoCoOfsDeploy* and *SoCoOpcUaDeploy* Shared Folders

To create the *SoCoOfsDeploy* or *SoCoOpcUaDeploy* shared folder on a computer on which OPC Factory Server or OPC UA Server Expert is installed respectively (that is to say, the computer acting as I/O server), proceed as follows:

Step	Action
1	<ul style="list-style-type: none"> <li>For the OFSOPC driver: <ul style="list-style-type: none"> <li>Browse to the 3.xx.0.0 folder, where xx depends on the version that is installed (for example, 3.60). The folder is located at the path <i>C:\ProgramData\Schneider Electric\OFS</i> (for a default Windows 10 installation).</li> </ul> </li> <li>For the OPCUA driver: <ul style="list-style-type: none"> <li>Browse to the 2.xx.0.0 folder, where xx depends on the version that is installed (for example, 2.00). The folder is located at the path <i>C:\ProgramData\Schneider Electric\EcoStruxure OPC UA Server Expert</i> (for a default Windows 10 installation).</li> </ul> </li> </ul> <p><b>NOTE:</b> <i>ProgramData</i> is a hidden folder.</p>
2	<p>Right-click the folder, and select <b>Properties</b>.</p> <p><b>Result:</b> The <b>Properties</b> dialog box of the folder opens.</p>
3	Click the <b>Sharing</b> tab.
4	Click <b>Advanced Sharing</b> .
5	In the <b>Advanced Sharing</b> dialog box, select <b>Share this folder</b> .
6	<p>In the field <b>Share name</b>, enter the following name:</p> <ul style="list-style-type: none"> <li>For the OFSOPC driver: <i>SoCoOfsDeploy</i></li> <li>For the OPCUA driver: <i>SoCoOpcUaDeploy</i></li> </ul>
7	<p>Click <b>Permissions</b>.</p> <p><b>Result:</b> The <b>Permissions for &lt;folder share name&gt;</b> dialog box opens.</p>
8	<p>Select the appropriate settings to grant read/write permission only to the user who needs to access it. This is the user who is logged into the system server computer.</p> <p><b>NOTE:</b> The user who is granted permission needs to be in the same or a linked domain.</p> <p><b>NOTE:</b> Additional steps are required and restrictions apply, page 24 when the system server startup mode is set to <i>Auto</i>.</p>
9	Click <b>OK</b> .
10	<p>Click <b>Apply</b> and <b>OK</b> in the <b>Properties</b> dialog box.</p> <p><b>Result:</b> The folder is shared.</p>

## Allowing Access to Shared Folders with System Server Auto-Start Enabled

When the system server startup mode (see *EcoStruxure Process Expert, Installation and Configuration Guide*) is set to *Auto*, the system server cannot access and deploy to the shared folders if you grant permission to a specific user (remote or local).

Instead, you need to grant **Full Control** permission to the system server computer. You can do so in the **Sharing** tab of the folder properties. Click **Advanced Sharing... > Permissions > Add... > Object Types...**, select **Computers**, and select the system server computer. Both computers must be on the same or linked domains.

You must configure the shared folders and the *User* subfolder of the *SoCoDeploy* folder as follows:

- In the **Security** tab of folder properties, click **Advanced** and add the system server computer with **Full Control** permission.
- In the **Sharing** tab, click **Share...** and verify that the system server computer is listed with **Full Control** permission.

**NOTE:** If you cannot select the system server computer to grant permissions, set the startup mode to manual.



# Restoring Supervision Projects

## Prerequisites

Deploy (see *EcoStruxure Process Expert, User Guide*) the built Supervision Participant project to the workstations of the system modeling the operation server and operator stations.

## Restoring the Supervision Project

To restore the Supervision Participant project on computers where it is deployed, proceed as follows:

Step	Action
1	From the Windows Start menu, click <b>AVEVA Plant SCADA &gt; Plant SCADA Studio</b> . <b>NOTE:</b> If an engineering client is installed the computer, you need to click the <b>Release Supervision Participant</b> button, page 10 before you can open Plant SCADA Studio.
2	Click the arrow next to <b>Backup</b> in the toolbar of Plant SCADA Studio and select <b>Restore</b> . <b>Result:</b> The <b>Restore Project</b> dialog box opens.
3	In the <b>Restore from</b> section, browse to the <b>Include</b> project file (.ctz) that you have deployed and click <b>Open</b> .  By default, the file is located in the <i>User</i> subfolder of the shared <i>AVEVA Plant SCADA X</i> folder, page 22.
4	In the <b>To</b> section, select <b>New project</b> .
5	Click <b>OK</b> and then confirm the creation of the Supervision project folder. <b>Result:</b> The selected file is restored.

For additional **Include** projects, repeat steps 2 to 5.

**NOTE:** For information on restoring the deployed Supervision Participant project, refer to the Plant SCADA help.

# Executing Supervision Projects

## Executing the Deployed Supervision Project

### Prerequisites

Deploy the Supervision project locally on each computer.

If this is a first deployment, also restore the project locally.

**NOTE:** If the EcoStruxure Process Expert system server or an engineering client is installed on the computer, you need to click the **Release Supervision Participant** button , page 10 before you can open Plant SCADA Studio.

### Supervision Participant Project Compilation

Supervision projects that are deployed to computers by EcoStruxure Process Expert are already compiled by using the Supervision Participant.

For information on the version of Plant SCADA that is installed with EcoStruxure Process Expert, refer to the topic that describes Supervision software requirements (see *EcoStruxure Process Expert, Installation and Configuration Guide*).

### Computer Setup Files

By default, when Plant SCADA starts, it reads values from the *citect.ini* file that is located in the *%SoCoDeploy%\Config*, page 22 folder on the local computer.

To use the *citect.ini* file that is generated and deployed by EcoStruxure Process Expert, you can select either method:

- Copy the deployed file from the *%SoCoDeploy%\Users\<Project identifier>* to the *%SoCoDeploy%\Config* folder.
- Modify the command line of Plant SCADA to use the file deployed to the *%SoCoDeploy%\Users\<Project identifier>* folder. For details, refer to *Using an Alternative INI file* in the Plant SCADA help.

### OPCUA Driver Security Configuration

When using the OPCUA driver, ensure that the security configuration of the driver is appropriate in order to establish a secure connection between the driver and the OPC UA server.

For details, refer to *Security Configuration, OPCUA Driver* in the Supervision Participant *Driver Reference Help*.

## Launching AVEVA Plant SCADA Runtime From the Engineering Client

The **Run Supervision Client** command of the engineering client lets you execute the deployed Supervision project on the local computer. For a first deployment, the prerequisites, page 26 must be fulfilled, the project compiled locally, and the **Computer Setup Wizard** completed by using AVEVA Plant SCADA standalone.

Command location	Description
Supervision project executable context menu (see <i>EcoStruxure Process Expert, User Guide</i> )	Launches the Plant SCADA runtime with the Supervision project that is set as active on the local computer after you confirm the command.
Workstation <b>Supervision</b> context submenu (see <i>EcoStruxure Process Expert, User Guide</i> )	
Engineering client toolbar (see <i>EcoStruxure Process Expert, User Guide</i> )	

## Executing a Deployed Supervision Project for the First Time

To execute the deployed Supervision project on an operator station, proceed as follows:

Step	Action
1	From the Windows Start menu, click <b>AVEVA Plant SCADA &gt; Computer Setup Wizard</b> .  <b>Result:</b> The <b>Computer Setup Wizard</b> window opens.
2	Complete the computer setup process. For information, refer to the Plant SCADA help.
3	From the Windows Start menu, click <b>AVEVA Plant SCADA &gt; Plant SCADA Runtime Manager</b> .  <b>Result:</b> The <b>Runtime Manager</b> window opens and the runtime environment starts.

For information on starting the Supervision project, refer to the Plant SCADA help.

## Executing a Supervision Project After a Subsequent Deployment

Depending on the type of changes that you deploy, you may need to reload project pages, or reload or restart servers.

Refer to the Plant SCADA help for information on the impact of changes to the Supervision project:

- Client-side changes.
- Server-side changes.

## Updating the OFSOPC and OPCUA Configuration Data After a Subsequent Deployment

When you make a modification to the Supervision Project that has an impact on the service or communication mapping (for example, changing the controller or the I/O device in the communication mapping), the configuration data contained in the corresponding OFSOPC or OPC UA configuration file (.xml) (see *EcoStruxure Process Expert, User Guide*) is updated when you build the project (see *EcoStruxure Process Expert, User Guide*).

When you deploy this modification, the updated OFSOPC/OPC UA configuration file is deployed to the workstation but the new configuration data is not

automatically loaded to the corresponding configuration tool. You must perform this step manually.

To load the updated configuration data to the OPC Factory Server or OPC UA Server Expert Configuration Tool, proceed as follows:

Step	Action
1	On the computer on which the updated configuration file has been deployed, open the corresponding configuration tool.
2	Click <b>File &gt; Open archive</b> . <b>Result:</b> The <b>Open</b> dialog box opens.
3	Browse to the shared folder, page 23 that corresponds to the protocol used.
4	Select the updated configuration file and click <b>Open</b> . <b>Result:</b> The aliases are shown in the user interface.
5	Click <b>File &gt; Save Configuration</b> .
6	Close the configuration tool.

# Troubleshooting

## Unable to Use Supervision Participant Services

If the system server closes or stops abnormally, Plant SCADA processes may not be stopped and you may not be able to use Supervision Participant services after you restart the system server.

In such case, end the corresponding processes (see *EcoStruxure Process Expert, Installation and Configuration Guide*) manually before restarting the system server.

## Unable to Open Supervision Project Advanced Settings

If either of the following messages is shown when you open **Advanced Settings** of a Supervision project, the *citect.ini* file needs to be upgraded in the Supervision project:

- Method not found message.
- Citect.ini file could not be found message.

To upgrade the *citect.ini* file in the Supervision project, proceed as follows:

Step	Action
1	Open the system server console and enable the console command prompt by pressing <b>Ctrl+M</b> and entering the password (see <i>EcoStruxure Process Expert, Installation and Configuration Guide</i> ). <b>NOTE:</b> Your user requires system server administrator rights.
2	At the command prompt, enter <code>Vjc UpgradeProjectCitectIni &lt;Supervision project identifier&gt;</code> . <b>Example:</b> <code>Vjc UpgradeProjectCitectIni Supervision_1</code>
3	Press <b>Enter</b> . <b>Result:</b> The <i>citect.ini</i> file of the Supervision project is updated and a message is displayed in the console when the operation is complete.
4	Disable the command prompt by pressing <b>Ctrl+M</b> .
5	In the engineering client, open the <b>Project Explorer</b> , right-click the Supervision project in the <b>Supervision Project Browser</b> , and select <b>Advanced Settings</b> . <b>Result:</b> <b>Computer Setup Editor</b> opens in the Supervision Participant window.
6	Click the <b>Save</b> button, save changes, and close the Participant window. <b>Result:</b> The <i>citect.ini</i> file is updated inside the Supervision project.

# Glossary

## A

### **application interface:**

Mechanism that allows sharing data and manage dependencies between 2 instances/references.

The *application interface* allows you to link:

- Application instances/references to each other
- Topological instances/references to each other

### **application link:**

Links describing connections between instances of the application that are made by using application interfaces.

### **application template:**

Global Template contained in the Global Templates library that models an object of the application of a system and its associated functions. The template encapsulates the necessary Participant capabilities.

*Application templates* are instantiated and can be configured to create the application of a system.

### **application:**

Models the process to be controlled and monitored. It consists of instances of application templates and a application folder structure. A system can contain several applications.

### **area:**

The *area*, when referring to access control, defines a topological, functional, or another user-based rule to restrict access in the scope of an automation system.

## B

### **binding:**

The *binding* is the key mechanism that establishes relations between the following items of the facet and composite templates:

- Parameters
- Interfaces
- Elements

### **built Participant project:**

The *built Participant project* is a generated, optionally refined, and built project, which is created by the corresponding Participant and that exists at the platform level in the form of an executable.

For example, files with *.stu* and *.ctz* extensions that are represented by Control and Supervision executables respectively are built Participant projects.

## C

### **cardinality:**

The *cardinality*, in the context of the interface model, is the number of connections that are supported by the objects playing the other role of the interface model.

**communication channel:**

A *communication channel* is the logical representation, at the platform level, of communication between controllers or between a controller and devices.

For example, a controller I/O scanner row is modeled by a *communication channel* for Modbus TCP communication in the executable of the Control project.

**communication interface:**

Mechanism that allows sharing data and manage dependencies between 2 instances or references.

*Communication interfaces* allow the platform to link topological instances/ references at the logical level (for example, I/O scanner, OPC Factory Server, Supervision I/O devices).

**communication link:**

Links describing logical connections between topological instances that are made by using communication interfaces.

For example, the communication link between 2 controllers exchanging data.

**communication mapping:**

The *communication mapping* process defines the communication aspects of a logical Participant project after being mapped to the topology.

**composite template:**

The *composite template* combines the capabilities of 1 or more facet templates, each encapsulating functionalities provided by one software Participant, and/or of other *composite templates*.

**composite:**

The *composite* is an instance of a composite template.

**constituent encapsulation:**

Process that is performed by using the **Facet Editor** and that allows you to:

- Select constituents that are created with a software Participant.
- Optionally, modify constituents inside the corresponding Participant.
- Include the selected constituents inside a facet template.

**constituent:**

Set of data provided by a software Participant, which can be global or local.

**contents repository:**

The *contents repository* is a global storage provided by the platform to manage global constituents and other files, such as Participant projects, used by the libraries and the systems.

## D

**deferring mechanism:**

Mechanism that allows you to make available in the composite template that is at the highest level optional element selections, parameters, and/or interfaces of its references.

**deployed Participant project:**

A *deployed Participant project* is a built project that has been transferred to a controller or other entity of the topology acting as an engine, and that you can execute.

**DFB type:**

The *derived function block type* is a programming language element that consists of:

- A data structure definition partitioned into input, output, public, and internal variables.
- A set of operations written in IEC 61131 programming languages to be performed upon the elements of the data structure when an instance of the function block type is started.

**E****EcoStruxure Process Expert:**

Third generation name of the software platform. Formerly, StruxureWare Process Expert then, EcoStruxure Hybrid DCS.

**element:**

*Element* is the term that is used to describe the contents of templates at the next lowest level as well as the contents of interface models:

- For facet templates, elements are the constituents that the facet encapsulates.
- For composite templates, elements are:
  - Facet references
  - Composite references
- For interface models, elements are the data that is shared. See *interface elements*.

You can define properties and rules for elements during the Global Templates definition stage.

**engine:**

An *engine* is the projection of the hardware and software defined in the topology that is able to execute the deployed Participant project.

**engineering client:**

EcoStruxure Process Expert client connecting to the system server that you use to engineer and maintain systems. It can run on the system server and/or an engineering station.

Engineering clients use software Participants.

**engineering station:**

The *engineering station* is a computer running an EcoStruxure Process Expert engineering client to design, and maintain systems that exist on the server to which the engineering client connects.

**executable:**

The *executable* is a project component that represents the built Participant project. It contains the mapping information and can be deployed a topological entity.

**execution domain:**

Property of the executable of a Participant project, which serves as a filter for selecting the scope of applicable services.

For example, it is used to define the boundaries for runtime navigation services or to restrict the exchange of data through peer to peer communication between projects that have executables with the same execution domain.



## F

### faceplate:

The *faceplate* is a component of a Supervision genie that provides a user interface to interact with the object that it represents.

### facet element:

The *facet element* is the contents that can be accessed at the system level. Depending on the type of facet template, such elements can be either:

- The visible part of the constituents stored in the facet templates.
- A set of data defined by the facet template.

### facet template:

The *facet template* is the smallest available template that encapsulates a specific capability provided by 1 software Participant only.

### facet:

The *facet* is an instance of a facet template.

## G

### genie:

Animated graphic that is assigned to Supervision pages and that represents functionalities of instances of the application during operation.

*Genies* are encapsulated in Supervision facets.

### global constituent:

Set of data provided by a software Participant that is a common resource referenced by several Global Templates. Global constituents are stored in the contents repository.

### Global Templates:

*Global Templates* encapsulate one or more functions that can be customized and reused in any system created with EcoStruxure Process Expert. They are stored in the Global Templates library.

## H

### hardware mapping:

The *hardware mapping* process links the logical projection of the hardware that is defined in the application and assigned to projects to the hardware defined in the topology of the system.

For example, linking Control variables representing I/O signals to I/O channels of an I/O module.

### HMI:

Abbreviation for *human machine interface*. It is a graphical operator interface for industrial equipment.

## I

### IEC:

The *International Electrotechnical Commission* is a non-profit and non-governmental international standard organization that prepares and publishes international standards for electrical, electronic, and related technologies.

**instance element selection:**

The *instance element selection* is a mechanism of the instantiation stage that allows you to customize an instance by selecting services that are provided by the template that the instance uses.

**instance parameter:**

*Instance parameters* are properties of the elements of an instance that you may be able to customize.

**instance:**

Abbreviation for object instance. It is the result of the instantiation of a template.

**instantiation naming convention:**

The *instantiation naming convention* defines the naming strategy that the platform applies when you create instances.

**interface element:**

Represents the data that will be shared through an interface. Interface elements are defined during in the interface definition. Interface elements can be transformed by the interface by using expressions.

**interface link:**

Links describing logical connections between instances that are made by using interfaces.

The following types of links exist:

- Physical links
- Communication links
- Application links

Each type of link is made by using the corresponding interface (physical, communication, or application interface).

**interface model:**

The *interface Model* is a type of template that is available in the Global Templates library and that you can configure.

**interface:**

The *interface* is a reference, inside a composite or facet template, of an interface model. Interfaces are exposed by the facets of an instance, allowing you to make different types of links with other instances to share data.

In the context of the template definition, interfaces are a mechanism to define the links between references by declaring compatibility and/or requirement rules.

**I/O:**

Abbreviation for *Inputs/Outputs*.

**L****local constituent:**

Set of data that is provided by a software Participant, encapsulated inside a facet template but not used at the system level. The local constituent is used to generate the contents of the logical Participant project. An example is Control Participant code that is encapsulated in a Control facet template.

**logical Participant project:**

The *logical Participant project* is a generated and refined project, which is created by the Participant but, which is not associated to the topology.

**NOTE:** The refinement of the project is optional.

## M

### mapping interface:

Mechanism that allows sharing data between two facets.

*Mapping interfaces* allow you to perform the hardware mapping. It is the process whereby you link facets assigned to projects to facets representing the hardware defined in the topology through matching mapping interfaces that these facets expose.

### MES:

The *Manufacturing Execution Systems* is a control system for managing and monitoring work-in-process in a factory plant.

## N

### network variable:

The *network variable* is a peer to peer communication mechanism allowing you to share data between 2 or more Control projects.

## O

### object template:

An *object template* is a generic term that covers several reusable templates such as facet or composite templates.

### OFS:

Abbreviation for OPC Factory Server.

### operation client:

An EcoStruxure Process Expert client connecting to the system server that you can use during runtime to monitor and troubleshoot a system.

### operator station:

The *operator station* is a computer running a Supervision client software.

## P

### Participant services:

*Participant services* are the functions provided by a software Participant when interacting with EcoStruxure Process Expert.

### Participant:

An external tool that is embedded in EcoStruxure Process Expert and installed on the system server and client computers. It allows refining projects and/or configuring topological entities. For example, the Control Participant.

### peer to peer communication:

*Peer to peer communication* is a data exchange mechanism between 2 or more Control projects, which uses the I/O scanner function of the controller acting as client.

### physical (interface) link:

Links describing logical connections between topological instances that are made by using physical interfaces.

For example, the connection of a controller to an Ethernet network.

### physical connection:

Link between topological entities representing the physical connections between controllers, station nodes, devices, and communication networks.

**physical interface:**

*Physical interfaces* allow the platform to link, at a physical level, topological instances to model the topology of the system.

**platform:**

Abbreviation for system platform. Represents the services that are provided by EcoStruxure Process Expert apart from the software Participants.

**privilege:**

Defines groups of functions that are provided by an application and granted to users through access control.

**project container:**

The *project container* is an organizational structure of a project to organize the facets that are assigned to it. Such a structure models the ones managed by the corresponding software Participant, and that are visible at the system level.

**project facet:**

Facet that is assigned to a project.

**project:**

Component of a system associated to a Participant. It contains elements that are managed at the platform level and executables that you can deploy to topological entities.

## R

**redundant controller:**

Generic term that is used to refer a Quantum Hot Standby controller and/or an M580 redundant controller.

**reference:**

Defines facet and composite templates, which are contained inside other facet or composite templates in order to distinguish templates, which are used in the composition of other templates from the highest level templates, such as control modules.

**role:**

The *role* can have 2 different meanings,

- For access control:

The *role* groups functionalities to grant different levels of user rights, which combine areas and privileges to fulfill a set of services.

- For interface models:

The *role* defines the 2 sides of an interface, role A and role B.

**runtime navigation services:**

Describes the complete set of functionalities that are provided by EcoStruxure Process Expert operation client in runtime, such as process monitoring, viewing of instance information, diagnostics.

## S

### service mapping:

The *service mapping* links the execution capabilities of a project represented by the executable to an engine of the topology.

For example, it can link:

- The I/O server of a Supervision project to a workstation modeling the operation server.
- The executable of a Control project to a controller.

### service:

In the context of projects, the *project service* is an organizational structure of a project to organize the execution capabilities. It models the structures that are managed by the corresponding software Participant, and that are visible and configured at the system level.

In the context of templates, a *service* represents a functionality provided by a Participant under the form of a facet referenced by the template.

### software:

Refers to EcoStruxure Process Expert.

### station node:

A *station node (workstation)* models a computer that can act as an engine to execute a Control project by using the Controller Simulator or a Supervision project by using Supervision software.

### subnet mask:

A 32-bit value that indicates the number of available host addresses on a subnet, which uses TCP/IP knowing that the first and last addresses are reserved (for example, subnet mask 255.255.192.0 allows 317 addresses for classless devices). It also indicates whether addressing is classful or classless. For classful addressing, it indicates the class of the network (for example, 255.255.255.0 is the subnet mask for class C networks).

### Supervision client:

Client connecting to the Supervision server that provides runtime services to operate and monitor automation systems. The client runs on an operator station and/or operation server.

### Supervision server:

Server running on the operation server or on the system server, and that provides runtime data to Supervision clients.

### system engineering life cycle:

Represents the stages that must be completed to create and commission a system with EcoStruxure Process Expert.

### system server:

EcoStruxure Process Expert server that hosts:

- Software Participants
- The database containing template libraries and system data

The system server manages requests from the EcoStruxure Process Expert clients.

### system:

Models a physical automation system. It consists of the following components:

- Applications
- Control and Supervision projects
- The topology

## T

### **topological entity:**

A *topological entity* is the representation of piece of hardware infrastructure.

For example, a controller.

### **topology:**

Models the hardware, software, and communication network infrastructure of a system by using topological folders and entities.

# Index

## A

access control settings	
default project settings (supervision).....	14
ActiveX controls	
using InBatch ActiveX controls when editing	
supervision pages .....	18
animated graphics	
integrating changes to Include projects .....	15
auto-start	
allowing access to shared folders with server auto-	
start enabled .....	24
AVEVA Plant SCADA	
opening Plant SCADA standalone .....	10

## C

Citect SCADA	
execution stage .....	26
citect.ini	
troubleshooting .....	29
upgrading configuration files .....	29
citect.ini files	
using different computer setup files .....	26
computer setup files	
using different citect.ini files .....	26
configuration data (supervision)	
updating after a subsequent deployment.....	27
connecting	
connecting to shared folders for supervision	
deployment.....	21

## D

data types	
conversion of duration for supervision.....	12
deploying	
allowing access to shared folders with server auto-	
start enabled .....	24
connecting to shared folders for supervision	
deployment.....	21
deployment stage	
preparing the supervision project deployment.....	21
working with Plant SCADA.....	21
duration	
conversion of duration data type (supervision).....	12

## E

editing supervision pages.....	16
equipment hierarchy	
configuring pages .....	17
executing	
supervision projects .....	26
execution stage	
working inside Citect SCADA .....	26
exporting	
exporting tags in project refinement .....	15

## G

genies	
integrating changes to Include projects .....	15
Genies	

Instances browser pane .....	17
limitations when editing supervision pages.....	17
pasting to pages .....	18
graphics	
integrating changes to Include projects .....	15
Graphics Builder	
Instances browser pane .....	17
limitations when editing supervision pages.....	17

## I

importing	
importing tags in project refinement .....	15
InBatch	
using InBatch ActiveX controls when editing	
supervision pages .....	18
Include projects	
integrating changes .....	15
Instances browser pane	
refining supervision projects.....	17

## L

language settings	
Plant SCADA language .....	8

## O

OFS	
configuration file performance settings.....	11
OFS configuration files	
updating after a subsequent deployment.....	27
OPCUA configuration files	
updating after a subsequent deployment.....	27
OPCUA driver	
OPCUA driver security configuration .....	26
opening AVEVA Plant SCADA standalone .....	10

## P

pages	
configuring to view equipment hierarchy .....	17
Instances browser pane .....	17
Participants	
limitations refining Plant SCADA projects .....	13
limitations when editing supervision pages.....	17
performance considerations (Supervision) .....	11
working inside the supervision Participant .....	12
pasting	
Genies to pages.....	18
performance	
Plant SCADA performance considerations .....	11
Plant SCADA	
conversion of duration data type.....	12
default access control settings .....	14
deployment stage .....	21
editing advanced project settings .....	20
executing supervision projects .....	26
Instances browser pane .....	17
language settings.....	8
limitations refining Plant SCADA projects.....	13
limitations when editing supervision pages.....	17
opening Plant SCADA standalone .....	10
refinement stage .....	13
refining supervision projects.....	13
restoring supervision projects.....	25
supervision Participant presentation .....	9

viewing the equipment hierarchy .....	17
working inside the supervision Participant .....	12
Plant SCADA help .....	9

## Q

QuickSetActive	
OFS configuration file settings .....	11

## R

refinement stage	
working inside Plant SCADA .....	13
refining	
limitations refining Plant SCADA projects .....	13
releasing the supervision Participant .....	10
reloading supervision pages	
executing projects after deploying changes .....	27
restarting supervision servers	
executing projects after deploying changes .....	27
restoring	
supervision projects .....	25
roles	
default role for Plant SCADA project .....	14
runtime	
launching Plant SCADA runtime from engineering	
client .....	27

## S

security configuration	
OPCUA driver security configuration .....	26
shared folders	
allowing access to shared folders with server auto-	
start enabled .....	24
creating for deployment ( <i>SoCoDeploy</i> ) .....	22
creating for deployment ( <i>SoCoOfsDeploy</i> ) .....	23
creating for deployment ( <i>SoCoOpcUaDeploy</i> ) .....	23
enabling the connection for supervision	
deployment .....	21
supervision Participant	
presentation .....	9
troubleshooting .....	29
supervision projects	
executing .....	26
restoring .....	25

## T

troubleshooting	
citect.ini .....	29
supervision Participant does not open .....	29
Supervision Participant services .....	29
troubleshooting supervision Participant services .....	29

## U

upgrading citect.ini files .....	29
users	
default user for Plant SCADA project .....	14





Schneider Electric  
35 rue Joseph Monier  
92500 Rueil Malmaison  
France

+ 33 (0) 1 41 29 70 00

[www.se.com](http://www.se.com)

As standards, specifications, and design change from time to time,  
please ask for confirmation of the information given in this publication.

© 2023 Schneider Electric. All rights reserved.

EIO0000001525.15