





TABLE-1: STAR DELTA STARTER COMPONENTS – TYPE-1 COORDINATION									
400V			SWITCH FUSE	FUSE LINK TYPE: oM ca(A)	FUSE SIZE TYPE	LINE CONTACTOR TYPE	DELTA CONTACTOR TYPE	STAR CONTACTOR TYPE	THERMAL O/L RELAYS TYPE
P (KW)	Ie	IrD							
90	160	92,4	GS*N	200	T1	LC1E95	LC1E95	LC1E80	LRE365

NOTE:
1. RATING WILL BE BASED ON UTILITY POWER INPUT.

BILL OF MATERIAL		
SL.NO	DESCRIPTION	QUANTITY
1	MEDIUM VOLTAGE SWITCHGEAR 12KV, 20KA/3S	1NO.
2	OIL-IMMERSED TRANSFORMER, GROUND MOUNTED 630KVA, 12KV/400V	1NO.
3	CIRCUIT BREAKER (ACB) EASYPACT MVS AIR CIRCUIT BREAKER MVS10C, ET66, 1000A	
4	CIRCUIT BREAKER (MCBB) EASYPACT CVS MOLDED CASE CIRCUIT BREAKER CVS400F.400A	1NO.
5	CIRCUIT BREAKER (MCBB) EASYPACT CVS MOLDED CASE CIRCUIT BREAKER CVS100F.100A	2NOs.
6	CIRCUIT BREAKER (MCBB) EASYPACT GV MOLDED CASE CIRCUIT BREAKER GVAL8N, 80A	1NO.
7	CIRCUIT BREAKER (MCBB) EASYPACT CVS MOLDED CASE CIRCUIT BREAKER CVS100F.32A	2NOs.
8	EASYLOGIC PFC CAPACITOR BANK 175KVAR	1NO.
9	CONTACTOR LC1D65AP7	1NO.
10	VARIABLE SPEED DRIVE (VSD) ATV340D22N4	1NO.
11	EASY UPS UNINTERRUPTIBLE POWER SUPPLY 2 KVA	1NO.
12	80 KW MOTOR FEEDER WITH STAR-DELTA STARTER REFER TABLE-1	4SETS.
13	EASYLOGIC PM1000H/2000 SERIES	2NOs.
14	PANEL SERVER	2NOs.
15	EASYCOM	1NO.
16	PowerLogic P1 Relay	1NO.

LEGENDE	
SYMBOL	DESCRIPTION
	CIRCUIT BREAKER
	SWITCH DISCONNECTOR/EARTHING DISCONNECTOR
	CONTACTOR
	FUSE
	MOTOR
	OVERLOAD RELAY
	OPERATED BY MOTOR
	EARTH
	PROPAGATION IN 1 DIRECTION
	LOCALISATION
	POWER TRANSFORMER
	DELTA 3 PHASES WINDING
	STAR 3 PHASES WINDING
	CURRENT TRANSFORMER
	CAPACITOR BANK
	VARIABLE SPEED DRIVE
	DISTRIBUTION BOARD
	CROSS REFERENCE
	CABLE
	3 CONDUCTORS WITH PROTECTIVE CONDUCTOR
	3 CONDUCTORS WITH NEUTRAL AND PROTECTIVE CONDUCTOR

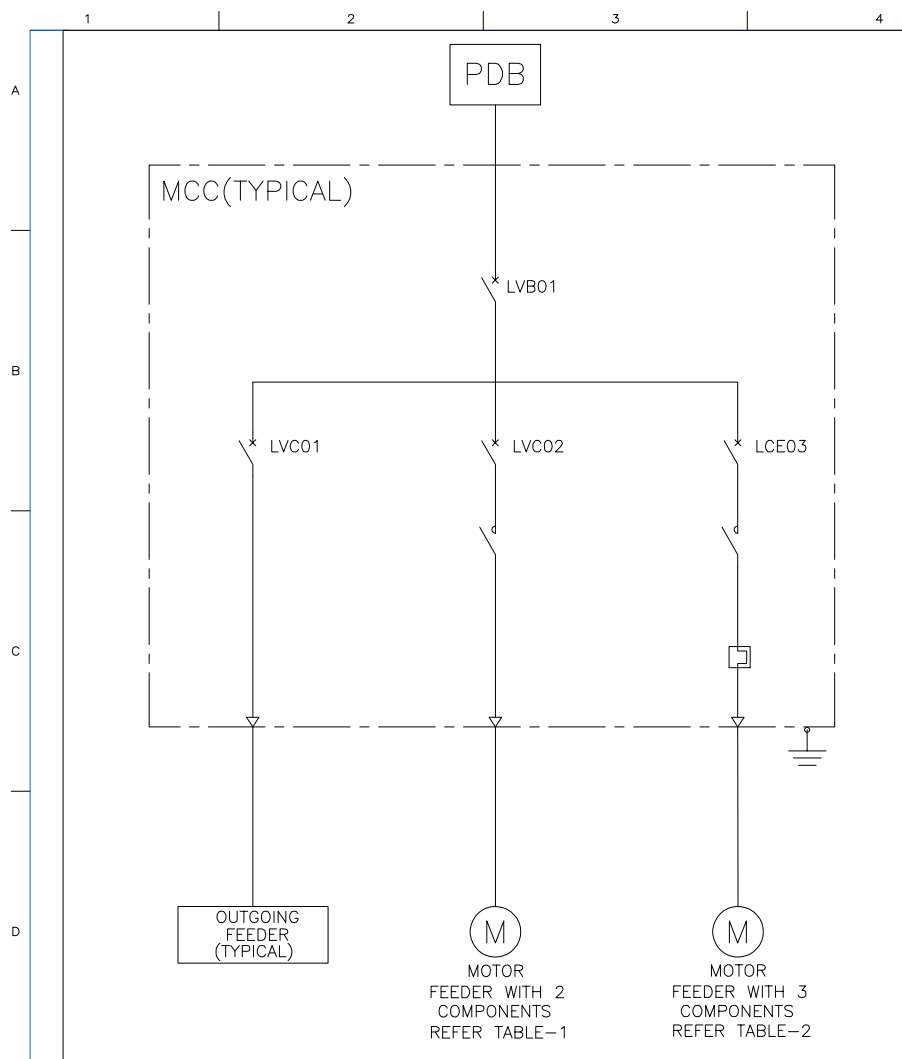
DESCRIPTION COMMUNICATION CONNECTION	
	ETHERNET TECHNICAL LAN CONNECTION
	MOBUS CONNECTION
	HARDWIRED CONNECTION
	WIRELESS (ZIGBEE) CONNECTION
TH110	WIRELESS THERMAL SENSOR
CL110	WIRELESS THERMAL AND HUMIDITY SENSOR

O2	21-03-2024	Revised Issue					
O1	27-03-2023	Revised Issue					
00	21-04-2021	First Issue					
Rev	Date	Modification					

IRRIGATION SYSTEM
EASY REFERENCE ARCHITECTURE



IRRIGATION SYSTEM		02
ESXPERA003EN	Rev 02	Sheet 001/002












0.37KW TO 55KW :TYPE 1 COORDINATION										
MOTOR DATA:							CIRCUIT-BREAKER			CONTACTOR
P(KW)	Ie(A) 380V	Ie(A) 400/415V	Iq 400/415V	P(KW)	Ie(A) 440V	Iq 440V	REFERENCE	SETTING	Irrm(AV)	REFERENCE
0.37	1.2	1.1	50	0.37	1	50	GZ1E06	1..1,6	13	LC1E09
0.55	1.6	1.5	50	0.55	1.36	50	GZ1E06	1..1,6	22.5	LC1E09
0.75	2	1.8	50	0.75	1.68	50	GZ1E07	1,6..2,5	33.5	LC1E09
1.1	2.8	2.6	50				GZ1E08	2,5..4	33.5	LC1E09
				1.1	2.37	50	GZ1E07	1,6..2,5	33.5	LC1E09
1.5	3.7	3.4	50	1.5	3.06	50	GZ1E08	2,5..4	51	LC1E09
2.2	5.3	4.8	50	2.2	4.4	50	GZ1E10	4..6,3	78	LC1E09
3	7	6.5	50				GZ1E14	6..10	138	LC1E09
				3	5.77	50	GZ1E10	4..6,3	78	LC1E09
4	9	8.2	50	4	7.9	15	GZ1E14	6..10	138	LC1E09
5.5	12	11	15	5.5	10.4	8	GZ1E16	9..14	170	LC1E12
7.5	16	14	15	7.5	13.7	8	GZ1E20	13..18	223	LC1E18
10	21	19	15				GZ1E21	17..23	327	LC1E25
11	23	21	15	11	20.1	6	GZ1E22	20..25	327	LC1E25
15	30	28	15	15	26.5	6	GZ1E32	24..32	416	LC1E32
18.5	37	34	50	18.5	32.5	50	GV3P40	30..40	560	LC1E40
22	43	40	50	22	39	50	GV3P50	37..50	700	LC1E50
30	59	55	50				GV3P65	48..65	910	LC1E65
				30	51.5	50	GV3P65	48..65		LC1E65
37	72	66	50	37	64	50	GV3P73	62..73	1120	LC1E80
45		80	100	45	76	70	GV4P115N	65..115	1300	LC1E95
55	105	100	100	55	90	70	GV4P115N	65..115	1500	LC1E120

NOTE: Contactor up sizing is recommended for frequent startup / heavy DOL starting requirements. For such requirements, kindly connect with Schneider Electric representatives

0.37KW TO 250KW :TYPE 1 COORDINATION												
MOTOR DATA:							CIRCUIT BREAKER:			CONTACTOR	OVERLOAD	RELAY
P(KW)	Ie(A) 380V	Ie(A) 400/415V	Iq 400/415V	P(KW)	Ie(A) 440V	Iq 440V	Type	SETTING	Irm(A)		O/L	I _{lrth}
0.37	1.2	1.1	50	0.37	1	50	GZ1LE06	1..1,6	13	LC1E09	LRE06	1..1.16
0.55	1.6	1.5	50	0.55	1.36	50	GZ1LE06	1..1,6	22.5	LC1E09	LRE06	1..1.16
0.75	2	1.8	50	0.75	1.68	50	GZ1LE07	1,6..2,5	33.5	LC1E09	LRE07	1,6..2.5
1.1	2.8	2.6	50				GZ1LE08	2,5..4	33.5	LC1E09	LRE08	2,5..4
				1.1	2.37	50	GZ1LE07	1,6..2,5	33.5	LC1E09	LRE07	1,6..2,5
1.5	3.7	3.4	50	1.5	3.06	50	GZ1LE08	2,5..4	51	LC1E09	LRE08	2,5..4
2.2	5.3	4.8	50	2.2	4.4	50	GZ1LE10	4..6.3	78	LC1E09	LRE10	4..6
3	7	6.5	50	3	5.77	50	GZ1LE14	6..10	138	LC1E09	LRE12	5,5..8
4	9	8.2	50	4	7.9	15	GZ1LE14	6..10	138	LC1E09	LRE14	7..10
5.5	12	11	15	5.5	10.4	8	GZ1LE16	9..14	170	LC1E12	LRE16	9..13
7.5	16	14	15	7.5	13.7	8	GZ1LE20	13..18	223	LC1E18	LRE21	12..18
11	23	21	15	11	20.1	6	GZ1LE22	20..25	327	LC1E25	LRE22	16..24
15	30	28	15	15	26.5	6	GZ1LE32	24..32	416	LC1E32	LRE32	23..32
18.5	37	34	50	18.5	32.5	50	GV3L40	30..40	560	LC1E40	LRE355	30..40
22	43	40	50	22	39	50	GV3L50	37..50	700	LC1E50	LRE357	37..50
30	59	55	50	30	51.5	50	GV3L65	48..65	910	LC1E65	LRE359	48..65
37	72	66	50	37	64	50	GV3L73	62..73	1120	LC1E80	LRE363	63..80
45	85	80	100				CVS100-MA	6..14	1300	LC1E95	LRE365	80..104
				45	76	70	CVS100-MA	6..14	1300	LC1E95	LRE363	63..80
55	105	100	100	55	90	70	CVS160-MA	9..14	1500	LC1E120	LRE482	84..135
75	140	135		75	125		CVS160-MA	9..14	1950	LC1E200	LRE483	124..198
90	170	160		90	146		CVS250-MA	9..14	2420	LC1E200	LRE484	146..234
110	210	200		110	178		CVS250-MA	9..14	2860	LC1E250	LRE484	146..234
							CVS400-MA	6..13	3500	LC1E250	LRE484	146..234
132	250	230		132	215		CVS400-MA	6..13	3500	LC1E300	LRE485	174..279
160	300	270		160	256		CVS400-MA	6..13	4160	LC1E300	LRE486	208..333
200	380	361		200	321		CVS630-MA	6..13	5700	LC1E400	LRE487	259..414
220	420	380		220	353		CVS630-MA	6..13	6500	LC1E500	LRE488	321..513
250	460	430		250	401		CVS630-MA	6..13	6500	LC1E500	LRE488	321..514

NOTE: Contactor up sizing is recommended for frequent startup / heavy DOL starting requirements. For such requirements, kindly connect with Schneider Electric representatives

LEGEND	
SYMBOL	DESCRIPTION
	CIRCUIT BREAKER
	PROPAGATION IN 1 DIRECTION
	POWER DISTRIBUTION BOARD
	CROSS REFERENCE
	CONTACTOR
	THERMAL OVERLOAD RELAY
	MOTOR
	CABLE
	EARTH

02	21-03-2014	Revised Issue					
01	27-03-2013	Revised Issue					
00	21-04-2001	First Issue					
Rev	Date	Modification					