

SEISMIC QUANTIFICATION
 TO BE COMPLIANT WITH THE SEISMIC REQUIREMENTS OF ASCE/SEI 7, THIS UNIT IS SELF CERTIFIED TO ICS ES AC156, BY SHAKE TABLE QUALIFICATION TESTING. THE ENCLOSURE ABOVE IS 20M.

TRANSFORMER SPECIFICATION
 75 KVA 3 PHASE 60 HERTZ
 PRIMARY VOLTAGE: 600 DELTA
 SECONDARY VOLTAGE: 208Y/120
 150°C RISE ABOVE 40°C AMBIENT
 220°C INSULATION SYSTEM COPPER WINDING
 APPROXIMATE WEIGHT: 622 LBS
 GUARANTEED SOUND LEVEL: 45 dB
 TYPE 2 ENCLOSURE PAINTED ANSI 49 GREY
 MINIMUM EFFICIENCY 98.60% @ 35% LOADING 75°C
 COMPLYING WITH DOE 2016-10 CFR 431
 (78 FR 23335-APRIL 18, 2013)

NOTES:
 cULus List TO UL 1561 AND C22.2No47, FILE NUMBER E6868
 ALL UNITS 100% TESTED PRIOR TO SHIPPING TO NEMA ST-20 (2014)
 MANUFACTURE IN ISO 9001 FACILITIES
 GREEN PREMIUM (RoHS/REACH COMPLIANT, PRODUCT ENVIRONMENT PROFILE)
 REGISTERED TO DOE VIA 10 CFR 429 & NRCAN
 MINIMUM CLEARANCE 1/2 INCH PER ALCOVE TESTING UL 1561. SIDES AND REAR FRONT ACCESS MUST COMPLY WITH NEC WORK SPACE REQUIREMENTS, MINIMUM CLEARANCE OF 6 INCHES.
 CONDUIT ENTRY AREA ARE SHOWN ABOVE, LOCATIONS ARE FRONT SIDES AND FRONT BOTTOM

DUAL DIMENSIONS: INCHES
 MILLIMETERS




LOW VOLTAGE DISTRIBUTION TRANSFORMER
 DOE 2016
 DRY TYPE TRANSFORMERS CATALOG NO EXN75T65HCU
 3 PHASE, 600 DELTA
 SECONDARY 208Y /120, COPPER



DWG# EXN75T65HCU PG 1

IN EACH PHASE CONNECT TO TAPS	
PRIMARY VOLTS	2-2.5% FCAN 4-2.5% FCBN
630	1
615	2
600	3
585	4
570	5
555	6
540	7

NOTE: ACTUAL VOLTAGES &
NAMEPLATE VALUES MAY NOT
MATCH VOLTAGE IN TABLE

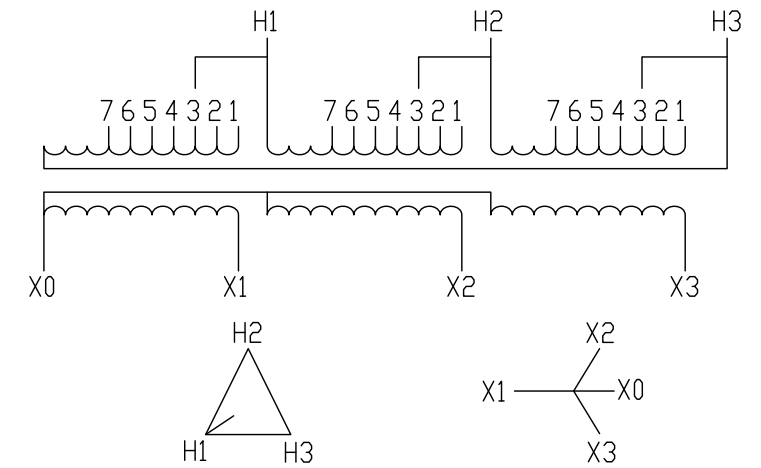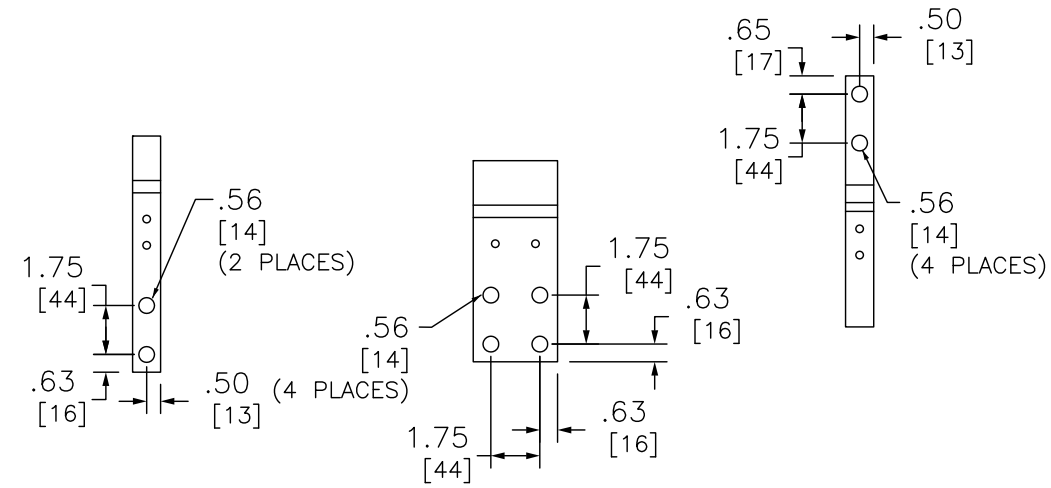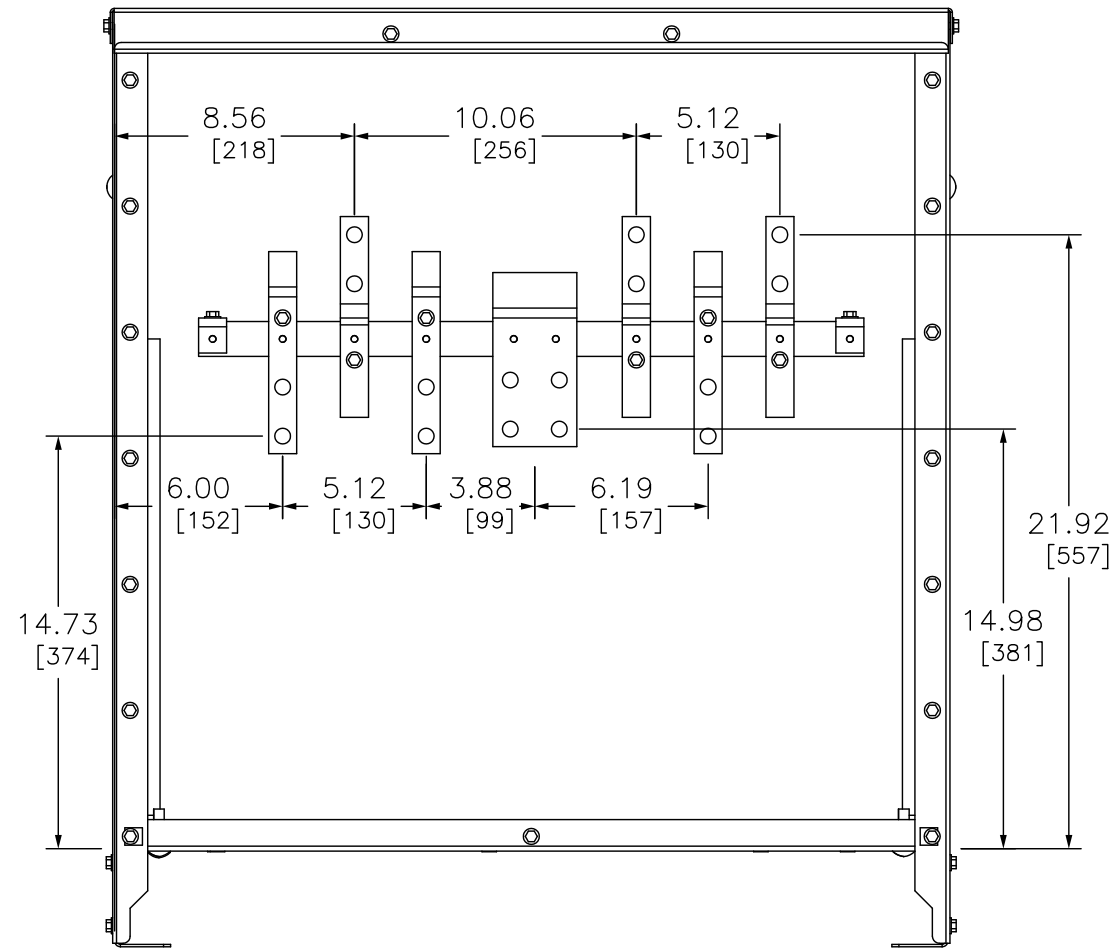

DUAL DIMENSIONS: INCHES
MILLIMETERS

LOW VOLTAGE DISTRIBUTION TRANSFORMER
DOE 2016
DRY TYPE TRANSFORMERS CATALOG NO EXN75T65HCU
3 PHASE, 600 DELTA
SECONDARY 208Y /120, COPPER



DWG# EXN75T65HCU PG 2
NO.