Safety Information

Electrical equipment should be installed, operated, serviced, and maintained only by qualified personnel. No responsibility is assumed by Schneider Electric for any consequences arising out of the use of this material.

A qualified person is one who has skills and knowledge related to the construction, installation, and operation of electrical equipment and has received safety training to recognize and avoid the hazards involved.

Esmi Impresia Multicriteria Detector

Esmi Impresia Multicriteria Detector (FFS06741003) is an addressable combined (temperature and optical-smoke) detector with built-in isolator module, designed for installing in addressable fire alarm systems with Esmi ELC loop controller supporting Schneider Electric communication protocol. The detector sensitivity can be configured with software. The detector is compatible with Esmi Impresia Standard Base (FFS06741018) and Esmi Impresia Standard Base High Profile (FFS06741028). The address setting is done by the panel, QR code or handheld addressing device. The address range is 1-250.

For more technical information visit www.se.com.



WARNING

HAZARD OF COMPROMISED DETECTION FUNCTIONALITY.

- Dust covers help to protect units during shipping and when first installed.
- Sensors should be removed before construction, major re-decoration or other dust producing work is started.

Failure to follow these instructions can result in death or serious injury.

Installation

Note: Collect the QR code stickers from the devices if QR codes are used for addressing of the devices.

- Follow the applicable local and national installation codes and regulations.
 - IMPORTANT: Do not install the detector near sources of steam, smoke, condensation or heat.
- If needed, lock the detector to the base by removing a small tab on the detector as shown on the picture
- 3. Install the detector base into a flat surface by using appropriate screws.
- 4. The loop power must be disconnected during installation.
- Connect the loop wiring as shown on picture 3. 5.
- Insert the detector to the base by turning it clockwise on the base until it drops into place. A stripe on the detector side match to the short stipe of the base. Continue to turn the detector until the stripe on the detector meet the longer stipe on the base - a click is heard. See picture 4.
- Test the detector functionality with Solo no climb tester.

If the detector is locked into the base it can be removed by pressing the lid with a small flat head screwdriver and gently turning the detector counter clockwise at the


Testina

Before testing make sure all persons in the building are aware of the test! If needed disconnect fire alarm devices, alarm transmitters and other fire outputs before the test. Use Solo "No Climb" tester to test the detector after installation. Follow the testers manufacturer instruction how to run smoke and heat tests.

Technical Specifications

Consumption in quiescent state, no communication . . . < 190µA@27VDC Consumption in quiescent state, with communication ... < 310µA@27VDC Consumption in alarm state, with communication 6.5mA Wire Gauge for terminals 0.4mm² ÷ 2.0mm² Supported communication protocol Esmi ELC



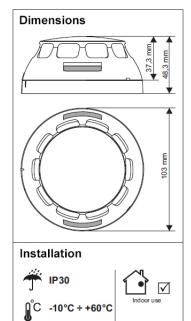

| Essential Characteristics According to EN 54 | Performance |
|--|-------------|
| Performance under fire conditions | Pass |
| Operational reliability | Pass |
| Durability: | |
| Temperature resistance | Pass |
| Humidity resistance | Pass |
| Shock and vibration resistance | Pass |
| Corrosion resistance | Pass |
| Resistance to ingress | Pass |
| Electrical stability | Pass |

 $(\epsilon_{22}$

DoP No: DP20019 Made in Bulgaria EN 54-5:2017+A1:2018

EN 54-7:2018

EN 54-17:2005/AC:2007 Detector Class A1/R

Schneider Electric Buildings AB Mobilvägen 8 22362 Lund Sweden

Schneider Electric Buildings AB

Mobilvägen 8 223 62 Lund Sweden se.com/contact February 2024



