


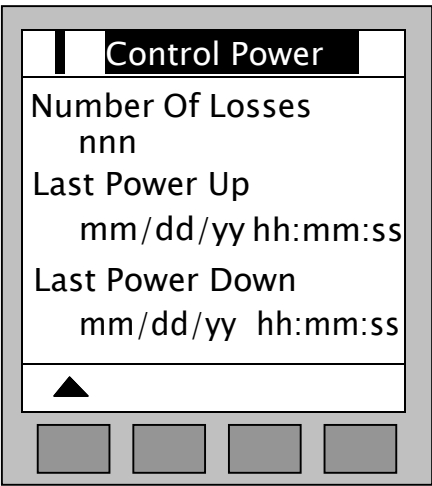
Release history for Model numbers PM5341

Release Version	Date	OS Version	RS version	Language Version
2.6.6	27-Mar-2024	2.6.6	2.0.0	4.2.0
2.4.4	5- Nov-2020	2.4.4	2.0.0	4.2.0
2.4.1	14-May-2020	2.4.1	2.0.0	4.1.0
2.2.3	28-Jun-2018	2.2.3	2.0.0	4.0.0
2.2.1	01-Mar-2017	2.2.1	2.0.0	4.0.0
2.2.0	16-Jun-2016	2.2.0	2.0.0	4.0.0

Note :

- Firmware revision 2.xx is applicable for PM51/53xx meters with enhanced internal memory.
- 2.xx revision applicable for Hardware version B1. Hardware version is indicated on the Meter labels
- Firmware version 2.xx is **not** compatible with firmware version 1.xx.
- Meters with 1.xx firmware can't be upgraded with 2.xx firmware

Revision	Changes Since Version	Change Details
2.6.6	2.4.4	<p>Fixes</p> <ul style="list-style-type: none"> • kVAR measurement error during energy export is fixed • PF phase wise -1 to 1 registers added in both Modbus register list and BACnet
2.4.4	2.4.1	<p>Fixes</p> <ul style="list-style-type: none"> • PM53xx & PM51xx Reactive Power measurement at UPF and high CT/PT ratio - the reactive power jumps around when PF is very close to 1, need to round-off PF higher than 0.996 to 1 • Affecting zero-day vulnerabilities from "Ripple20" in low-level TCP/IP software library developed by Treck, Inc. - fixed <p>Enhancements</p> <ul style="list-style-type: none"> • User-configurable fixed energy unit settings • Checksum implementation for these models • MAC on Display
2.4.1	2.23	<p>Following are added for new as per latest Welmec Guidance for MID certification</p> <ul style="list-style-type: none"> • When the meter powers up, a Control Power Down symbol  is displayed if the meter is locked (Revenue/MID). The Control Power Down symbol will be there if both 'Power Up and Power Down events are not acknowledged.

		<ul style="list-style-type: none"> Following screen is added in the control power menu  <ul style="list-style-type: none"> 10 pairs of Power Down and Power Up Events should be logged and available to read via Modbus
2.2.3	2.21	<ul style="list-style-type: none"> Meter sometimes hangs when BACnet (Bnet) menu is accessed on the HMI, this is fixed Bug Fixed: Phase reverse alarm Changed: Default LCD type Vx to Tm (internal) Bug fixed: Gain switch changed Bug fixed: Checksum verification is upgraded from 1Mb to 2Mb in Ethernet models
		<p>Fixes</p> <ul style="list-style-type: none"> 8905 Bitmap Register Changed from UINT32 to UINT16 <p>Note: This register not applicable to PM51xx meters. Firmware revised to keep the commonality</p>
2.20	1.60	<p>First release for Meter hardware with Enhanced memory.</p> <p>Enhancements</p> <ul style="list-style-type: none"> DPWS support added Hardware enhancement for increased internal memory Individual harmonics magnitude <1% available CT primary / secondary ratio data can take float values Bacnet support added <p>Fixes</p> <ul style="list-style-type: none"> In case of negative energy flow, the HMI scaling for Power and Energy not correct: fixed Single/ Multiple coil read correction for DI,DO, Alarms Power Fail Reset Counter Not Getting Changed on HMI After Reset In 2VT configuration, unused phase value was showing 0. – Fixed

		<ul style="list-style-type: none">• Display RTC time and QR code time stamp not matching when GMT offset is added. - Fixed.• Missing of 1st pulse in DO Alarm Counter and Setup Changed from ON -> OFF Vice verse – Fixed
--	--	---