

No. 10010289-OPE/INC 16-0005

**Issued to:**

Schneider Electric  
2195 Keating Cross Road  
Saanichton, British Columbia  
Canada V8M 2A5

**For the server product:**

PowerLogic ION7400 Meter  
Software version: 001.002.015  
S/N: MR-1510A816-00

The server product has not been shown to be non-conforming to:

## IEC 61850 Edition 2 Parts 6, 7-1, 7-2, 7-3, 7-4 and 8-1

Communication networks and systems for power utility automation

The conformance test has been performed according to IEC 61850-10 Edition 2, the UCA International Users Group Edition 2 Server Test Procedures version 1.0 with TPCL<sup>2</sup> 1.1.1 with product's protocol, model, technical issue implementation conformance statements and the extra information for testing: "IEC 61850 and ION technology, 70022-0125-05 (02/2016)".


The following IEC 61850 conformance blocks have been tested with a positive result (number of relevant and executed test cases / total number of test cases):

1 Basic Exchange (16/26)	12a Direct Control (4/18)
2 Data Sets (4/7)	13 Time Synchronization (3/7)
5 Unbuffered Reporting (16/20)	
6 Buffered Reporting (24/29)	

This certificate includes a summary of the test results as carried out at DNV GL in The Netherlands with UniCA 61850 Client Simulator 4.29.03 with test suite Ed2 3.29.04 and UniCA 61850 Analyzer 5.29.02. This document has been issued for information purposes only, and the original paper copy of the DNV GL verification report No. 10010289-OPE/INC 16-0006 will prevail.

The test has been carried out on one single specimen of the product as referred above and submitted to DNV GL by Schneider Electric. The manufacturer's production process has not been assessed. This certificate does not imply that DNV GL has approved any product other than the specimen tested.

Arnhem, January 15, 2016

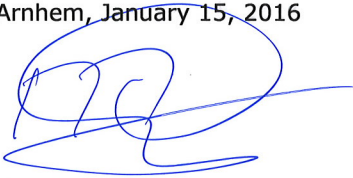

**M. Adriaensen**  
Head of Department  
Operational Excellence

**Issued by:**



DNV KEMA is now DNV GL



**R. Schimmel**  
Verification Manager

<sup>1</sup> Level A - Independent test lab with certified ISO 9001 Quality System

<sup>2</sup> TPCL - Test procedures change list

Copyright © KEMA Nederland B.V. Arnhem, the Netherlands. All rights reserved. It is prohibited to update or change this certificate in any manner whatsoever, including but not limited to dividing it into parts.

Applicable Test Procedures from the UCA International Users Group Edition 2 Server Test Procedures version 1.0 with TPCL 1.1.1

Conformance Block	Mandatory	Conditional
1: Basic Exchange	sAss1, sAss2, sAss3, sAssN2, sAssN3, sAssN4, sAssN5, sSrv1, sSrv2, sSrv3, sSrv4, sSrv5, sSrvN1abcd, sSrvN4	sSrv8, sSrvN1f
2: Data Sets	sDs1, sDs10a, sDsN1ae	sDs15
5: Unbuffered Reporting	sRp1, sRp2, sRp3, sRp4, sRp9, sRp14, sRpN1, sRpN2, sRpN3, sRpN4, sRpN8	sRp5, sRp8, sRp10, sRp11, sRp12
6: Buffered Reporting	sBr1, sBr2, sBr3, sBr4, sBr9, sBr14, sBr20, sBr21, sBr22, sBr25, sBr26, sBr27, sBr28, sBrN1, sBrN2, sBrN3, sBrN4, sBrN5, sBrN8	sBr5, sBr8, sBr10, sBr11, sBr12
12a: Direct control	sCtl5, sCtl10, sDOns1, sDOns2	
13: Time sync	sTm1, sTm2, sTmN1	

All configuration file and data model tests have been successfully performed for the product variants using the same communication hardware and software version:

- PowerLogic PM8000 Meter