

EU Type Examination Certificate Number: **0120/SGS0203**

Schneider Electric

Schneider Electric Canada Inc.
2195 Keating Cross Road
Saanichton, British Columbia
Canada, V8M 2A5

Instrument Identification:
PM8000

**Polyphase, Active Import/ Export (kWh), Transformer Operated, Auxiliary power supply,
RS485, Dual Ethernet, 1 digital output, 3 digital inputs**

Instrument Traceable Number
0120/SGS0203

has been assessed and certified as meeting the requirements of

EU Directive 2014/32/EU

on Measuring Instruments Annex II, Module B

It is certified that the manufacturer's technical design and specimen for the above instrument has been examined and, based on the evidence submitted, it is considered that the instrument conforms to the requirements of Annex V of EU Directive 2014/32/EU

This certificate must be used in conjunction with a certificate covering the product verification as required in Annex II, Module D or Annex II, Module F

This certificate is valid until 6th September 2025
Issue 5


Certification is based on report number(s)
EMA195810/1 dated 28th January 2015, EMA204099 dated 28th January 2015

Authorised Signature



Tuomas Hänninen

SGS Fimko OY, Notified Body 0598
Takomatie 8, FI-00380 Helsinki, Finland
t +358 9 6963 61 www.sgs.fi

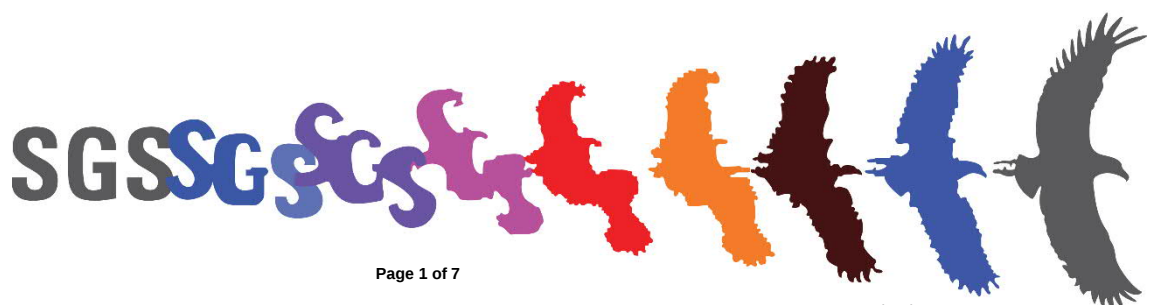

	EU-Type Examination Certificate Number:	
	0120/SGS0203	
	Issue Number: 5	Dated: 12 th March 2024

1. Technical Data

Manufacturer	Schneider Electric
Meter Type	PM8000
Voltage Rating (U_n)	3P3W: 3x100V ~ 3x600V (L-L) 3P4W: 3 x 57.7/100V ~ 3x400/690V
Current Rating (I_{min} – I_{ref} (I_{max}))	0.025-5(10)A
Frequency (F_n)	50Hz or 60Hz (IEC only)
Active Accuracy Class (kWh)	C (kWh)
Type of circuit	3P4W, 3P3W
Temperature Range	-25°C ~ +70°C
Software/ Firmware Version No's	Version: 001.004.003. CRC: 0x0c2eda9a Version: 002.001.000. CRC: 0x5c9693a1 Version: 002.002.001. CRC: 0xd0467dc0 Version: 003.000.000. CRC: 0xe4bbde55 Version: 003.001.000. CRC: 0xa5722135 Version: 004.000.000. CRC: 0x262a2d16 Version: 004.005.000. CRC: 0xa5ac524b
Identification Location	LCD
Bill of Materials No's	EAV66596 PCBA, PSU, PM8000 EAV66599 PCBA, CVM, PM8000 EAV66594 PCBA, Comm I/O, PM8000 EAV66601 PCBA, Backplane, INT, PM8000 EAV66597 PCBA, CPU, PM8000 QGH24414 LVDC PCBA, PSU, PM8000 Alternative construction GEX30048 PCBA, CPU, PM8000, LATTICE
IP Rating	IP51 Front Display Meter body not rated, must be fitted in an IP51 Enclosure
Insulation Protective Class	Class II
LED Pulse Constant	5000 imp/ kWh
Impulse Voltage Rating	6kV
AC Voltage Rating	4kV
Main Cover Sealing Type	Destructible rivet
Integrity of meter	Inaccessible without breaking rivet
Intended Location of the Meter	Indoor
Type of Register	LCD

SGS

EU-Type Examination Certificate Number:

0120/SGS0203

Issue Number: 5

Dated: 12th March 2024

2. Photograph of Meter and Sealing Plan



SGS


EU-Type Examination Certificate Number:

0120/SGS0203

Issue Number: 5

Dated: 12th March 2024

3. Examples of Nameplates

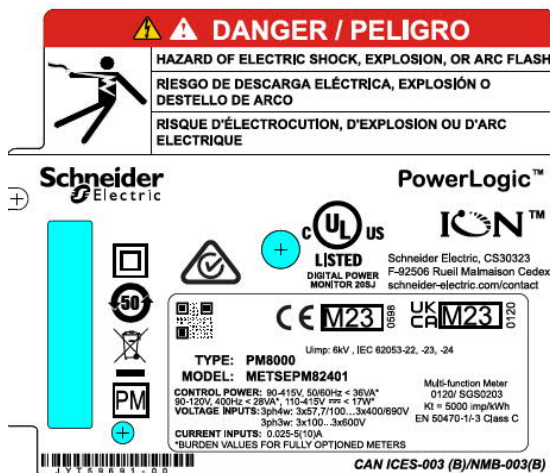

	EU-Type Examination Certificate Number:	
	0120/SGS0203	
	Issue Number: 5	Dated: 12 th March 2024

4. Calculation of the composite error/ MPE

During the type approval examination the influence factors for temperature, frequency and voltage are determined per load point. The table below represents the sum of the square values per load, determined via the following formula:-

$$\delta e(T, U, f) = \sqrt{(\delta e^2(T, I, \cos\phi) + \delta e^2(U, I, \cos\phi) + \delta e^2(f, I, \cos\phi))}$$

where

$\delta e(T, I, \cos\phi)$ = Additional error due to variation of the temperature at the same load
 $\delta e(U, I, \cos\phi)$ = Additional error due to variation of the voltage at the same load
 $\delta e(f, I, \cos\phi)$ = Additional error due to variation of the frequency at the same load

Current	PF Cos	Influence Factors for temperature, frequency and voltage							
		-40°C	-25°C	-10°C	5°C	30°C	40°C	55°C	70°C
I _{min}	1.0	0.15	0.20	0.14	0.12	0.11	0.12	0.13	0.13
I _{tr}	1.0	0.13	0.18	0.11	0.07	0.06	0.07	0.07	0.07
10I _{tr}	1.0	0.24	0.27	0.19	0.09	0.05	0.06	0.06	0.05
I _{max}	1.0	0.20	0.23	0.15	0.09	0.06	0.07	0.07	0.06
I _{tr}	0.5ind	0.27	0.19	0.21	0.11	0.08	0.08	0.10	0.15
10I _{tr}	0.5ind	0.42	0.42	0.31	0.17	0.08	0.11	0.11	0.08
I _{max}	0.5ind	0.45	0.44	0.32	0.19	0.08	0.10	0.09	0.10
I _{tr}	0.8cap	0.10	0.09	0.22	0.13	0.09	0.09	0.09	0.09
10I _{tr}	0.8cap	0.21	0.23	0.15	0.11	0.10	0.10	0.10	0.10
I _{max}	0.8cap	0.15	0.17	0.11	0.10	0.09	0.09	0.09	0.09
L1									
I _{tr}	1.0	0.26	0.22	0.15	0.11	0.09	0.10	0.12	0.10
10I _{tr}	1.0	0.19	0.20	0.13	0.08	0.04	0.05	0.06	0.04
I _{max}	1.0	0.18	0.19	0.10	0.07	0.03	0.04	0.04	0.04
I _{tr}	0.5ind	0.29	0.33	0.24	0.17	0.14	0.17	0.23	0.31
10I _{tr}	0.5ind	0.25	0.25	0.16	0.09	0.07	0.11	0.11	0.09
I _{max}	0.5ind	0.21	0.22	0.14	0.09	0.07	0.08	0.06	0.20
L2									
I _{tr}	1.0	0.19	0.20	0.17	0.15	0.15	0.15	0.15	0.15
10I _{tr}	1.0	0.38	0.36	0.26	0.17	0.14	0.14	0.14	0.14
I _{max}	1.0	0.31	0.29	0.22	0.18	0.15	0.15	0.15	0.15
I _{tr}	0.5ind	0.72	0.54	0.47	0.25	0.16	0.16	0.16	0.17
10I _{tr}	0.5ind	0.59	0.57	0.46	0.29	0.18	0.19	0.19	0.18
I _{max}	0.5ind	0.65	0.64	0.50	0.33	0.21	0.23	0.22	0.22
L3									
I _{tr}	1.0	0.16	0.16	0.07	0.04	0.04	0.04	0.04	0.04
10I _{tr}	1.0	0.26	0.29	0.17	0.10	0.03	0.04	0.04	0.03
I _{max}	1.0	0.21	0.23	0.12	0.08	0.03	0.04	0.04	0.03
I _{tr}	0.5ind	0.41	0.28	0.28	0.15	0.06	0.06	0.06	0.06
10I _{tr}	0.5ind	0.49	0.47	0.32	0.18	0.07	0.10	0.09	0.08
I _{max}	0.5ind	0.47	0.47	0.31	0.19	0.02	0.09	0.08	0.07

	EU-Type Examination Certificate Number:	
	0120/SGS0203	
	Issue Number: 5	Dated: 12 th March 2024

5. Annex of Variants

Product Variant Identification Details:

Type Designation		Description of meter
Product	Model (SKU)	Description
	PM8000	
	METSEPM82401	Polyphase, Active Import/ Export (kWh), Transformer Operated, Auxiliary Power Supply, RS485, Dual Ethernet, 1 Digital Output, 3 Digital Inputs
	METSEPM82101	Polyphase, Active Import/ Export (kWh), Transformer Operated, Auxiliary Power Supply (20-60 VDC), Dual Ethernet, 1 Digital Output, 3 Digital Inputs
Aux Devices	METSEPM83401	Polyphase, Active Import/ Export (kWh), Transformer Operated, Auxiliary Power Supply, RS485, Dual Ethernet, 1 Digital Output, 3 Digital Inputs Advanced MID, integrated display
	METSEPM81401	Polyphase, Active Import/ Export (kWh), Transformer Operated, Auxiliary Power Supply, RS485, Dual Ethernet, 1 Digital Output, 3 Digital Inputs Essential MID, integrated display
	METSEPM89M2600	Digital I/O module (6 digital inputs & 2 relay outputs)
	METSEPM89M0024	Analogue I/O module (4 analogue inputs & 2 analogue outputs)
	METSEPMFIBER	+ 100BASE FX SC duplex connector

Modifications to the meter(s) described according to approval No.0120/SGS0203 must be notified to the issuing body to confirm the meter(s) continuing compliance to the relevant pattern approval standard(s).

	EU-Type Examination Certificate Number:	
	0120/SGS0203	
	Issue Number: 5	Dated: 12 th March 2024

6. Document Revision History

Issue	Date	Comments
1	07/09/2015	Initial Issue
2	12/10/2016	New BOM and software revision
3	11/04/2018	New firmware version
4	27/05/2018	Auxiliary devices included in product details
5	18/04/2019	New firmware version 002.001.000 & CRC checksum No. 0x5c9693a1 added.
6	03/03/2020	New firmware version 002.002.001 & CRC checksum No. 0xd0467dc0 added. BOM numbers changed to part numbers. Rear label updated to show correct marking 0120/SGS0203
7	14/04/2020	BOM number correction
8	17/09/2020	New firmware version 003.000.000 & CRC checksum No. 0xe4bbde55 added.
1	22/11/2021	Issue 1 for SGS Fimko NB 0598 The original approval certificate issued 07/09/2015 The modifications listed above were made prior to the transfer to SGS Fimko. New software version 003.001.000. Assessed to meet the requirements of Welmec 11.8.
2	31/03/2023	New software version 004.000.000. CRC 0x262a2d16. New rear label Alternative construction CPU PCBA, GEX30048 Corporate legal name changed. Replaced dba Power Measurement with Schneider Electric Inc.
3	30/08/2023	METSEPMFIBER added to list of Aux Devices on the TEC (as an I/O accessory)
4	19/12/2023	New model METSEPM82101 added to approval
5	12/03/2024	New models METSEPM81401 & METSEPM83401 added to approval. Firmware update 004.005.000, CRC: 0xa5ac524b

This document is issued by the Company subject to its General Conditions for Certification Services, available on request or accessible at <http://www.sgs.com/en/Terms-and-Conditions.aspx>.

Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law.

Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 28 days only.

END OF CERTIFICATE