

RUNTIME CHART

Runtime in Minutes	Number of Battery Cartridges (GVMMBTU)	Quantity & Type of Cabinet
7.4	12	1W
8.3	13	1W+1N
9.3	14	1W+1N
10	15	1W+1N
11	16	1W+1N
12	17	1W+1N
13	18	1W+1N
19.5	24	2W
26	30	2W+1N
32.5	36	3W
39.5	42	3W+1N
46.5	48	4W
54	54	4W+1N
61	60	5W
69	66	5W+1N
76.5	72	6W
84.5	78	6W+1N
92	84	7W
100	90	7W+1N
105	96	8W

FOR ADDITIONAL DETAILS, CLICK ON LINKS BELOW OF REFERENCE SUBMITTALS	
SL NO	REFERENCE SUBMITTALS
1	GVMPB180KG65S – Galaxy VM 180 kVA UPS Parallel 480–480 V, 65kAIC
2	GVMMODBCNS – Galaxy VM Modular Battery Cabinet–Narrow (FOR 480V PRODUCTS)
3	GVMMODBCWS – Galaxy VM Modular Battery Cabinet–Wide (For 480V products)
4	GVMSBC675KG – Galaxy VM System Bypass Cabinet 675K 480V
5	GVM180KG65SBCMC10R4–SD–Galaxy VM 180kVA UPS 3 N+1 with SBC and Modular Batt Cab System One Line

LEGEND

1N = 1 Narrow Battery Cabinet:

SKU No. GVMMODBCNS

1W = 1 Wide Battery Cabinet:

SKU No. GVMMODBCWS

NOTES:

- INSTALLATION SHALL COMPLY WITH ALL APPLICABLE NATIONAL, STATE AND LOCAL CODES.
- REFER TO PRODUCT DOCUMENTATION FOR ADDITIONAL DETAILS PRIOR TO INSTALLATION AND SITE PREPARATION WORK.
- IN AREAS WHERE SEISMIC PROTECTION IS REQUIRED, ANCHOR THE BRACKETS TO THE FLOOR. FLOOR ANCHORING BOLTS ARE NOT SUPPLIED.

THIS DRAWING AND SPECIFICATIONS HEREIN ARE THE PROPERTY OF SCHNEIDER ELECTRIC AND SHALL NOT BE COPIED, REPRODUCED OR USED IN WHOLE OR IN PART, AS THE BASIS FOR THE MANUFACTURE OR SALE OF ITEMS WITHOUT WRITTEN PERMISSION FROM SCHNEIDER ELECTRIC. THIS DRAWING IS BASED UPON LATEST AVAILABLE INFORMATION AND IS SUBJECT TO CHANGE WITHOUT NOTICE.

Schneider Electric

TITLE: Galaxy VM
Input: 480V AC 3PH DUAL/SINGLE MAINS
Output: 480V AC 3PH 180kVA
3+1 MODULE UPS WITH MODULAR BATTERY CABINETS
SOLUTION-ISOMETRIC VIEW



PROJECT: DRAWINGS SHEET 1 OF 5

DWG NO: GVM180KGMODBC9R4 REV. 0

DRAWN BY: C KRISHNA 08-JUN-16 THIRD

ENGINEER: C ANDERSEN/Z WILLIAM 08-JUN-16 ANGLE

APPROVED BY: M DESHPANDE 08-JUN-16 PROJECTION

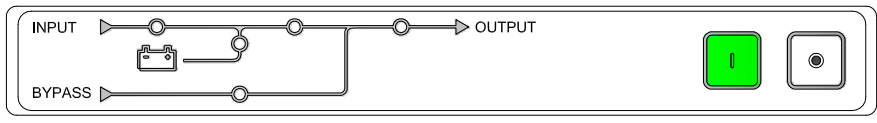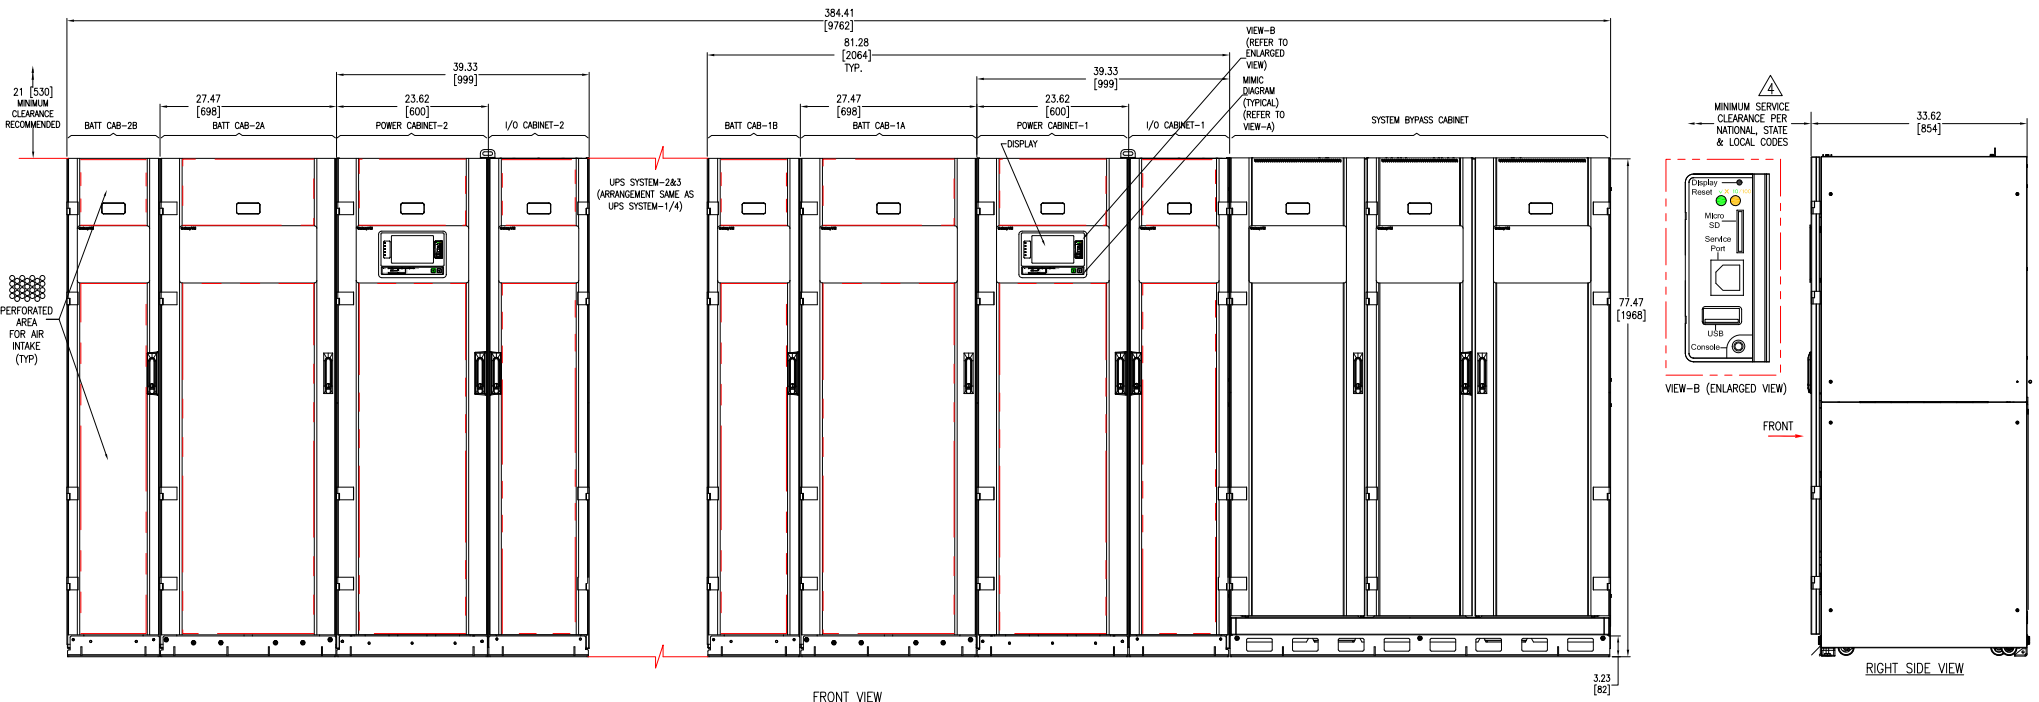


VIEW-A (MIMIC DIAGRAM)

Floor Loading Data			
SKU #	Dimensions HxWxD in Inches [mm]	Weight in lb [kg]	Floor Loading in lb/ft ² [kg/m ²]
0G-GVMPB160K180D (Power Cabinet-1,2,3&4)	77.56x23.62x33.62 [1970x600x854]	1032 [469]	187 [915]
0G-GVM1225KG65K (I/O Cabinet-1,2,3&4)	77.56x11.81x33.62 [1970x300x854]	462 [210]	168 [820]
GVMPB180KGS (UPS-1,2,3&4)	77.56x39.45x33.62 [1970x1002x854]	1495 [679]	162 [793]
GVMMODBCW (Wide Battery Cabinet-without Batteries)	77.56x27.56x33.62 [1970x700x854]	462 [210]	73 [355]
GVMMODBCN (Narrow Battery Cabinet-without Batteries)	77.56x14.57x33.62 [1970x370x854]	306 [139]	91 [443]
GVMMODBCW+12 GVMMBTU	77.56x27.56x33.62 [1970x700x854]	3630 [1650]	564 [2755]
GVMMODBCN+6 GVMMBTU	77.56x14.57x33.62 [1970x370x854]	1890 [859]	555 [2709]

- NOTES:
- INSTALLATION SHALL COMPLY WITH ALL APPLICABLE NATIONAL, STATE AND LOCAL CODES.
 - REFER TO PRODUCT DOCUMENTATION FOR ADDITIONAL DETAILS PRIOR TO INSTALLATION AND SITE PREPARATION WORK.
 - ALL DIMENSIONS ARE IN INCHES [MILLIMETERS].
 - FRONT ACCESS REQUIRED FOR SERVICE.
 - INPUT POWER CABLE ENTRY IS FROM TOP OR BOTTOM OF THE UNIT.
 - OPERATING TEMPERATURE: 32°F TO 104° [0° TO 40°].
 - PROTECTION CLASS: IP20 (IP23 OPTIONAL).
 - COLOR: RAL 9003 WHITE.
 - THIS INFORMATION PROVIDES CONSERVATIVE CENTER OF GRAVITY CALCULATION.

POWER/INPUT OUTPUT CABINET/BATTERY CABINET

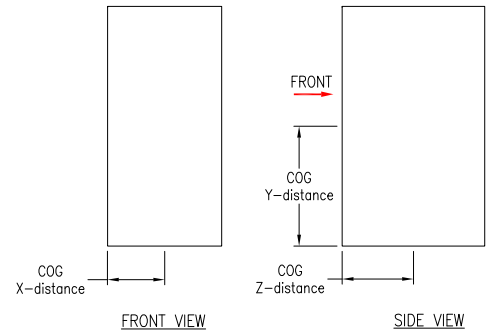


Cabinet	Center of Gravity in Inches [mm]		
	X-Distance	Y-Distance	Z-Distance
Power Cabinet	11.81 [300]	37.40 [950]	14.92 [379]
I/O Cabinet	7.48 [190]	33.46 [850]	9.02 [229]
Wide Battery Cabinet without Batteries	13.74 [349]	39.37 [1000]	15.75 [400]
Narrow Battery Cabinet without Batteries	7.24 [184]	39.37 [1000]	15.75 [400]

THIS DRAWING AND SPECIFICATIONS HEREIN ARE THE PROPERTY OF SCHNEIDER ELECTRIC AND SHALL NOT BE COPIED, REPRODUCED OR USED IN WHOLE OR IN PART, AS THE BASIS FOR THE MANUFACTURE OR SALE OF ITEMS WITHOUT WRITTEN PERMISSION FROM SCHNEIDER ELECTRIC. THIS DRAWING IS BASED UPON LATEST AVAILABLE INFORMATION AND IS SUBJECT TO CHANGE WITHOUT NOTICE.



TITLE: Galaxy VM
 Input: 480V AC 3PH DUAL/SINGLE MAINS
 Output: 480V AC 3PH 180kVA
 3+1 MODULE UPS WITH MODULAR BATTERY CABINETS
 SOLUTION-GENERAL ARRANGEMENT
 PROJECT: DRAWINGS SHEET 2 OF 5

DWG NO: GVM180KGMODBC9R4 REV: 0
 DRAWN BY: C KRISHNA 08-JUN-16 THIRD
 ENGINEER: C ANDERSEN/Z WILLIAM 08-JUN-16 ANGLE
 APPROVED BY: M DESHPANDE 08-JUN-16 PROJECTION

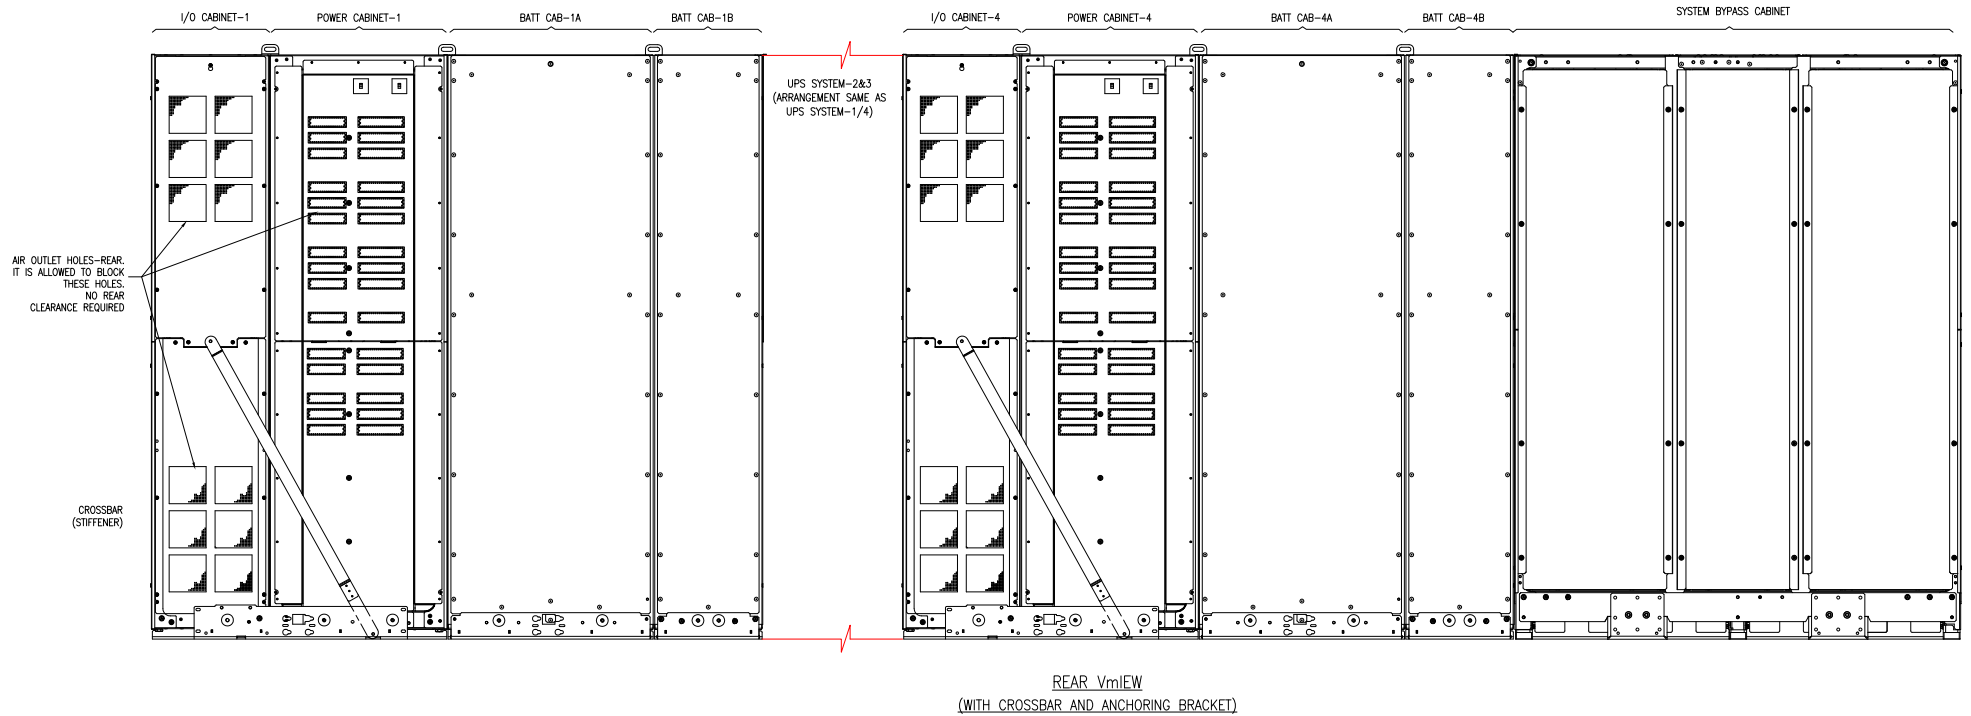

NOTES:

1. INSTALLATION SHALL COMPLY WITH ALL APPLICABLE NATIONAL, STATE AND LOCAL CODES.
2. REFER TO PRODUCT DOCUMENTATION FOR ADDITIONAL DETAILS PRIOR TO INSTALLATION AND SITE PREPARATION WORK.
3. ALL DIMENSIONS ARE IN INCHES [MILLIMETERS].

THIS DRAWING AND SPECIFICATIONS HEREIN ARE THE PROPERTY OF SCHNEIDER ELECTRIC AND SHALL NOT BE COPIED, REPRODUCED OR USED IN WHOLE OR IN PART, AS THE BASIS FOR THE MANUFACTURE OR SALE OF ITEMS WITHOUT WRITTEN PERMISSION FROM SCHNEIDER ELECTRIC. THIS DRAWING IS BASED UPON LATEST AVAILABLE INFORMATION AND IS SUBJECT TO CHANGE WITHOUT NOTICE.



TITLE: Galaxy VM
 Input: 480V AC 3PH DUAL/SINGLE MAINS
 Output: 480V AC 3PH 180KVA
 3+1 MODULE UPS WITH MODULAR BATTERY CABINETS
 SOLUTION-REAR VIEW


DWG NO: GVM180KGMODBC9R4 REV. 0

DRAWN BY: C KRISHNA 08-JUN-16 THIRD

ENGINEER: C ANDERSEN/Z WILLIAM 08-JUN-16 ANGLE

PROJECT: DRAWINGS SHEET 3 OF 5

APPROVED BY: M DESHPANDE 08-JUN-16 PROJECTION

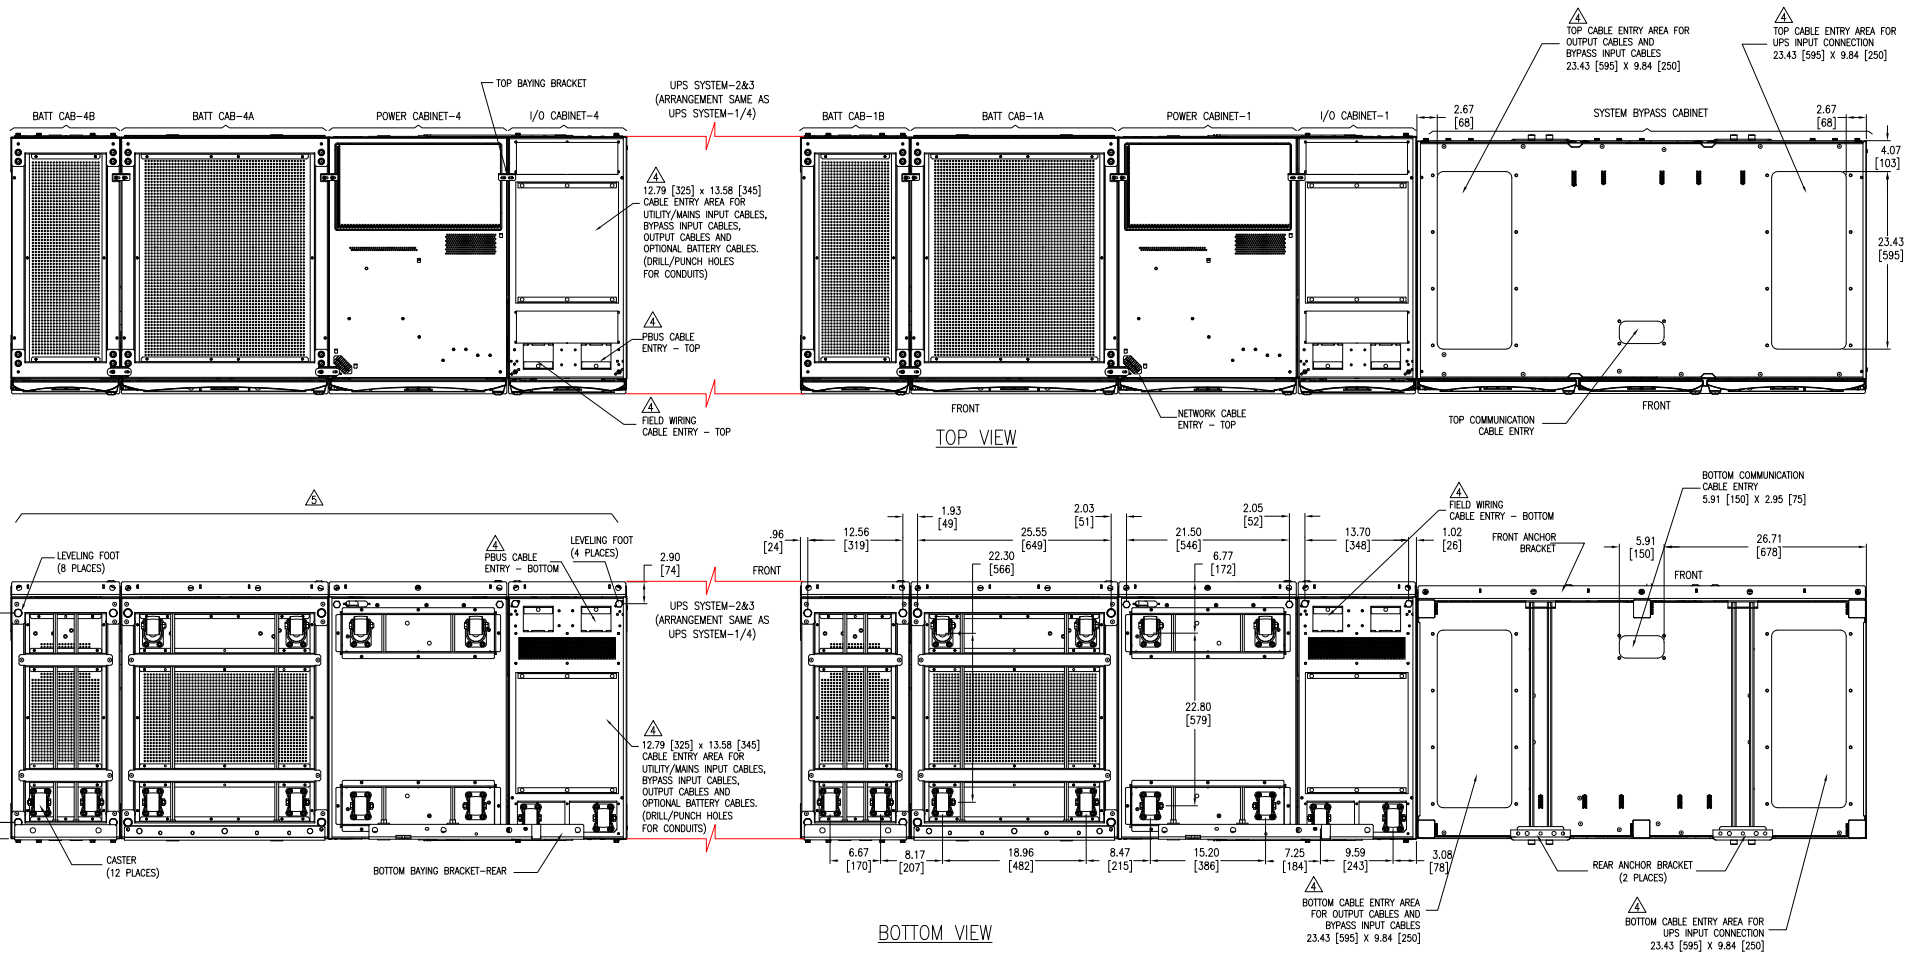

NOTES:

1. INSTALLATION SHALL COMPLY WITH ALL APPLICABLE NATIONAL, STATE AND LOCAL CODES.
2. REFER TO PRODUCT DOCUMENTATION FOR ADDITIONAL DETAILS PRIOR TO INSTALLATION AND SITE PREPARATION WORK.
3. ALL DIMENSIONS ARE IN INCHES [MILLIMETERS].
- △ 4. DRILL/PUNCH HOLES IN PLATE. REMOVE PLATE FROM CABINET BEFORE DRILLING/PUNCHING.
- △ 5. BOTTOM VIEW DIMENSIONS FOR CABINETS WITH SUFFIX "4", "4x" ARE SAME AS CABINETS WITH SUFFIX "1", "1x".

THIS DRAWING AND SPECIFICATIONS HEREIN ARE THE PROPERTY OF SCHNEIDER ELECTRIC AND SHALL NOT BE COPIED, REPRODUCED OR USED IN WHOLE OR IN PART, AS THE BASIS FOR THE MANUFACTURE OR SALE OF ITEMS WITHOUT WRITTEN PERMISSION FROM SCHNEIDER ELECTRIC. THIS DRAWING IS BASED UPON LATEST AVAILABLE INFORMATION AND IS SUBJECT TO CHANGE WITHOUT NOTICE.



TITLE: Galaxy VM
 Input: 480V AC 3PH DUAL/SINGLE MAINS
 Output: 480V AC 3PH 180kVA
 3+1 MODULE UPS WITH MODULAR BATTERY CABINETS
 SOLUTION-TOP AND BOTTOM VIEWS


PROJECT: DRAWINGS **SHEET:** 4 OF 5

DWG NO: GVM180KGMODBC9R4 **REV.:** 0

DRAWN BY: C KRISHNA 08-JUN-16 **THIRD**

ENGINEER: C ANDERSEN/Z WILLIAM 08-JUN-16 **ANGLE**

APPROVED BY: M DESHPANDE 08-JUN-16 **PROJECTION**

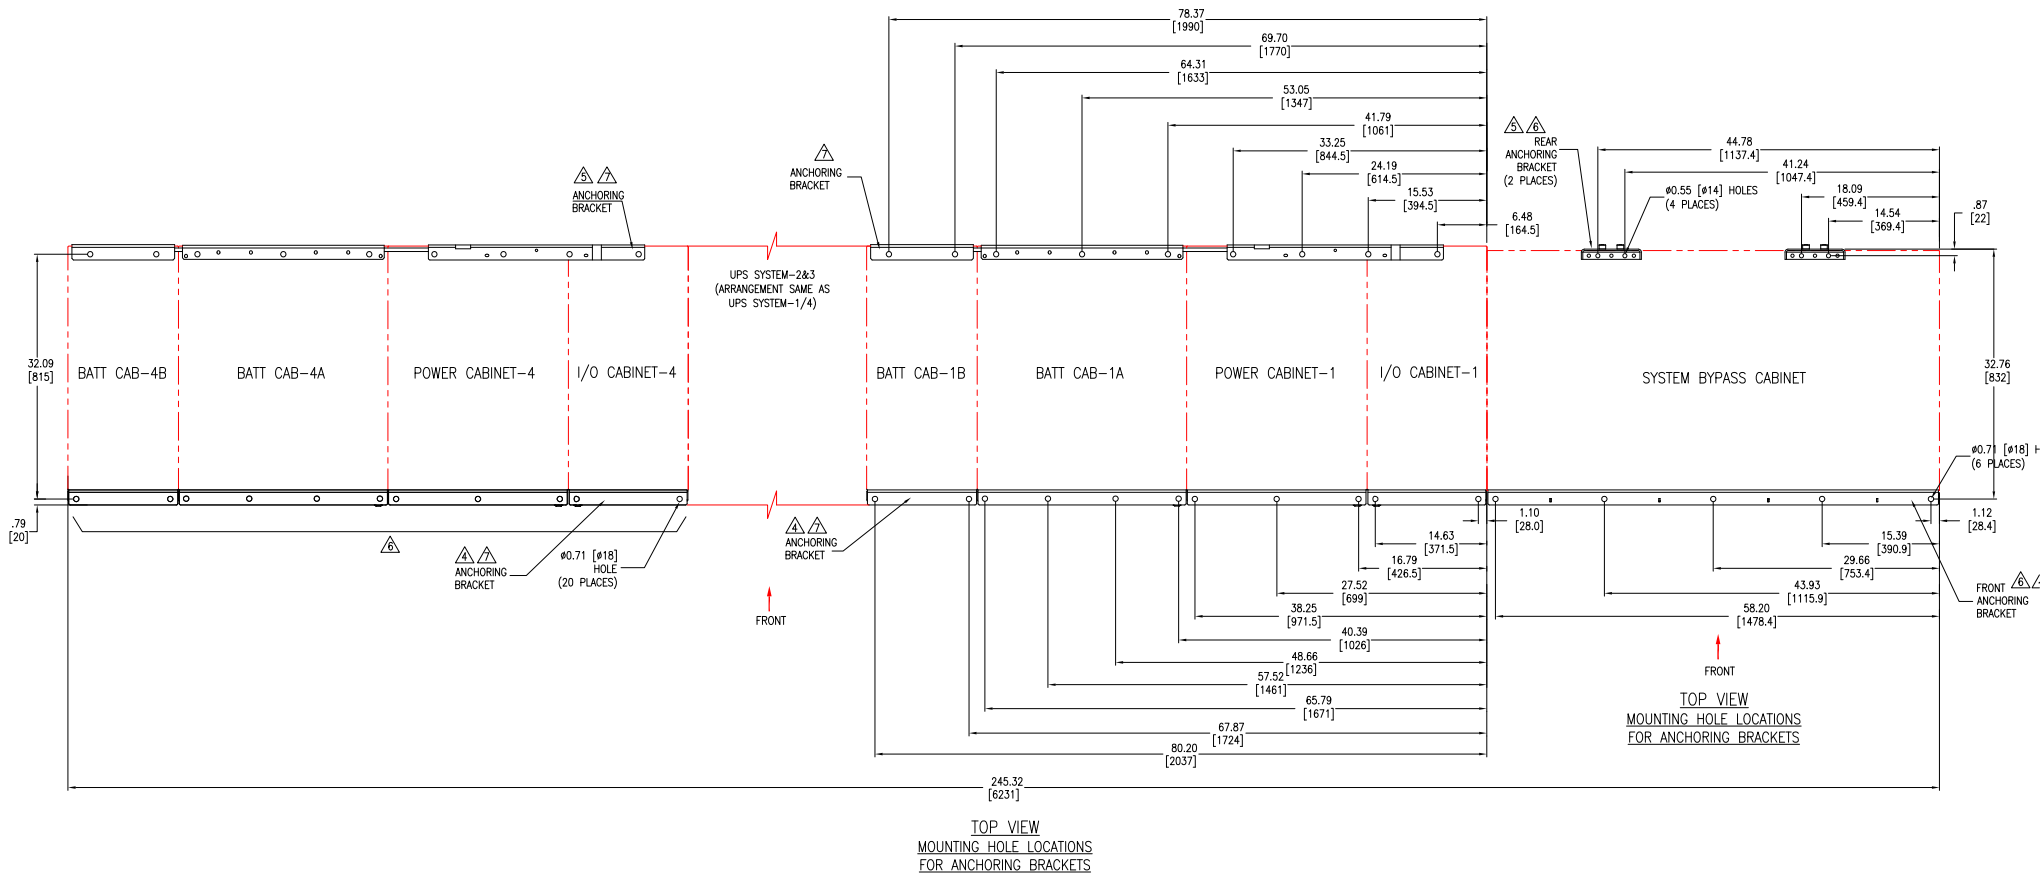

NOTES:

1. INSTALLATION SHALL COMPLY WITH ALL APPLICABLE NATIONAL, STATE AND LOCAL CODES.
2. REFER TO PRODUCT DOCUMENTATION FOR ADDITIONAL DETAILS PRIOR TO INSTALLATION AND SITE PREPARATION WORK.
3. ALL DIMENSIONS ARE IN INCHES [MILLIMETERS].
4. FIXATION OF ANCHORING BRACKETS IN FRONT IS OPTIONAL IN NON-SEISMIC LOCATIONS. FOR SEISMIC COMPLIANCE, USE CODE COMPLIANT FASTENERS TO SECURE UNIT TO THE FLOOR. FLOOR ANCHORING BOLTS ARE NOT SUPPLIED.
5. USE THE BAYING BRACKET THAT WAS ATTACHED TO THE REAR PALLET OF I/O CABINET FOR ANCHORING THE UNIT. REAR BAYING BRACKET MUST BE BOLTED TO THE FLOOR. USE CODE COMPLIANT FASTENERS.
6. ANCHORING DIMENSIONS FOR CABINETS WITH SUFFIX "4", "4x" ARE SAME AS CABINETS WITH SUFFIX "1", "1x".
7. IN AREAS WHERE SEISMIC PROTECTION IS REQUIRED, FOLLOW THE INSTRUCTIONS IN "GVMANCHORING-SA" DRAWING. FLOOR ANCHORING BOLTS ARE NOT SUPPLIED.
8. FOR INSTALLATION ON RAISED FLOOR FOLLOW THE INSTRUCTIONS IN "GVMANCHORING-RF" DRAWING. FLOOR ANCHORING BOLTS ARE NOT SUPPLIED.

THIS DRAWING AND SPECIFICATIONS HEREIN ARE THE PROPERTY OF SCHNEIDER ELECTRIC AND SHALL NOT BE COPIED, REPRODUCED OR USED IN WHOLE OR IN PART, AS THE BASIS FOR THE MANUFACTURE OR SALE OF ITEMS WITHOUT WRITTEN PERMISSION FROM SCHNEIDER ELECTRIC. THIS DRAWING IS BASED UPON LATEST AVAILABLE INFORMATION AND IS SUBJECT TO CHANGE WITHOUT NOTICE.



TITLE: Galaxy VM
 Input: 480V AC 3PH DUAL/SINGLE MAINS
 Output: 480V AC 3PH 180KVA
 3+1 MODULE UPS WITH MODULAR BATTERY CABINETS
 SOLUTION-ANCHORING DETAILS
 PROJECT: DRAWINGS SHEET 5 OF 5

DWG NO:	GVM180KGMODBC9R4	REV:	0
DRAWN BY:	C KRISHNA	08-JUN-16	THIRD
ENGINEER:	C ANDERSEN/Z WILLIAM	08-JUN-16	ANGLE
APPROVED BY:	M DESHPANDE	08-JUN-16	PROJECTION