

NOTES:

1. INSTALLATION SHALL COMPLY WITH ALL APPLICABLE NATIONAL, STATE AND LOCAL CODES.
2. REFER TO PRODUCT DOCUMENTATION FOR ADDITIONAL DETAILS PRIOR TO INSTALLATION AND SITE PREPARATION WORK.
3. ALL DIMENSIONS ARE IN INCHES [MILLIMETERS].
- △4. ONLY FRONT ACCESS REQUIRED FOR SERVICE. MINIMUM RECOMMENDED FRONT CLEARANCE IS 36.0 [914].
5. CABLE ENTRY IS FROM TOP OR BOTTOM OF THE UNIT.
- △6. FOR WEIGHT AND CENTER OF GRAVITY DETAILS REFERS TO TABLE-1. THIS INFORMATION PROVIDES APPROXIMATE CENTER OF GRAVITY CALCULATION.
7. OPERATING TEMPERATURE: 32°F TO 104°F [0°C TO 40°C]. RECOMMENDED TEMPERATURE AT 77°F[25°C].
8. DOOR OPENS 110°.
9. COLOR: RAL 9003, GLOSS LEVEL 85%.
- △10. ALL CABINETS SHIPPED WITH SIDE PANELS.
11. REMOVABLE COVER PLATE USED FOR ADJACENT CABLE CONNECTIONS TO UPS CABINET.

△6 TABLE-1

Seismic Unit - CENTER OF GRAVITY AND WEIGHT DETAILS				
SKU	Center of Gravity in Inches [mm]			Weight lbs [kg]
	X-Distance	Y-Distance	Z-Distance	
GVSCBT2	11.3 [288]	28.6 [726]	15.5 [394]	1457 [662]
GVSCBT3	11.0 [280]	29.1 [739]	16.7 [424]	2120 [964]

THIS DRAWING AND SPECIFICATIONS HEREIN ARE THE PROPERTY OF SCHNEIDER ELECTRIC AND SHALL NOT BE COPIED, REPRODUCED OR USED IN WHOLE OR IN PART, AS THE BASIS FOR THE MANUFACTURE OR SALE OF ITEMS WITHOUT WRITTEN PERMISSION FROM SCHNEIDER ELECTRIC. THIS DRAWING IS BASED UPON LATEST AVAILABLE INFORMATION AND IS SUBJECT TO CHANGE WITHOUT NOTICE.



TITLE: GALAXY VS BATTERY CABINET UL TYPE-2 & 3
 Input: 480Vdc, 3PH, 60Hz
 Output: 480Vdc, 3PH, 60Hz
 GENERAL ARRANGEMENT

DWG NO: GVSCBT2-3 REV. 1


DRAWN BY: JAYAPRAKASH 07-JUN-21 THIRD

ENGINEER: SYED BASHA 07-JUN-21 ANGLE



APPROVED BY: SYED BASHA 07-JUN-21 PROJECTION

PROJECT: SUBMITTAL DRAWING SHEET 1 OF 7

TOP ENTRY CONDUIT LOCATION

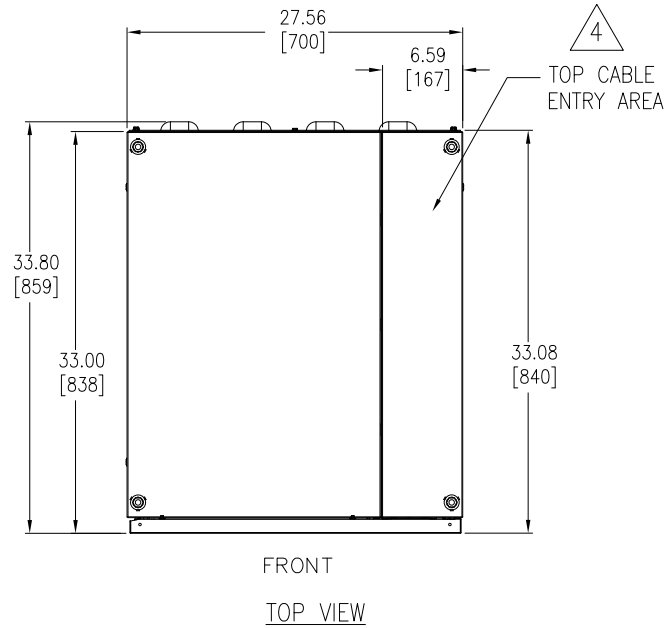

BOTTOM ENTRY CONDUIT LOCATION

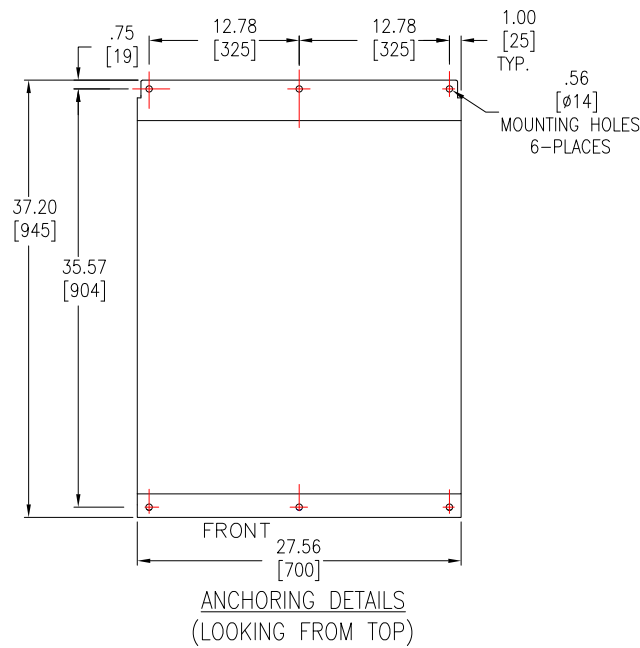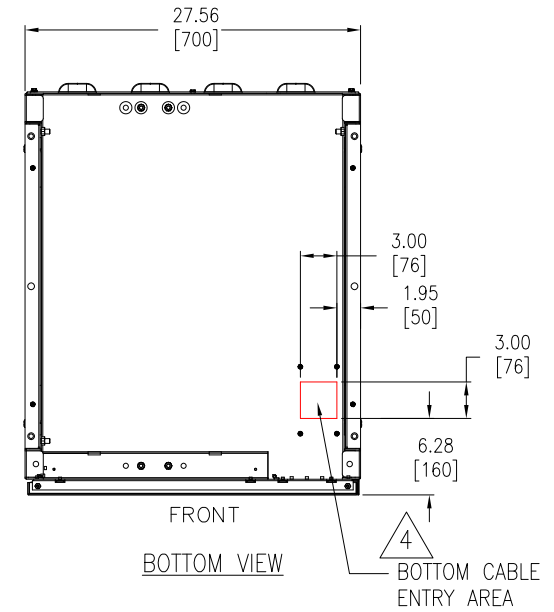

NOTES:

1. INSTALLATION SHALL COMPLY WITH ALL APPLICABLE NATIONAL, STATE AND LOCAL CODES.
2. REFER TO PRODUCT DOCUMENTATION FOR ADDITIONAL DETAILS PRIOR TO INSTALLATION AND SITE PREPARATION WORK.
3. ALL DIMENSIONS ARE IN INCHES [MILLIMETERS].
- △4. DRILL/PUNCH HOLES IN PLATE AS PER REQUIREMENT.
REMOVE PLATE FROM CABINET BEFORE DRILLING/PUNCHING.


THIS DRAWING AND SPECIFICATIONS HEREIN ARE THE PROPERTY OF SCHNEIDER ELECTRIC AND SHALL NOT BE COPIED, REPRODUCED OR USED IN WHOLE OR IN PART, AS THE BASIS FOR THE MANUFACTURE OR SALE OF ITEMS WITHOUT WRITTEN PERMISSION FROM SCHNEIDER ELECTRIC. THIS DRAWING IS BASED UPON LATEST AVAILABLE INFORMATION AND IS SUBJECT TO CHANGE WITHOUT NOTICE.



TITLE: GALAXY VS
BATTERY CABINET UL TYPE-2 & 3
Input: 480Vdc, 3PH, 60Hz
Output: 480Vdc, 3PH, 60Hz
TOP & BOTTOM VIEW, ANCHORING DETAILS
PROJECT: SUBMITTAL DRAWING SHEET 2 OF 7

DWG NO: GVSCBT2-3
DRAWN BY: JAYAPRAKASH 07-JUN-21
ENGINEER: SYED BASHA 07-JUN-21
APPROVED BY: SYED BASHA 07-JUN-21

REV. 1
THIRD ANGLE PROJECTION


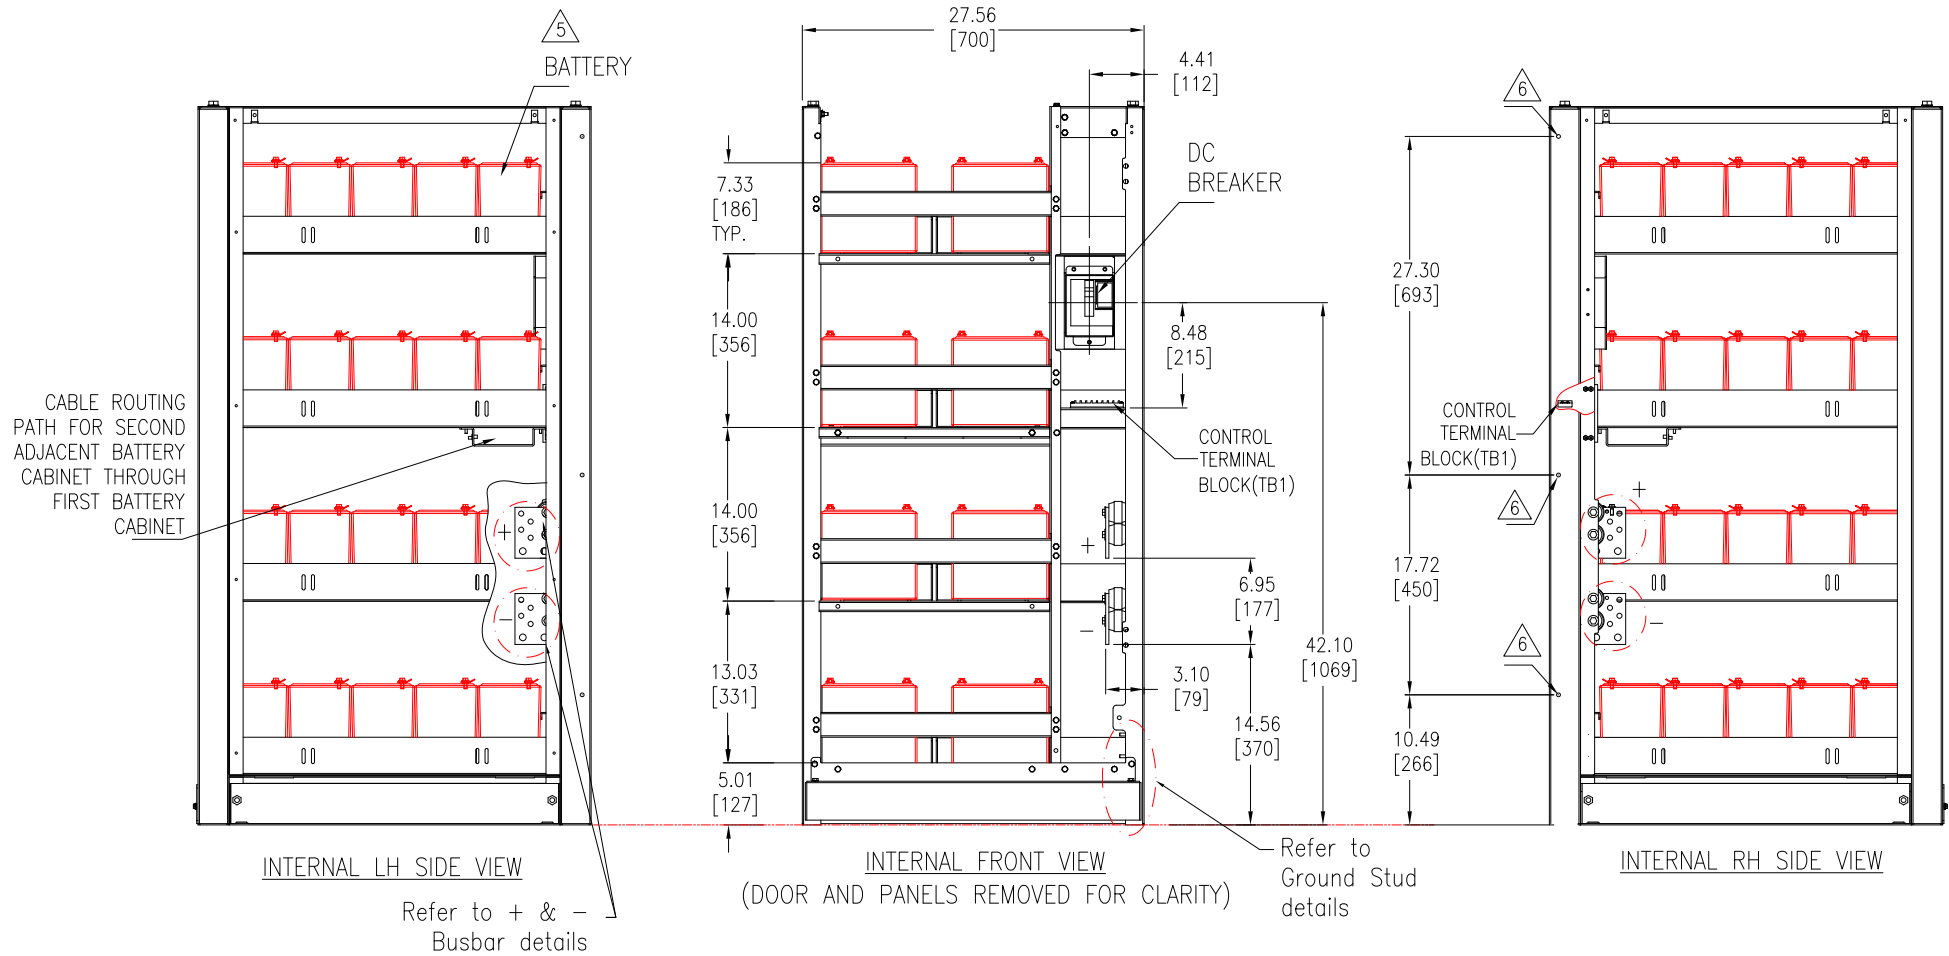


TORQUE SPECIFICATIONS

M6	5.0Nm (3.60lb-ft)
M8	17.5Nm (12.91lb-ft)
M10	30.0Nm (22.0lb-ft)
M12	50.0Nm (36.87lb-ft)

NOTES:

1. INSTALLATION SHALL COMPLY WITH ALL APPLICABLE NATIONAL, STATE AND LOCAL CODES.
2. REFER TO PRODUCT DOCUMENTATION FOR ADDITIONAL DETAILS PRIOR TO INSTALLATION AND SITE PREPARATION WORK.
3. ALL DIMENSIONS ARE IN INCHES [MILLIMETERS].
4. FOR BATTERY INTERFACE DETAILS REFER TO UPS INSTALLATION MANUAL.
- △5. BATTERY ARRANGEMENT SHOWN ABOVE IS TYPICAL.
- △6. FOR ADJACENT BATTERY CABINET FRAME CONNECTION TO UPS: REMOVE LEFT SIDE PANEL AND PLATE FROM UPS. REMOVE KNOCKOUTS (THREE PLACES) ON RIGHT FRONT SIDE OF BATTERY CABINET FRAME. PLACE BATTERY CABINET NEXT TO UPS. LINE UP HOLES AND SECURE WITH M6 HARDWARE INCLUDED WITH BATTERY CABINET.

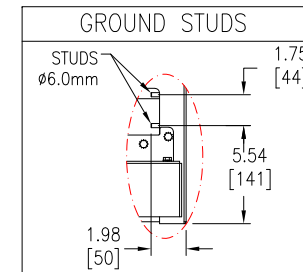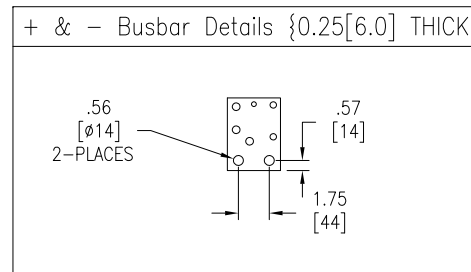

THIS DRAWING AND SPECIFICATIONS HEREIN ARE THE PROPERTY OF SCHNEIDER ELECTRIC AND SHALL NOT BE COPIED, REPRODUCED OR USED IN WHOLE OR IN PART, AS THE BASIS FOR THE MANUFACTURE OR SALE OF ITEMS WITHOUT WRITTEN PERMISSION FROM SCHNEIDER ELECTRIC. THIS DRAWING IS BASED UPON LATEST AVAILABLE INFORMATION AND IS SUBJECT TO CHANGE WITHOUT NOTICE.




TITLE: GALAXY VS BATTERY CABINET UL TYPE-2 & 3
 Input: 480Vdc, 3PH, 60Hz
 Output: 480Vac, 3PH, 60Hz
 INTERNAL VIEW


PROJECT: SUBMITTAL DRAWING **SHEET 3 OF 7**

DWG NO: GVSCBT2-3 **REV.** 1

DRAWN BY: JAYAPRAKASH	28-MAR-19	THIRD
ENGINEER: IRENE KENNEDY/J SMITH	28-MAR-19	ANGLE
APPROVED BY: IRENE KENNEDY	28-MAR-19	PROJECTION

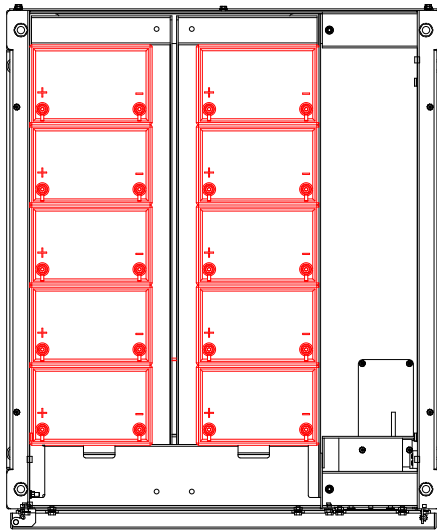

SECTIONAL VIEW A-A
TOP VIEW
(BATTERY SHOWN FOR REFERENCE)

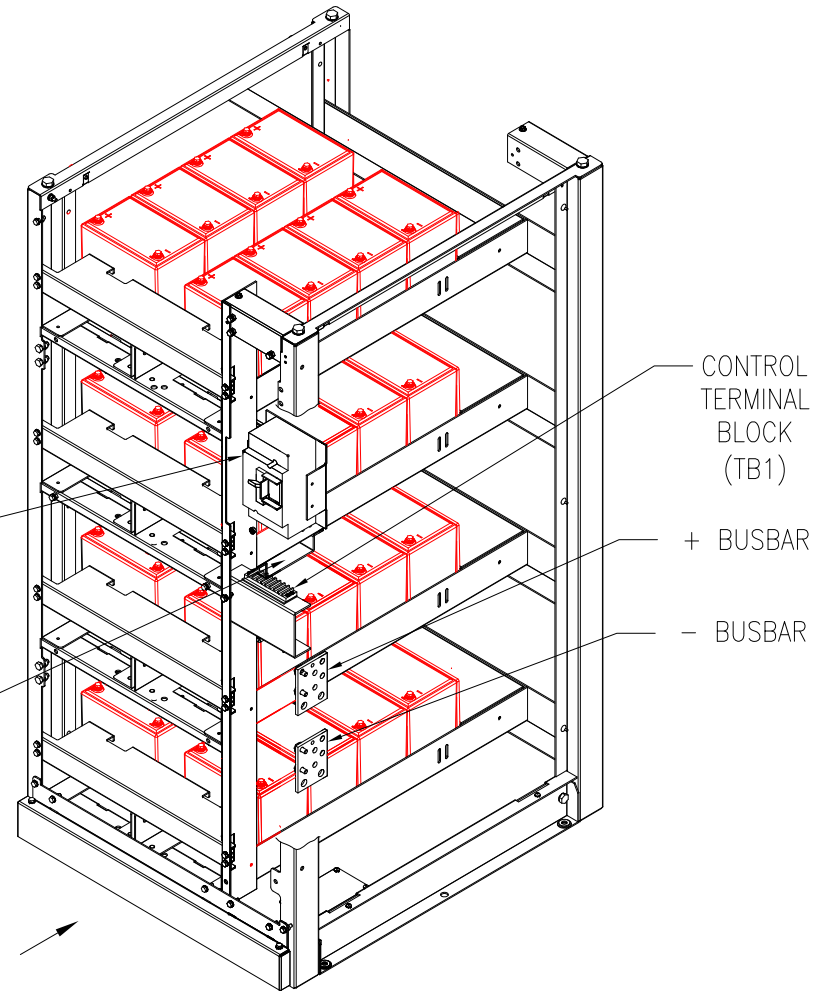

DC BREAKER
150A

△4
TEMPERATURE
SENSOR
(ROUTE FROM
UPS CABINET FOR
ADJACENT BATTERY
CABINET)

CONTROL
TERMINAL
BLOCK
(TB1)

+ BUSBAR

- BUSBAR

FRONT

INTERNAL ISOMETRIC VIEW
(FRAME CUT AND SHOWN FOR CONVENIENCE)

NOTES:

1. INSTALLATION SHALL COMPLY WITH ALL APPLICABLE NATIONAL, STATE AND LOCAL CODES.
2. REFER TO PRODUCT DOCUMENTATION FOR ADDITIONAL DETAILS PRIOR TO INSTALLATION AND SITE PREPARATION WORK.
3. FOR CONNECTION DETAILS REFER TO UPS INSTALLATION MANUAL.
- △4. THE TEMPERATURE SENSOR IS SUPPLIED IN THE UPS CABINET.
FOR ADJACENT BATTERY CABINET, CONNECT IN THE UPS, ROUTE AND MOUNT SENSOR WHERE SHOWN IN THE BATTERY CABINET.
FOR REMOTE BATTERY CABINET, CONNECT TO TERMINAL BLOCK IN BATTERY CABINET. CONNECTION FROM BATTERY TO UPS NOT PROVIDED.
REFER TO SHEET-6 FOR CONNECTION DETAILS.
5. REMOVABLE PAD-LOCK PROVIDED FOR DC BREAKER.

THIS DRAWING AND SPECIFICATIONS HEREIN ARE THE PROPERTY OF SCHNEIDER ELECTRIC AND SHALL NOT BE COPIED, REPRODUCED OR USED IN WHOLE OR IN PART, AS THE BASIS FOR THE MANUFACTURE OR SALE OF ITEMS WITHOUT WRITTEN PERMISSION FROM SCHNEIDER ELECTRIC. THIS DRAWING IS BASED UPON LATEST AVAILABLE INFORMATION AND IS SUBJECT TO CHANGE WITHOUT NOTICE.

Schneider
Electric

TITLE: GALAXY VS
BATTERY CABINET UL TYPE-2 & 3
Input: 480Vdc, 3PH, 60Hz
Output: 480Vdc, 3PH, 60Hz
INTERNAL DETAILS

PROJECT: SUBMITTAL DRAWING SHEET 4 OF 7

DWG NO:	GVSCBT2-3	REV.	0
DRAWN BY:	K.NAGENDRA	10-JAN-19	THIRD
ENGINEER:	IRENE KENNEDY/J SMITH	10-JAN-19	ANGLE
APPROVED BY:	IRENE KENNEDY	10-JAN-19	PROJECTION

BATTERY RUNTIMES (minutes) at Full Load (calculated)				Classic Battery Cabinets											
				1x GVSCBT2			1x GVSCBT3			2x GVSCBT2			2x GVSCBT3		
				28" / 700mm Wide			28" / 700mm Wide			2x 28" / 700mm Wide			2x 28" / 700mm Wide		
				40 Batteries (Leoch:XP12-150FR)			40 Batteries (Leoch:XP12-240FR)			40 Batteries (Leoch:XP12-150FR)			40 Batteries (Leoch:XP12-240FR)		
			UPS SKU	PF 0.8	PF 0.9	PF 1	PF 0.8	PF 0.9	PF 1	PF 0.8	PF 0.9	PF 1	PF 0.8	PF 0.9	PF 1
GALAXY VS (1 PM)	480V	20kW	GVSUPS20KGS	40.0	35.0	30.5	68.0	59.5	52.5	92.0	80.5	71.0	150.0	130.0	115.0
		30kW	GVSUPS30KGS	24.5	21.0	18.0	42.0	36.5	32.0	57.5	49.5	44.0	95.5	83.5	74.0
		40kW	GVSUPS40KGS	16.5	14.0	12.0	29.5	25.5	22.5	40.5	35.0	30.5	68.5	59.5	52.5
		50kW	GVSUPS50KGS	12.0	10.5	9.0	22.5	19.5	17.0	30.5	26.5	23.0	52.5	45.5	40.0
GALAXY VS (2 PM)	480V	60kW	GVSUPS60KGS	9.6	8.0	6.7	17.5	15.0	13.0	24.5	21.0	18.0	42.0	36.5	32.0
		80kW	GVSUPS80KGS	N/A	N/A	N/A	N/A	N/A	N/A	16.5	14.0	12.5	29.5	25.5	22.5
		100kW	GVSUPS100KGS	N/A	N/A	N/A	N/A	N/A	N/A	12.5	10.5	8.9	22.5	19.5	16.5
GALAXY VS (1 PM)	208V	10kW	GVSUPS10KFS	91.0	79.5	70.0	150.0	130.0	115.0	200.0	175.0	155.0	330.0	290.0	255.0
		15kW	GVSUPS15KFS	56.5	49.5	43.5	94.5	82.5	73.0	125.0	110.0	99.0	210.0	185.0	160.0
		20kW	GVSUPS20KFS	40.0	34.5	30.5	67.5	59.0	52.0	91.5	80.0	70.5	150.0	130.0	115.0
		25kW	GVSUPS25KFS	30.5	26.0	23.0	52.0	45.0	39.5	70.5	61.0	54.0	115.0	100.0	90.0
GALAXY VS (2 PM)	208V	30kW	GVSUPS30KFS	24.0	20.5	18.0	41.5	36.0	31.5	56.5	49.0	43.5	95.0	82.5	73.0
		40kW	GVSUPS40KFS	16.5	14.0	12.0	29.5	25.5	22.0	40.0	34.5	30.5	67.5	59.0	52.0
		50kW	GVSUPS50KFS	12.0	10.0	8.8	22.0	19.0	16.5	30.5	26.0	23.0	52.0	45.0	39.5

NOTES:

1. INSTALLATION SHALL COMPLY WITH ALL APPLICABLE NATIONAL, STATE AND LOCAL CODES.
2. REFER TO PRODUCT DOCUMENTATION FOR ADDITIONAL DETAILS PRIOR TO INSTALLATION AND SITE PREPARATION WORK.
3. REFER TO BATTERY INSTALLATION MANUAL FOR CABLING DETAILS.


THIS DRAWING AND SPECIFICATIONS HEREIN ARE THE PROPERTY OF SCHNEIDER ELECTRIC AND SHALL NOT BE COPIED, REPRODUCED OR USED IN WHOLE OR IN PART, AS THE BASIS FOR THE MANUFACTURE OR SALE OF ITEMS WITHOUT WRITTEN PERMISSION FROM SCHNEIDER ELECTRIC. THIS DRAWING IS BASED UPON LATEST AVAILABLE INFORMATION AND IS SUBJECT TO CHANGE WITHOUT NOTICE.



TITLE: GALAXY VS
BATTERY CABINET UL TYPE-2 & 3
Input: 480Vdc, 3PH, 60Hz
Output: 480Vdc, 3PH, 60Hz
RUNTIME DATA & SPECIFICATION

DWG NO:	GVSCBT2-3	REV.	2
DRAWN BY:	JAYAPRAKASH	07-JUN-21	ANGLE
ENGINEER:	SYED BASHA	07-JUN-21	PROJECTION
APPROVED BY:	SYED BASHA	07-JUN-21	N.A

TYPICAL CABLING DIAGRAM (ONE CABINET)

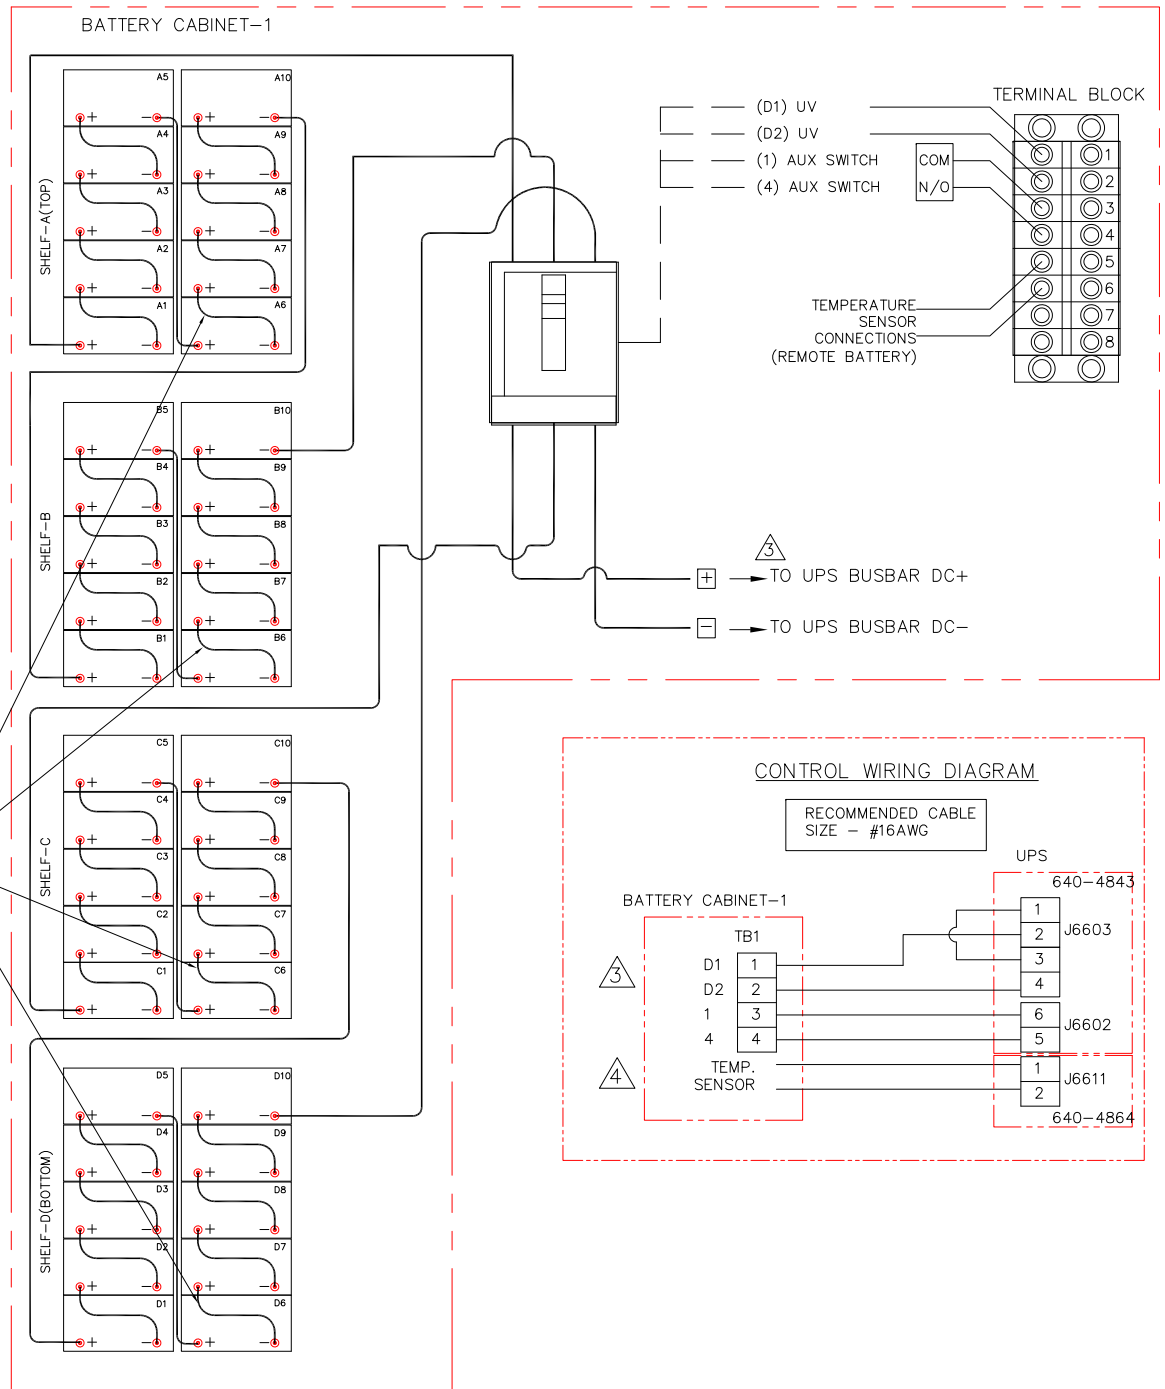

NOTES:

1. INSTALLATION SHALL COMPLY WITH ALL APPLICABLE NATIONAL, STATE AND LOCAL CODES.
 2. REFER TO PRODUCT DOCUMENTATION FOR ADDITIONAL DETAILS PRIOR TO INSTALLATION AND SITE PREPARATION WORK.
 - △ 3. POWER AND CONTROL CABLES ARE PROVIDED. FOR USE ONLY WITH ADJACENT BATTERY CABINET INSTALLATION ON LEFT SIDE OF UPS CABINET.
 - △ 4. TEMPERATURE SENSOR OM-1160 IS SUPPLIED IN THE UPS CABINET.
 - △ 5. STRING DISCONNECT CABLES ARE REMOVED FROM EACH SHELF PRIOR TO SHIPMENT. RE-CONNECT PRIOR TO CABINET INSTALLATION.
- TORQUE CABLES TO BATTERY MANUFACTURER'S SPECIFICATION.

THIS DRAWING AND SPECIFICATIONS HEREIN ARE THE PROPERTY OF SCHNEIDER ELECTRIC AND SHALL NOT BE COPIED, REPRODUCED OR USED IN WHOLE OR IN PART, AS THE BASIS FOR THE MANUFACTURE OR SALE OF ITEMS WITHOUT WRITTEN PERMISSION FROM SCHNEIDER ELECTRIC. THIS DRAWING IS BASED UPON LATEST AVAILABLE INFORMATION AND IS SUBJECT TO CHANGE WITHOUT NOTICE.



TITLE: GALAXY VS BATTERY CABINET UL TYPE-2 & 3
 Input: 480Vdc, 3PH, 60Hz
 Output: 480Vdc, 3PH, 60Hz
 CABLING DETAILS-1

PROJECT: SUBMITTAL DRAWING SHEET 6 OF 7


DWG NO: GVSCBT2-3 REV. 2

DRAWN BY: K.NAGENDRA 30-MAY-19 THIRD

ENGINEER: IRENE KENNEDY/J SMITH 30-MAY-19 ANGLE

APPROVED BY: IRENE KENNEDY 30-MAY-19 PROJECTION

TYPICAL CABLING DIAGRAM (TWO CABINETS)

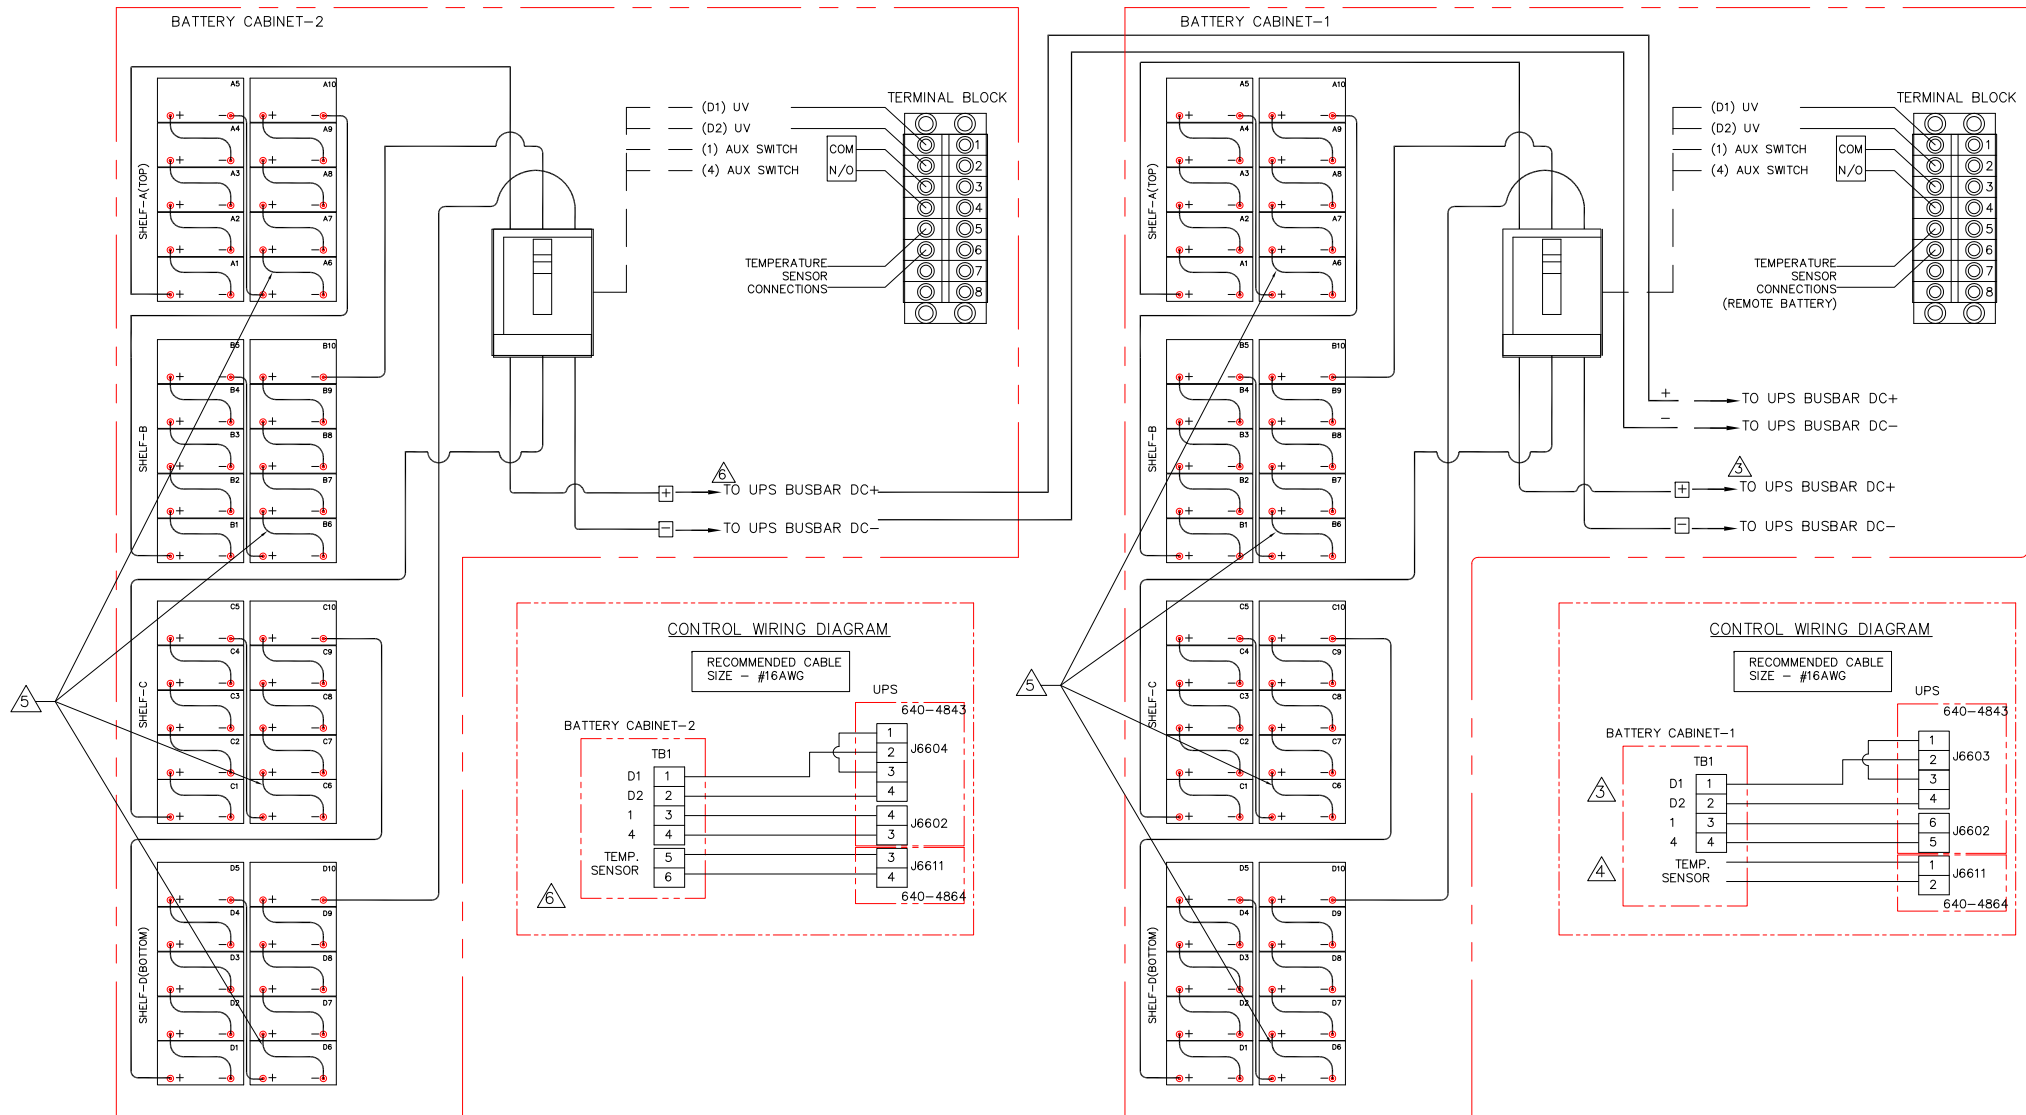

NOTES:

1. INSTALLATION SHALL COMPLY WITH ALL APPLICABLE NATIONAL, STATE AND LOCAL CODES.
2. REFER TO PRODUCT DOCUMENTATION FOR ADDITIONAL DETAILS PRIOR TO INSTALLATION AND SITE PREPARATION WORK.
- △ 3. POWER AND CONTROL CABLES ARE PROVIDED. FOR USE ONLY WITH ADJACENT BATTERY CABINET INSTALLATION ON LEFT SIDE OF UPS CABINET.
- △ 4. TEMPERATURE SENSOR 0M-1160 IS SUPPLIED IN THE UPS CABINET.
- △ 5. STRING DISCONNECT CABLES ARE REMOVED FROM EACH SHELF PRIOR TO SHIPMENT. RE-CONNECT PRIOR TO CABINET INSTALLATION. TORQUE CABLES TO BATTERY MANUFACTURER'S SPECIFICATION.
- △ 6. ADJACENT BATTERY CABINET-2 INSTALLATION REQUIRES OPTIONAL CABLE KIT "GVSOPT011" FOR CONNECTION TO UPS. DISCARD PRE-INSTALLED POWER AND COMMUNICATION CABLES. ADDITIONAL TEMPERATURE SENSOR OJ-0M-1160 REQUIRED.
7. BATTERY CABINET-1 AND BATTERY CABINET-2 EACH CONNECT DIRECTLY TO THE UPS CABINET.
NO DAISY CHAIN CONNECTIONS BETWEEN BATTERY CABINETS.
8. REMOTE BATTERY CABLES PROVIDED BY OTHERS.

THIS DRAWING AND SPECIFICATIONS HEREIN ARE THE PROPERTY OF SCHNEIDER ELECTRIC AND SHALL NOT BE COPIED, REPRODUCED OR USED IN WHOLE OR IN PART, AS THE BASIS FOR THE MANUFACTURE OR SALE OF ITEMS WITHOUT WRITTEN PERMISSION FROM SCHNEIDER ELECTRIC. THIS DRAWING IS BASED UPON LATEST AVAILABLE INFORMATION AND IS SUBJECT TO CHANGE WITHOUT NOTICE.



TITLE: GALAXY VS BATTERY CABINET UL TYPE-2 & 3
Input: 480Vdc, 3PH, 60Hz
Output: 480Vdc, 3PH, 60Hz
CABLING DETAILS-2

PROJECT: SUBMITTAL DRAWING SHEET 7 OF 7

DWG NO:	GVSCBT2-3	REV.	2
DRAWN BY:	K.NAGENDRA	30-MAY-19	THIRD
ENGINEER:	IRENE KENNEDY/J SMITH	30-MAY-19	ANGLE
APPROVED BY:	IRENE KENNEDY	30-MAY-19	PROJECTION