
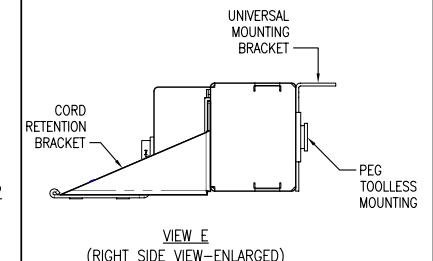



VIEW D
(MOUNTING BRACKET
ENLARGED)



NOTES:


1. INSTALLATION SHALL COMPLY WITH ALL APPLICABLE NATIONAL, STATE AND LOCAL CODES.
2. SEE PRODUCT DOCUMENTATION FOR FURTHER INFORMATION
3. UNLESS OTHERWISE SPECIFIED, ALL DIMENSIONS ARE IN MILLIMETERS [INCHES].
4. UNIVERSAL MOUNTING BRACKET IS AN ALTERNATIVE MOUNTING METHOD TO THE TOOLLESS MOUNT FOR NON SCHNEIDER ELECTRIC RACKS.
5. BRACKET KITS TO MOUNT TO SPECIFIC COMPETITORS RACKS ARE AVAILABLE AS OPTIONS.
6. NET WEIGHT IS 5.57 KG [12.25 LBS].

THIS DRAWING AND SPECIFICATIONS HEREIN ARE THE PROPERTY OF SCHNEIDER ELECTRIC AND SHALL NOT BE COPIED, REPRODUCED OR USED IN WHOLE OR IN PART, AS THE BASIS FOR THE MANUFACTURE OR SALE OF ITEMS WITHOUT WRITTEN PERMISSION FROM SCHNEIDER ELECTRIC. THIS DRAWING IS BASED UPON LATEST AVAILABLE INFORMATION AND IS SUBJECT TO CHANGE WITHOUT NOTICE.

Schneider
Electric

TITLE: RACK PDU, BASIC, ZERO U
INPUT: 200/208VAC, 30A MAX, NEMA L6-30P
OUTPUT: (20) IEC320 C13, (4) IEC320 C19
DOUBLE POLE CIRCUIT BREAKERS
GENERAL MECHANICAL LAYOUT

| | | |
|--------------|---------------------------|--------------|
| DWG NO: | AP7541 | REV. 2 |
| DRAWN BY: | M CRAVEN | 24-AUG-09 |
| ENGINEER: | T HORSTMANN/Y JIANG | 24-AUG-09 |
| PROJECT: | STD SUBMITTAL DRAWINGS | SHEET 1 OF 2 |
| APPROVED BY: | B SHERIDAN/F DIOGA/S WAGH | 25-AUG-09 |

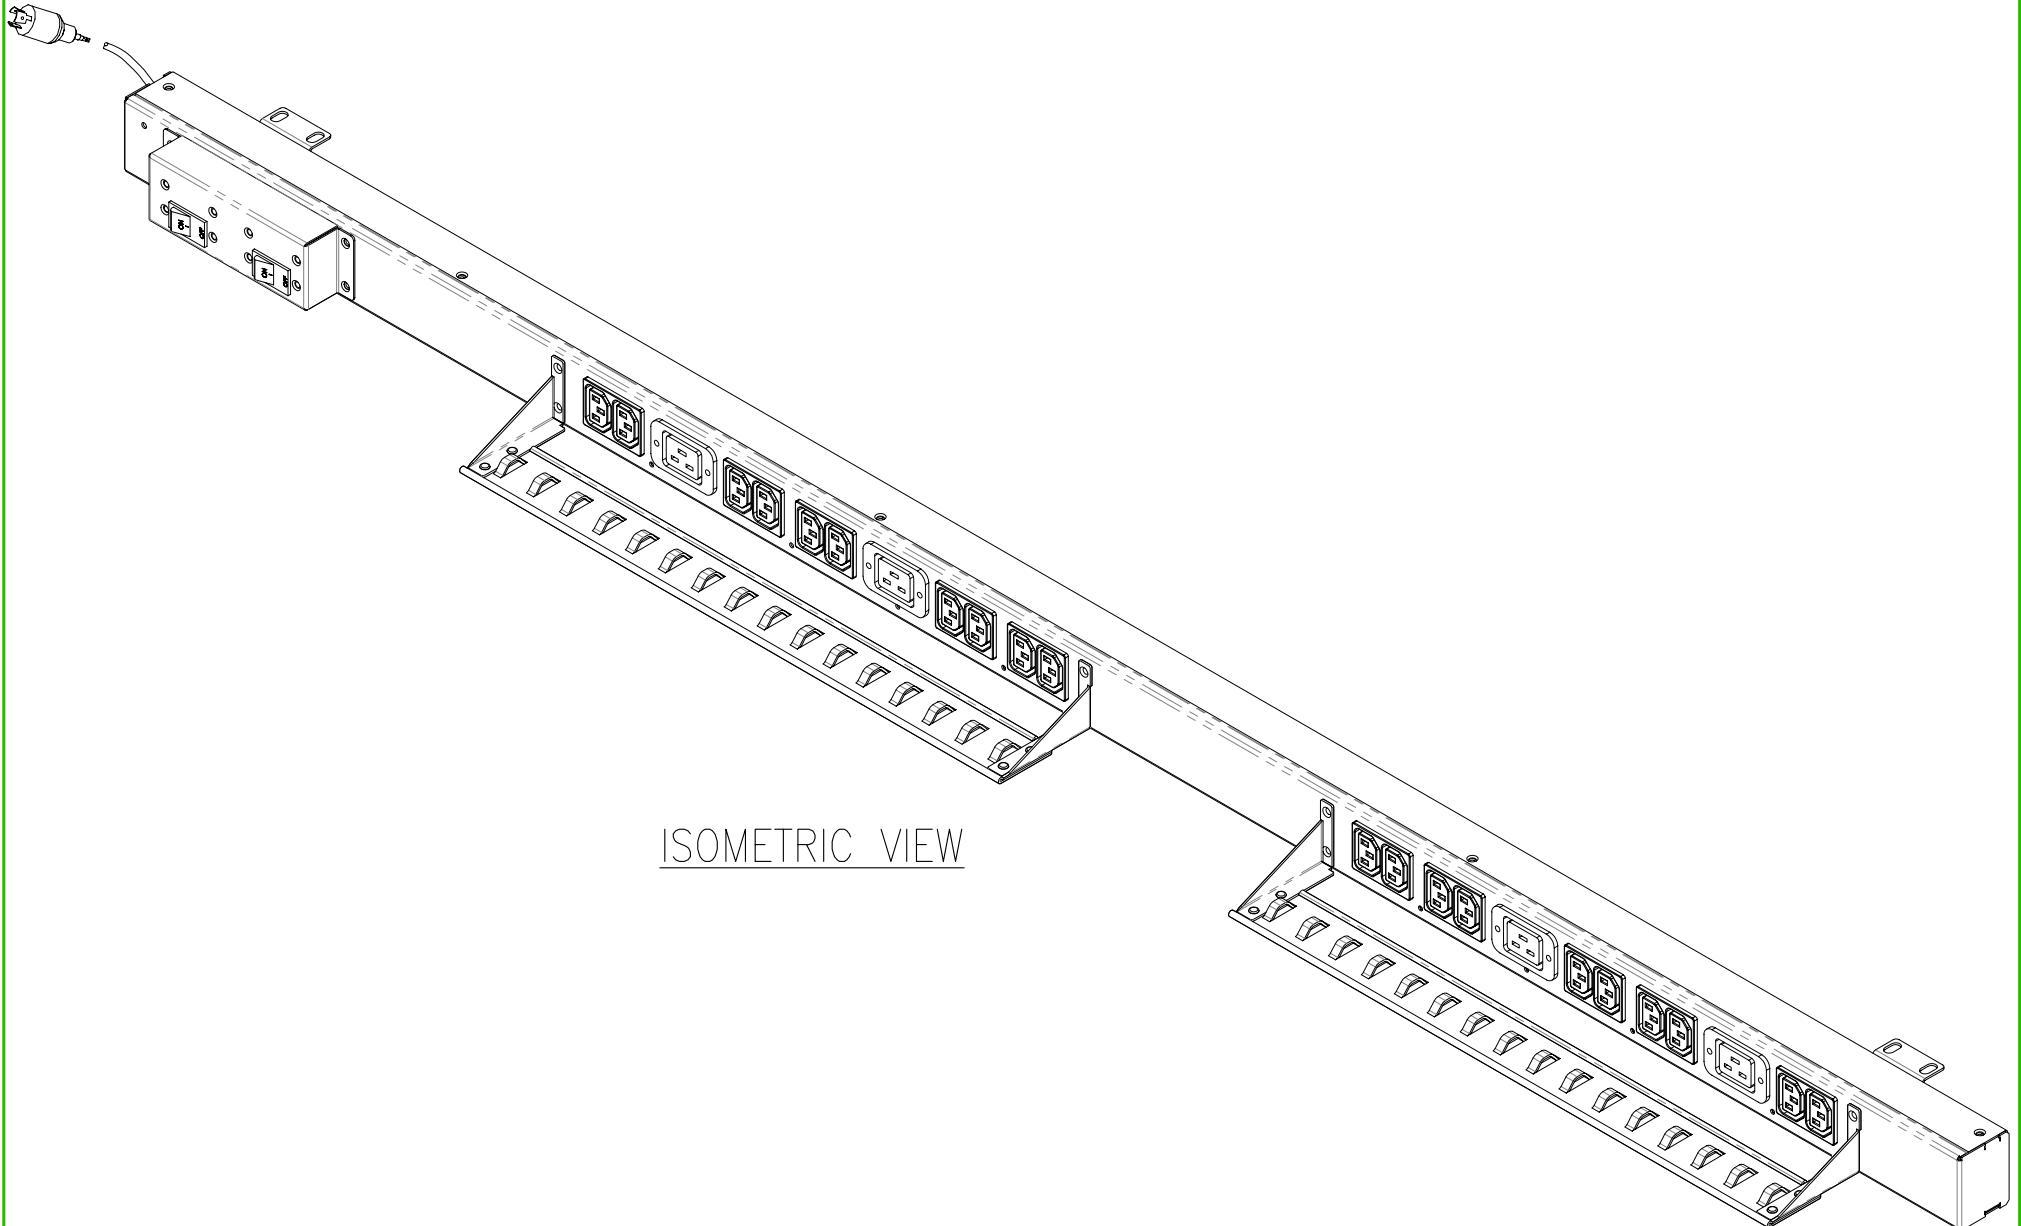

NOTES:

1. SEE SHEET 1

THIS DRAWING AND SPECIFICATIONS HEREIN ARE THE PROPERTY OF SCHNEIDER ELECTRIC AND SHALL NOT BE COPIED, REPRODUCED OR USED IN WHOLE OR IN PART, AS THE BASIS FOR THE MANUFACTURE OR SALE OF ITEMS WITHOUT WRITTEN PERMISSION FROM SCHNEIDER ELECTRIC. THIS DRAWING IS BASED UPON LATEST AVAILABLE INFORMATION AND IS SUBJECT TO CHANGE WITHOUT NOTICE.



TITLE: RACK PDU, BASIC, ZERO U
INPUT: 200/208VAC, 30A MAX, NEMA L6-30P
OUTPUT: (20) IEC320 C13, (4) IEC320 C19
DOUBLE POLE CIRCUIT BREAKERS
ISOMETRIC VIEW

PROJECT: STD SUBMITTAL DRAWINGS

| DWG NO: | AP7541 | REV. 2 |
|--------------|---------------------------|-----------|
| DRAWN BY: | M CRAVEN | 24-AUG-09 |
| ENGINEER: | T HORSTMANN/Y JIANG | 24-AUG-09 |
| APPROVED BY: | B SHERIDAN/F DIOGA/S WAGH | 25-AUG-09 |