


## NOTES:


- 1. INSTALLATION SHALL COMPLY WITH ALL APPLICABLE NATIONAL, STATE AND LOCAL CODES.
- 2. PLEASE REFER TO PRODUCT DOCUMENTATION FOR FURTHER INFORMATION.
- 3. ALL DIMENSIONS ARE IN INCHES [MILLIMETERS].
- 4. WEIGHT OF UNIT IS 0.70 LBS [0.32 KG].





TITLE:		DWG NO:
CABLE FALL (RADIUS FOR NETSHELTER RA	$\overline{}$	
ENCLOSURES AND CABLE LADDERS (QTY. 2)		DRAWN BY:
MAIN MECHANICA	ENGINEER: P FIS	
PROJECT: STD SUBMITTAL DRAWINGS	SHEET 1 OF 2	APPROVED BY:

	DWG NO: AR8654		
2)		UNHA 28-FEB-13	THIR
-/	ENGINEER: P FISCHER/J KU	UMMER 28-FEB-13	ANGL
2	APPROVED BY: S VO	OCCIO 28-FEB-13	PRC

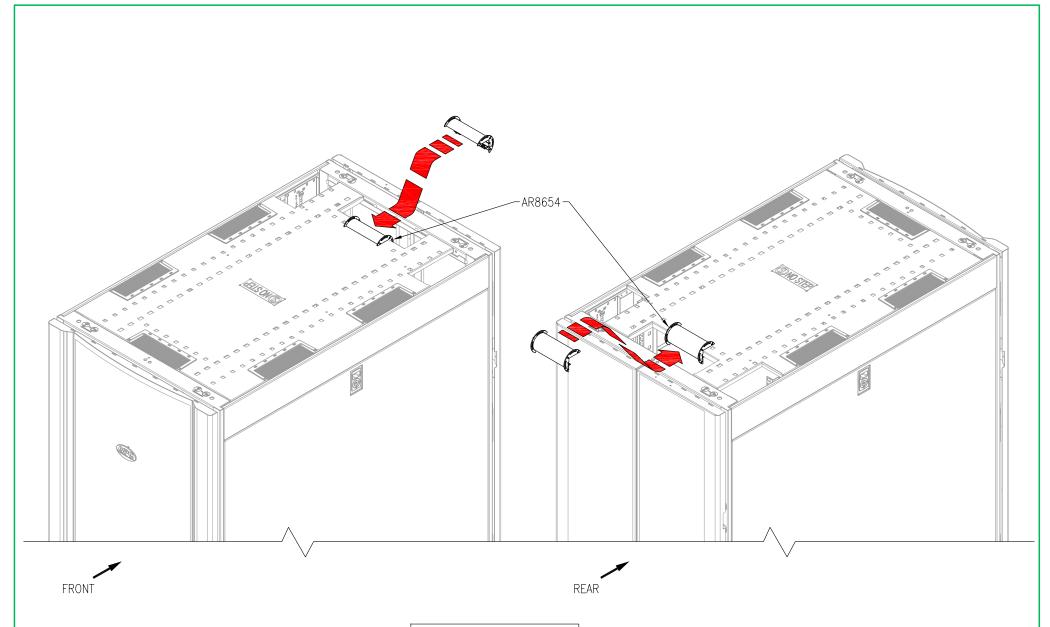

AR3100 NETSHELTER SHOWN

## NOTES

- 1. INSTALLATION SHALL COMPLY WITH ALL APPLICABLE NATIONAL, STATE AND LOCAL CODES.
- 2. PLEASE REFER TO PRODUCT DOCUMENTATION FOR FURTHER INFORMATION.

THIS DRAWING AND SPECIFICATIONS HEREIN ARE THE PROPERTY OF SCHNEIDER ELECTRIC AND SHALL NOT BE COPIED, REPRODUCED OR USED IN WHOLE OR IN PART, AS THE BASIS FOR THE MANUFACTURE OR SALE OF ITEMS WITHOUT WRITTEN PERMISSION FROM SCHNEIDER ELECTRIC. THIS DRAWING IS BASED UPON LATEST AVAILABLE INFORMATION AND IS SUBJECT TO CHANGE WITHOUT NOTICE.



r	TITLE:  CABLE FALL (RADIUS DROP) FOR NETSHELTER RACKS, ENCLOSURES AND CABLE LADDERS (QTY. 2) MOUNTING DETAIL		DWG NO:	A
			DRAWN BY:	
			ENGINEER:	P FISC
	PROJECT: STD SUBMITTAL DRAWINGS	SHEET 2 OF 2	APPROVED	BY:

	DWG NO: AR86	354	REV.
2)	DRAWN BY: S CUNHA	28-FEB-13	THIRD
-,	ENGINEER: P FISCHER/J KUMMER	28-FEB-13	ANGLE
2	APPROVED BY: S VOCCIO	28-FEB-13	PROJ