



DETAIL B IEC 309 16A 3P+N+PE VDE, IEC 309 20A 3P+N+PE UL PLUG-ENLARGED



DETAIL-B

NOTES:

- 1. INSTALLATION SHALL COMPLY WITH ALL APPLICABLE NATIONAL, STATE AND LOCAL CODES.
- 2. SEE PRODUCT DOCUMENTATION FOR FURTHER INFORMATION
- 3. UNLESS OTHERWISE SPECIFIED, ALL DIMENSIONS ARE IN INCHES[MILLIMETERS].
- 4. NET WEIGHT OF UNIT IS 15.40LBS [6.98kG].
- 5. LENGTH OF THE CORD IS 72IN [1830MM].
- 6. UNIVERSAL MOUNTING BRACKET IS AN ALTERNATIVE MOUNTING METHOD TO THE TOOLLESS MOUNT FOR 3RD PARTY ENCLOSURES. BRACKET IS PROVIDED WITH THE UNIT. DETAILED INSTALLATION INSTRUCTIONS CAN BE FOUND IN THE PROVIDED MANUAL
- 7. BRACKET KITS TO MOUNT TO SPECIFIC 3RD PARTY ENCLOSURES ARE AVAILABLE AS OPTIONS.
- △8. REFER TO WARNING LABEL ON REAR OF UNIT FOR SCREW MOUNTING.

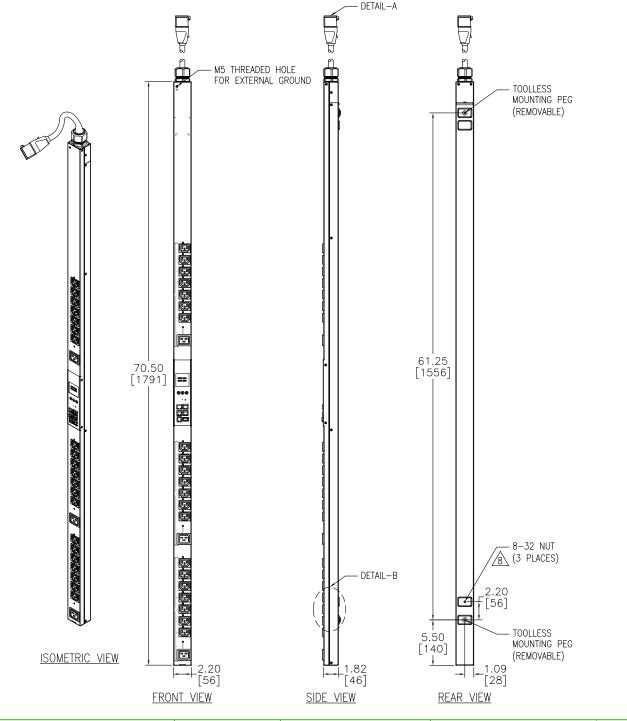


THIS DRAWING AND SPECIFICATIONS HEREIN ARE THE PROPERTY OF SCHNEIDER ELECTRIC AND SHALL NOT BE COPIED, REPRODUCED OR OR SALE OF ITEMS WITHOUT WRITTEN PERMISSION FROM SCHNEIDER ELECTRIC. THIS DRAWING IS BASED UPON LATEST AVAILABLE INFORMATION AND IS SUBJECT TO CHANGE WITHOUT NOTICE.

Schneider @ Electric

TITLE: RACK PDU 2G, SWITCHED
ZERO U, 11kW 230VAC
INPUT: IEC 309 16A 3P+N+FE, IEC 309 20A 3P+N+E
OUTPUT: (21)IEC 320 C13, (3)IEC 320 C19
MAIN MECHANICAL

89 20-0CT-10 THIRD DRAWN BY: V BUSH ENGINEER: Y JIANG/T HORSTMANN 20-0CT-10 ANGLE PROJECT: STD SUBMITTAL DRAWINGS SHEET 1 OF 2 APPROVED BY: M LEPARD/B SHERIDAN 20-OCT-10

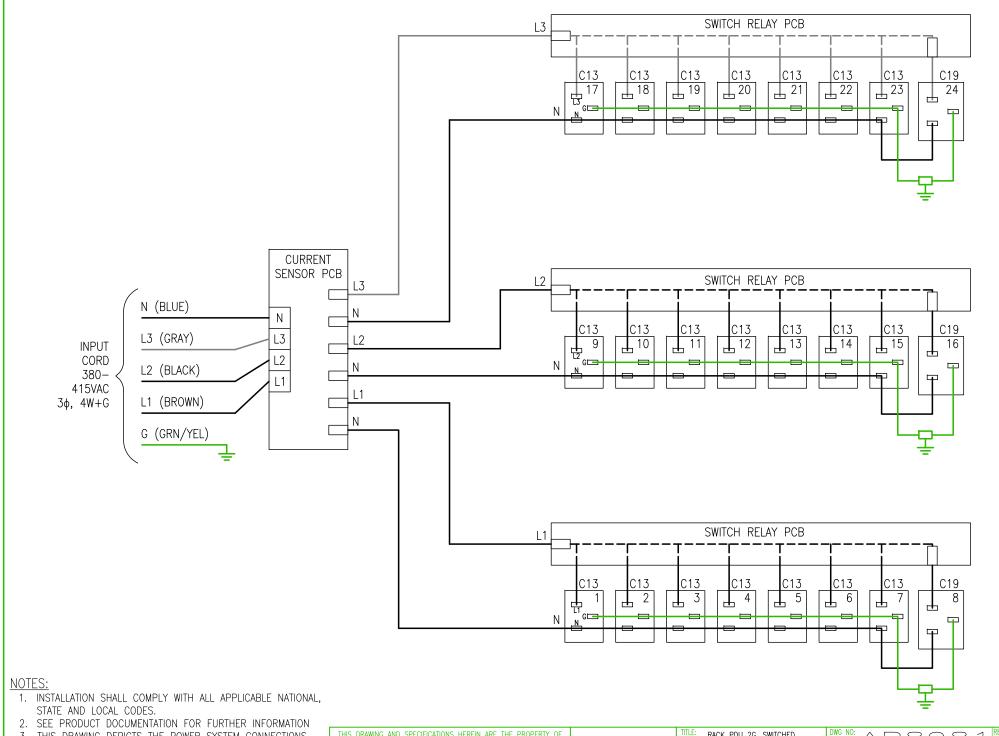

3. THIS DRAWING DEPICTS THE POWER SYSTEM CONNECTIONS AND IS NOT REPRESENTATIVE OF THE PHYSICAL LAYOUT. PLEASE REFER TO MECHANICAL DRAWINGS FOR PHYSICAL LAYOUT.

THIS DRAWING AND SPECIFICATIONS HEREIN ARE THE PROPERTY OF SCHNEIDER ELECTRIC AND SHALL NOT BE COPIED, REPRODUCED OR USED IN WHOLE OR IN PART, AS THE BASIS FOR THE MANUFACTURE OR SALE OF ITEMS WITHOUT WRITTEN PERMISSION FROM SCHNEIDER ELECTRIC. THIS DRAWING IS BASED UPON LATEST AVAILABLE INFORMATION AND IS SUBJECT TO CHANGE WITHOUT NOTICE.

Schneider @Electric

| | TITLE: RACK PDU 2G, SWITCHED ZERO U, 11kW 230VAC | | | | | |
|---|---|--|--|--|--|--|
| 1 | INPUT: IEC 309 16a 3P+N+PE, IEC 309 20a 3P+N+E OUTPUT: (21)IEC 320 C13, (3)IEC 320 C19 ELECTRICAL SCHEMATIC | | | | | |
| | | | | | | |
| | DOCUMENT OF CURNITY PRIMITION CLIEFT O OF C | | | | | |

| | ZERO U. 11kW 230VAC | | | 8 | 981 | REV. |
|--|---|--------------|------------------------|------------|-----------|-------|
| | INPUT: IEC 309 16A 3P+N+PE, IEC 309 20A 3P+N+E OUTPUT: (21)IEC 320 C13, (3)IEC 320 C19 | DRAWN BY: | V BUSH | 20-0CT-10 | PROJ | |
| | | | ENGINEER: Y JIANG/T HO | RSTMANN | 20-0CT-10 | ANGLE |
| | PROJECT: STD SUBMITTAL DRAWINGS | SHEET 2 OF 2 | APPROVED BY: M LEPARD/ | B SHERIDAN | 20-0CT-10 | N.A. |