



Ref. Certif. No.

FR_712309/A1

IEC SYSTEM FOR MUTUAL RECOGNITION OF TEST CERTIFICATES FOR ELECTRICAL EQUIPMENT (IECEE) CB SCHEME

CB TEST CERTIFICATE

Product

Transfer switching equipment
Transfer Switching Equipment (Class PC)

Name and address of the applicant

Schneider Electric (China) Co., Ltd. Shanghai Branch
No.669, Suide road, Putuo
Shanghai - CHINA

Name and address of the manufacturer

Schneider Electric (China) Co., Ltd.
Building A, No. 6, East Wangjing Road, Chaoyang District
BEIJING - CHINA

Name and address of the factory

Schneider Wingoal (Tianjin)Electric Equipment Co.,Ltd.
No.11, Hi-Tech Chuang Xin No. 6 Rd, Hua Yuan Industrial
Development Area (Outside Outer Ring), Binhai New Area
Tianjin P.R. - CHINA

Note: When more than one factory, please report on page 2

Additional Information on page 2

Ratings and principal characteristics

See Annex

Trademark / Brand (if any)



Customer's Testing Facility (CTF) Stage used

/

Model / Type Ref.

TransferPact TA10

Additional information (if necessary may also be reported on page 2)

Supersedes CBTC FR_712309 dated 29/10/2021. Editorial correction

Additional Information on page 2

A sample of the product was tested and found to be in conformity with

IEC 60947-6-1:2005 +A1:2013
IEC 60947-1:2007 +A1:2010


As shown in the Test Report Ref. No. which forms part of this Certificate

2111996002

This CB Test Certificate is issued by the National Certification Body



LABORATOIRE CENTRAL DES INDUSTRIES ELECTRIQUES - LCIE
33 avenue du Général Leclerc
92260 Fontenay-aux-Roses, FRANCE
www.lcie.fr



LABORATOIRE CENTRAL DES
INDUSTRIES ELECTRIQUES
S.A.S au capital de 15.745.984 €
RCS Nanterre B 408 363 174
33 avenue du Général Leclerc
F - 92266 FONTENAY AUX ROSES

Date: 24/11/2021

Signature: **Julien GAUTHIER**
Certification Officer

ANNEX


Ratings and main characteristics:

<i>Class of equipment</i>	PC
<i>method of controlling</i>	ATSE
<i>number of poles</i>	2P, 3P, 4P
<i>Rated operational voltage U_e (V)</i>	2P: AC220V/230V/240V/250V; 3P/4P: 380V/400V/415V/440V
<i>rated insulation voltage U_i (V)</i>	800V
<i>rated impulse withstand voltage U_{imp} (kV)</i>	6kV
<i>Conventional free air thermal current I_{th} (A)</i>	100A
<i>Rated operational current I_e (A)</i>	16A,20A,25A,32A,40A,50A,63A for AC-33B 80A,100A for AC-32B
<i>Rated frequency (Hz)</i>	50/60Hz
<i>Utilization category</i>	AC-32B, AC-33B
<i>rated short-time withstand current I_{cw} (kA)</i>	5kA/100ms
<i>rated short-circuit making capacity I_{cm} (kA)</i>	15kA
<i>rated conditional short-circuit current I_q (kA)</i>	2P: 25kA (breaker), 80kA (fuse) 3P/4P: 50kA (breaker), 100kA (fuse)
<i>EMC environment</i>	B



LABORATOIRE CENTRAL DES INDUSTRIES ELECTRIQUES - LCIE
33 avenue du Général Leclerc
92260 Fontenay-aux-Roses, FRANCE
www.lcie.fr

Date: 24/11/2021

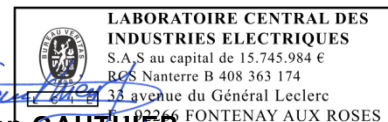

Signature: **Julien GAUTHIER**
Certification Officer