


### Presentation



LRD 08



LRD 365



LRD 33pp

TeSys D thermal overload relays are designed to protect a.c. circuits and motors against:

- b overloads,
- b phase failure,
- b excessively long starting times,
- b prolonged stalled rotor condition.

#### Power connection

##### LRD 01 to LRD 35

LRD 01 to 35 relays are designed for connection by screw clamp terminals. They can be supplied for connection by spring terminals or by lugs (1).

##### LRD 313 to LRD 365

LRD 313 to 365 relays are for connection by BTR screw connectors (hexagon socket head).

The screws are tightened by means of a size 4, insulated Allen key.

This type of connection uses the **EverLink®** system with creep compensation (2) (Schneider Electric patent).


This technique makes it possible to achieve accurate and durable tightening torque.

These relays are also available for connection by lugs (1).


##### LRD 3361 to 4369, LR2 D3561 to D3563

LRD 3361 to 4369 and LR2 D3561 to D3563 relays are designed for connection by screw clamp terminals. They can be supplied for connection by lugs (1).

### Description

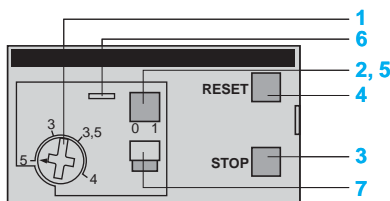

LRD 01...35 and LRD 313...LRD 365

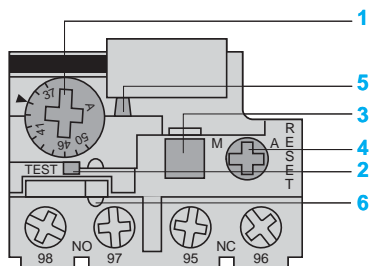

LRD 3361...4369, LR2 D3561...3563

TeSys D 3-pole thermal overload relays are designed to protect a.c. circuits and motors against overloads, phase failure, long starting times and prolonged stalling of the motor.

- 1 Adjustment dial Ir.
- 2 Test button.  
Operation of the Test button allows:
  - checking of control circuit wiring,
  - simulation of relay tripping (actuates both the N/O and N/C contacts).
- 3 Stop button. Actuates the N/C contact; does not affect the N/O contact.
- 4 Reset button.
- 5 Trip indicator.
- 6 Setting locked by sealing the cover.
- 7 Selector for manual or automatic reset.

LRD 01 to 35 and LRD 313 to LRD 365 relays are supplied with the selector in the manual position, protected by a cover. Deliberate action is required to move it to the automatic position.

(1) Connection by lugs meets the requirements of certain Asian markets and is suitable for applications subject to strong vibration, such as railway transport.

(2) Creep: normal crushing phenomenon of copper conductors, that is accentuated over time.

Environment			
Conforming to standards			IEC/EN 60947-4-1, IEC/EN 60947-5-1, UL 508, CSA C22.2 n° 14. ATEX directive 94/9/EC (1)
Product certifications			UL, CSA, CCC, GOST ATEX INERIS (1). GL, DNV, RINA, BV, LROS (2).
Degree of protection	Conforming to VDE 0106		Protection against direct finger contact IP 2X
Protective treatment	Conforming to IEC 60068		"TH"
Ambient air temperature around the device	Storage	°C	- 60...+ 70
	Normal operation, without derating (IEC 60947-4-1)	°C	- 20...+ 60
	Minimum /maximum operating temperatures (with derating)	°C	- 40...+ 70
Operating positions without derating	In relation to normal vertical mounting plane		Any position. When mounting on a vertical rail, use a stop.
Flame resistance	Conforming to UL 94		V1
	Conforming to IEC 60695-2-1	°C	850
Shock resistance	Permissible acceleration conforming to IEC 60068-2-7		15 gn - 11 ms
Vibration resistance (3)	Permissible acceleration conforming to IEC 60068-2-6		6 gn
Dielectric strength at 50 Hz	Conforming to IEC 60255-5	kV	6
Surge withstand	Conforming to IEC 60801-5	kV	6

Electrical characteristics of power circuit			LRD 01 ...16, LR3 D01 ...16	LRD 1508 ...1532	LRD 21 ...35, LR3 D21 ...35	LRD 313 ...365 LR3 D313 ...365	LRD 313L ...365L	LRD 3322 ...33696 LR3 D3322 ... 33696	LR2 D3522 ... 3563	LRD 4365 ...4369	
Tripping class	Conforming to UL 508, IEC 60947-4-1		10 A	20	10 A	10 A	20	10 A	20	10 A	
Rated insulation voltage (Ui)	Conforming to IEC 60947-4-1	V	690						1000		
	Conforming to UL, CSA	V	600						600 except LRD 4369		
Rated impulse withstand voltage (Uimp)		kV	6								
Frequency limits	Of the operating current	Hz	0...400								
Setting range	Depending on model	A	0.1...13	2.5...32	12...38	9...65	9...65	17...140	17...80	80...140	

Auxiliary contact characteristics										
Conventional thermal current		A	5							
Max. sealed consumption of the operating coils of controlled contactors (Occasional operating cycles of contact 95-96)	a.c. supply, AC-15	V	120	240	380	480	500	600		
		A	3	1.5	0.95	0.75	0.72	0.12		
	d.c. supply, DC-13	V	125	250	440					
		A	0.22	0.1	0.06					
Protection against short-circuits	By gG, BS fuses. Maximum rating or by GB2	A	5							


(1) For relays LRD01 to LRD365.

(2) Pending for relays LRD313 to LRD365.

(3) For relays LRD 313 to LRD 365: 6 gn only with independent plate mounting and 4 gn when mounted beneath the contactor.

#### Power circuit connection characteristics


Relay type		LRD 01 ...16, LR3 D01 ...16	LRD 1508 ...1532	LRD 21 ...35, LR3 D21 ...35	LRD 313 ...365 LR3 D313 ...365	LRD 313L ...365L	LRD 3322 ...33696 LR3 D3322 ... 33696	LR2 D3522 ...3563	LRD 4365 ...4369	
<b>Connection to screw clamp terminals</b>										
Flexible cable without cable end	1 conductor	mm <sup>2</sup>	1.5...10	1.5...10	1...35	1...35	4...35		4...50	
Flexible cable with cable end	1 conductor	mm <sup>2</sup>	1...4	1...6 except LRD 21: 1...4	1...35	1...35	4...35		4...35	
Solid cable without cable end	1 conductor	mm <sup>2</sup>	1...6	1.5/10 except LRD 21: 1/6	1...35	1...35	4...35		4...50	
Tightening torque		N.m	1.7	1.85	2.5	1...25 : 5 35 : 8	1...25 : 5 35 : 8	9	9	9
<b>Connection to spring terminals (Min/max c.s.a.)</b>										
Flexible cable without cable end	1 conductor	mm <sup>2</sup>	1.5...4	-	1.5...4	-	-	-	-	
Flexible cable with cable end	1 conductor	mm <sup>2</sup>	1.5...4	-	1.5...4	-	-	-	-	

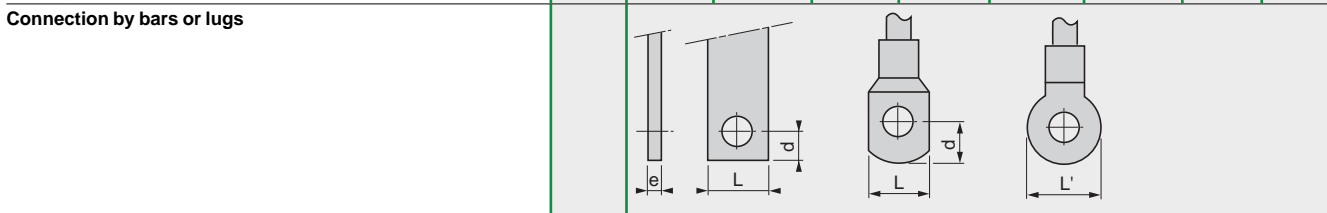

Relay type		LRD 016 ... 166	LRD 216 ... 356	LRD 3136 ... 3656	LRD 313L6 ... 365L6	LRD 3322A66 ... 3365A66
Pitch	Without spreaders	mm	14.5	17.5	17.5	21.5
Bars or cables with lugs	e	N.m	y 6	y 6	y 6	y 6
	L	mm	y 8	y 8	y 13.5	y 16
	L'	mm	y 9.5	y 10	y 16.5	y 16
	d		y 7	y 7	y 10	y 12
Screws		M4	M4	M6	M6	M10
	Tightening torque	N.m	2.3	2.3	6	6

#### Control circuit connection characteristics

##### Connection to screw clamp terminals or spring terminals

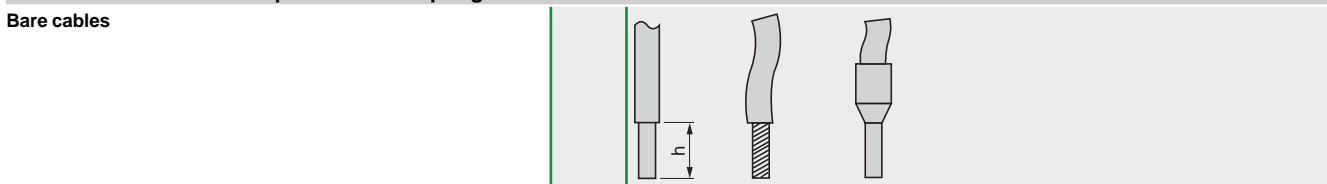

Relay type		LRD 01 ...16, LR3 D01 ...16	LRD 1508 ... 1532	LRD 21 ...35, LR3 D21 ...35	LRD 313 ...365 LR3 D313 ...365	LRD 313L ...365L	LRD 3322 ...33696 LR3 D3322 ... 33696	LR2 D3522 ... 3563	LRD 4365 ...4369
<b>Connection to screw clamp terminals (1)</b>									
	Solid cable without cable end	mm <sup>2</sup>	2 x 1...2.5						
	Flexible cable without cable end	mm <sup>2</sup>	2 x 1...2.5						
	Flexible cable with cable end	mm <sup>2</sup>	2 x 1...2.5						
<b>Tightening torque</b>		N.m	1.7						
<b>Connection to spring terminals (Min/max c.s.a.)</b>									
	Solid cable	mm <sup>2</sup>	1...2.5	-	1...2.5		-		
	Flexible cable without cable end	mm <sup>2</sup>	1...2.5	-	1...2.5		-		

(1) For relays LRD 313 to 365: BTR hexagon socket head screws, EverLink® system. In accordance with local electrical wiring regulations, a size 4 insulated Allen key must be used (reference LADALLEN4, see page 24511/9).

### Operating characteristics



Relay type		LRD 01 ...16, LR3 D01 ...16	LRD 1508 ... 1532	LRD 21 ...35, LR3 D21 ...35	LRD 313 ...365 LR3 D313 ...365	LRD 313L ...365L	LRD 3322 ...33696 LR3 D3322 ... 33696	LR2 D3522 ... 3563	LRD 4365 ...4369
Temperature compensation	°C	- 20...+ 60							
Tripping threshold	Conforming to IEC 60947-4-1	A	1.14 ± 0.06 I <sub>r</sub>						
Sensitivity to phase failure	Conforming to IEC 60947-4-1		Tripping current I 30 % of I <sub>r</sub> on one phase, the others at I <sub>r</sub> .						

### Tripping curves

Average operating time related to multiples of the setting current



LRD 01 to LRD 35, LR2 D and LRD 3322 to LRD 4369

LRD 1508 to LRD 32 and LR2 D3522 to LR2 D3563

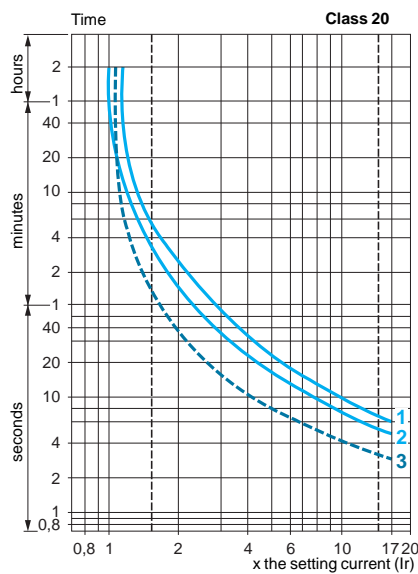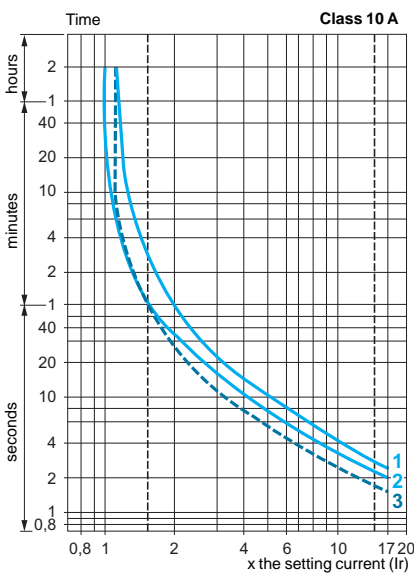


LRD 313 to LRD 365

LRD 313L to LRD 365L

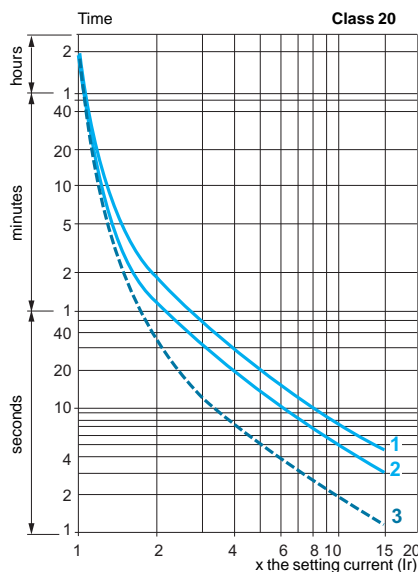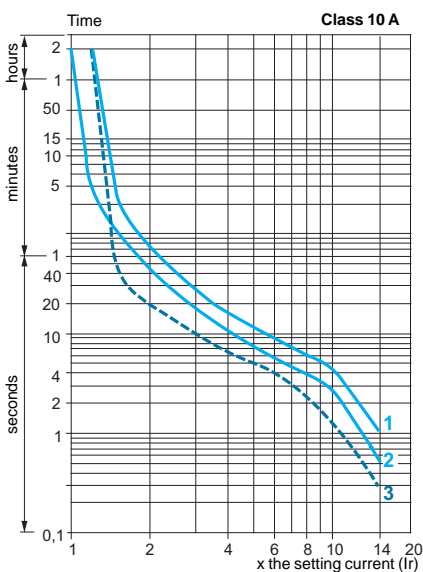


- 1 Balanced operation, 3-phase, without prior current flow (cold state).
- 2 2-phase operation, without prior current flow (cold state).
- 3 Balanced operation, 3-phase, after a long period at the set current (hot state).

### Description

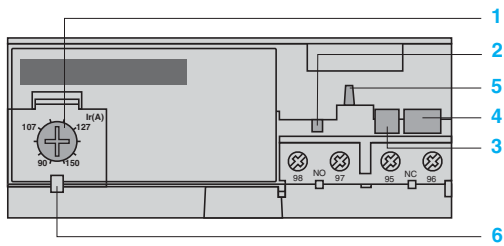

LR9 D5367...D5569

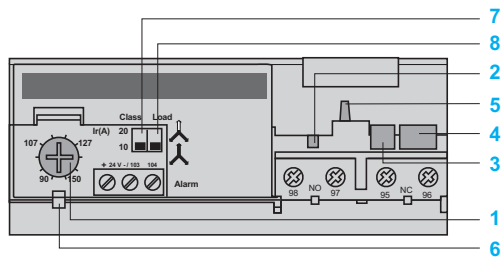

LR9 D67 and D69

LR9 D electronic thermal overload relays are designed for use with contactors LC1 D115 and D150.

In addition to the protection provided by TeSys D thermal overload relays (see page 24516/2), they offer the following special features:

- b protection against phase imbalance,
- b choice of starting class,
- b protection of unbalanced circuits,
- b protection of single-phase circuits,
- b alarm function to avoid tripping by load shedding.

- 1 Adjustment dial  $I_r$ .
- 2 Test button.
- 3 Stop button.
- 4 Reset button.
- 5 Trip indicator.
- 6 Setting locked by sealing the cover.
- 7 Class 10/class 20 selector switch.
- 8 Selector for balanced load /unbalanced load

### Environment

<b>Conforming to standards</b>		IEC 60947-4-1, 255-8, 255-17, VDE 0660 and EN 60947-4-1	
<b>Product certifications</b>		UL 508 , CSA 22-2	
<b>Degree of protection</b>	Conforming to IEC 60529 and VDE 0106	IP 20 on front panel with protective covers <b>LA9 D11570p</b> or <b>D11560p</b>	
<b>Protective treatment</b>	Standard version	"TH"	
<b>Ambient air temperature around the device</b> (Conforming to IEC 60255-8)	Storage	°C	- 40...+ 85
	Normal operation	°C	- 20...+ 55 (1)
<b>Maximum operating altitude</b>	Without derating	<b>m</b>	2000
<b>Operating positions without derating</b>	In relation to normal vertical mounting plane	Any position	
<b>Shock resistance</b>	Permissible acceleration conforming to IEC 60068-2-7	13 gn - 11 ms	
<b>Vibration resistance</b>	Permissible acceleration conforming to IEC 60068-2-6	2 gn - 5...300 Hz	
<b>Dielectric strength at 50 Hz</b>	Conforming to IEC 60255-5	<b>kV</b>	6
<b>Surge withstand</b>	Conforming to IEC 61000-4-5	<b>kV</b>	6
<b>Resistance to electrostatic discharge</b>	Conforming to IEC 61000-4-2	<b>kV</b>	8
<b>Immunity to radiated radio-frequency disturbances</b>	Conforming to IEC 61000-4-3 and NF C 46-022	<b>V/m</b>	10
<b>Immunity to fast transient currents</b>	Conforming to IEC 61000-4-4	<b>kV</b>	2
<b>Electromagnetic compatibility</b>	Draft EN 50081-1 and 2, EN 50082-2	Meets requirements	

### Electrical characteristics of auxiliary contacts


<b>Conventional thermal current</b>	<b>A</b>	5						
<b>Max. sealed consumption</b> of the operating coils of controlled contactors (Occasional operating cycles of contact 95-96)	a.c. supply	<b>V</b>	24	48	110	220	380	600
		<b>VA</b>	100	200	400	600	600	600
	d.c. supply	<b>V</b>	24	48	110	220	440	–
		<b>W</b>	100	100	50	45	25	–
<b>Protection against short-circuits</b>	By gG or BS fuses or by circuit-breaker <b>GB2</b>	<b>A</b>	5					
<b>Cabling</b> Flexible cable without cable end	1 or 2 conductors	<b>mm<sup>2</sup></b>	Minimum c.s.a.: 1 Maximum c.s.a.: 2.5					
	Tightening torque	<b>Nm</b>	1.2					

(1) For operating temperatures up to 70 °C, please consult your Regional Sales Office.

Relay type		LR9 D	
<b>Electrical characteristics of power circuit</b>			
Tripping class	Conforming to UL 508, IEC 60947-4-1	A	10 or 20
Rated insulation voltage (U <sub>i</sub> )	Conforming to IEC 60947-4-1	V	1000
	Conforming to UL, CSA	V	600
Rated impulse withstand voltage (U <sub>imp</sub> )		Hz	8
Frequency limits	Of the operating current	Hz	50...60 (1)
Setting range	Depending on model	A	60...150
Power circuit connections	Width of terminal lug	mm	20
	Clamping screw		M8
	Tightening torque	N.m	18
<b>Operating characteristics</b>			
Temperature compensation		°C	- 20...+ 70
Tripping thresholds	Conforming to IEC 60947-4-1		
	Alarm	A	1.05 ± 0.06 I <sub>n</sub>
	Trip	A	1.12 ± 0.06 I <sub>n</sub>
Sensitivity to phase failure	Conforming to IEC 60947-4-1		Tripping in 4 s ± 20 % in the event of phase failure
<b>Alarm circuit characteristics</b>			
Rated supply voltage	d.c. supply	V	24
Supply voltage limits		V	17...32
Current consumption	No-load	mA	y 5
Switching capacity		mA	0...150
Protection	Short-circuit and overload		Self protected
Voltage drop	Closed state	V	y 2.5
Cabling	Flexible cable without cable end	mm <sup>2</sup>	0.5...1.5
Tightening torque		N.m	0.45

(1) For other frequencies and for applications involving the use of these overload relays with soft starters or variable speed drives, please consult your Regional Sales Office.

### LR9 D tripping curves

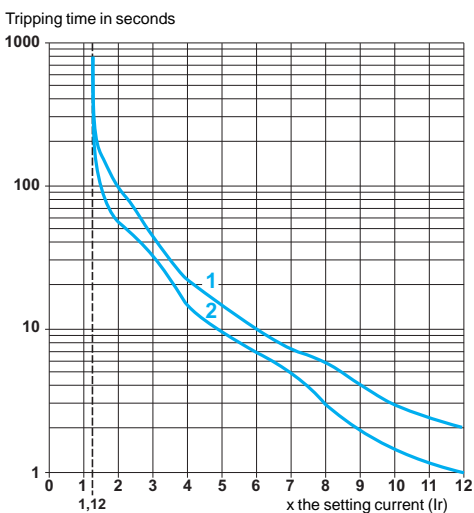

526200




LRD pp

526201



LRD 3pp

526202



LRD 33pp

526203



LRD 3pp6

### Differential thermal overload relays

for use with fuses or magnetic circuit-breakers GV2 L and GV3 L

- b Compensated relays with manual or automatic reset,
- b with relay trip indicator,
- b for a.c. or d.c.

Relay setting range (A)	Fuses to be used with selected relay			For use with contactor LC1	Reference	Weight kg
	aM (A)	gG (A)	BS88 (A)			
<b>Class 10 A (1) for connection by screw clamp terminals or connectors</b>						
0.10...0.16	0.25	2	–	D09...D38	<b>LRD 01</b>	0.124
0.16...0.25	0.5	2	–	D09...D38	<b>LRD 02</b>	0.124
0.25...0.40	1	2	–	D09...D38	<b>LRD 03</b>	0.124
0.40...0.63	1	2	–	D09...D38	<b>LRD 04</b>	0.124
0.63...1	2	4	–	D09...D38	<b>LRD 05</b>	0.124
1...1.6	2	4	6	D09...D38	<b>LRD 06</b>	0.124
1.6...2.5	4	6	10	D09...D38	<b>LRD 07</b>	0.124
2.5...4	6	10	16	D09...D38	<b>LRD 08</b>	0.124
4...6	8	16	16	D09...D38	<b>LRD 10</b>	0.124
5.5...8	12	20	20	D09...D38	<b>LRD 12</b>	0.124
7...10	12	20	20	D09...D38	<b>LRD 14</b>	0.124
9...13	16	25	25	D12...D38	<b>LRD 16</b>	0.124
12...18	20	35	32	D18...D38	<b>LRD 21</b>	0.124
16...24	25	50	50	D25...D38	<b>LRD 22</b>	0.124
23...32	40	63	63	D25...D38	<b>LRD 32</b>	0.124
30...38	40	80	80	D32 and D38	<b>LRD 35</b>	0.124
<b>Class 10 A (1) for connection by EverLink® BTR screw connectors (3)</b>						
9...13	16	25	25	D40A...D65A	<b>LRD 313</b>	0.375
12...18	20	32	35	D40A...D65A	<b>LRD 318</b>	0.375
17...25	25	50	50	D40A...D65A	<b>LRD 325</b>	0.375
23...32	40	63	63	D40A...D65A	<b>LRD 332</b>	0.375
30...40	40	80	80	D40A...D65A	<b>LRD 340</b>	0.375
37...50	63	100	100	D40A...D65A	<b>LRD 350</b>	0.375
48...65	63	100	100	D50A and D65A	<b>LRD 365</b>	0.375
<b>Class 10 A (1) for connection by screw clamp terminals or connectors</b>						
17...25	25	50	50	D80 and D95	<b>LRD 3322</b>	0.510
23...32	40	63	63	D80 and D95	<b>LRD 3353</b>	0.510
30...40	40	100	80	D80 and D95	<b>LRD 3355</b>	0.510
37...50	63	100	100	D80 and D95	<b>LRD 3357</b>	0.510
48...65	63	100	100	D80 and D95	<b>LRD 3359</b>	0.510
55...70	80	125	125	D80 and D95	<b>LRD 3361</b>	0.510
63...80	80	125	125	D80 and D95	<b>LRD 3363</b>	0.510
80...104	100	160	160	D80 and D95	<b>LRD 3365</b>	0.510
80...104	125	200	160	D115 and D150	<b>LRD 4365</b>	0.900
95...120	125	200	200	D115 and D150	<b>LRD 4367</b>	0.900
110...140	160	250	200	D150	<b>LRD 4369</b>	0.900
80...104	100	160	160	(2)	<b>LRD 33656</b>	1.000
95...120	125	200	200	(2)	<b>LRD 33676</b>	1.000
110...140	160	250	200	(2)	<b>LRD 33696</b>	1.000

### Class 10 A (1) for connection by lugs

Select the appropriate overload relay with screw clamp terminals or connectors from the table above and add one of the following suffixes:

b figure 6 for relays LRD 01 to LRD 35 and relays LRD 313 to LRD 365.

b **A66** for relays LRD 3322 to LRD 3365.

Relays LRD 43pp are suitable, as standard, for use with lug-clamps.

### Thermal overload relays for use with unbalanced loads

#### Class 10 A (1) for connection by screw clamp terminals or lugs

In the references selected above, change the prefix **LRD** (except **LRD 4ppp**) to **LR3 D**.

Example: **LRD 01** becomes **LR3 D01**.

Example with **EverLink®** connectors: **LRD 340** becomes **LR3 D340**.

Example with lugs: **LRD 3406** becomes **LR3 D3406**.

(1) Standard IEC 60947-4-1 specifies a tripping time for 7.2 times the setting current  $I_R$ : class 10 A: between 2 and 10 seconds

(2) Independent mounting of the contactor.

(3) BTR screws: hexagon socket head. In accordance with local electrical wiring regulations, a size 4 insulated Allen key must be used (reference **LAD ALLEN4**, see page 24511/9).

528204



LRD pp3

**Differential thermal overload relays****for use with fuses or magnetic circuit-breakers GV2 L and GV3 L**

- b Compensated relays with manual or automatic reset,
- b with relay trip indicator,
- b for a.c. or d.c.

Relay setting range (A)	Fuses to be used with selected relay			For use with contactor LC1	Reference	Weight kg
	aM (A)	gG (A)	BS88 (A)			
<b>Classes 10 A (1) for connection by spring terminals (only for direct mounting beneath the contactor)</b>						
0.10...0.16	0.25	2	–	D09...D38	<b>LRD 013</b>	0.140
0.16...0.25	0.5	2	–	D09...D38	<b>LRD 023</b>	0.140
0.25...0.40	1	2	–	D09...D38	<b>LRD 033</b>	0.140
0.40...0.63	1	2	–	D09...D38	<b>LRD 043</b>	0.140
0.63...1	2	4	–	D09...D38	<b>LRD 053</b>	0.140
1...1.6	2	4	6	D09...D38	<b>LRD 063</b>	0.140
1.6...2.5	4	6	10	D09...D38	<b>LRD 073</b>	0.140
2.5...4	6	10	16	D09...D38	<b>LRD 083</b>	0.140
4...6	8	16	16	D09...D38	<b>LRD 103</b>	0.140
5.5...8	12	20	20	D09...D38	<b>LRD 123</b>	0.140
7...10	12	20	20	D09...D38	<b>LRD 143</b>	0.140
9...13	16	25	25	D12...D38	<b>LRD 163</b>	0.140
12...18	20	35	32	D18...D38	<b>LRD 213</b>	0.140
16...24	25	50	50	D25...D38	<b>LRD 223</b>	0.140

**Class 10 A with connection by EverLink® BTR screw connectors (2) and control by spring terminals**

9...13	16	25	25	D40A...D65A	<b>LRD 3133</b>	0.375
12...18	20	32	35	D40A...D65A	<b>LRD 3183</b>	0.375
17...25	25	50	50	D40A...D65A	<b>LRD 3253</b>	0.375
23...32	40	63	63	D40A...D65A	<b>LRD 3323</b>	0.375
30...40	40	80	80	D40A...D65A	<b>LRD 3403</b>	0.375
37...50	63	100	100	D40A...D65A	<b>LRD 3503</b>	0.375
48...65	63	100	100	D50A and D65A	<b>LRD 3653</b>	0.375

**Thermal overload relays for use with unbalanced loads****Classes 10 A (1) for connection by BTR screw connectors (2) and control by spring terminals**

- In the references selected above, replace **LRD 3** with **LR3 D3**.  
Example: **LRD 3653** becomes **LR3 D3653**.

**Thermal overload relays for use on 1000 V supplies****Classes 10 A (1) for connection by screw clamp terminals**

For relays LRD 06 to LRD 35 only, for an operating voltage of 1000 V, and only for independent mounting, the reference becomes **LRD 33ppA66**.

Example: **LRD 12** becomes **LRD 3312A66**.


Order an **LA7 D3064** terminal block separately, see page 24515/3.

(1) Standard IEC 60947-4-1 specifies a tripping time for 7.2 times the setting current  $I_{tr}$ :  
class 10 A: between 2 and 10 seconds

(2) BTR screws: hexagon socket head. In accordance with local electrical wiring regulations, a size 4 insulated Allen key must be used (reference **LAD ALLEN4**, see page 24511/9).



528205



LRD 15pp

528201



LRD 3ppL

528206



LR2 D35pp

**Differential thermal overload relays**

for use with fuses or magnetic circuit-breakers GV2 L and GV3 L

- b Compensated relays with manual or automatic reset,
- b with relay trip indicator,
- b for a.c. or d.c.

Relay setting range (A)	Fuses to be used with selected relay			For use with contactor LC1	Reference	Weight kg
	aM (A)	gG (A)	BS88 (A)			
<b>Classes 20 (1) for connection by screw clamp terminals</b>						
2.5...4	6	10	16	D09...D32	LRD 1508	0.190
4...6	8	16	16	D09...D32	LRD 1510	0.190
5.5...8	12	20	20	D09...D32	LRD 1512	0.190
7...10	16	20	25	D09...D32	LRD 1514	0.190
9...13	16	25	25	D12...D32	LRD 1516	0.190
12...18	25	35	40	D18...D32	LRD 1521	0.190
17...25	32	50	50	D25 and D32	LRD 1522	0.190
23...28	40	63	63	D25 and D32	LRD 1530	0.190
25...32	40	63	63	D25 and D32	LRD 1532	0.190
<b>Class 20 (1) for connection by EverLink® BTR screw connectors (2)</b>						
9...13	20	32	35	D40A...D65A	LRD 313L	0.375
12...18	25	40	40	D40A...D65A	LRD 318L	0.375
17...25	32	50	50	D40A...D65A	LRD 325L	0.375
23...32	40	63	63	D40A...D65A	LRD 332L	0.375
30...40	50	80	80	D40A...D65A	LRD 340L	0.375
37...50	63	100	100	D40A...D65A	LRD 350L	0.375
48...65	80	125	125	D50A and D65A	LRD 365L	0.375
<b>Classes 20 (1) for connection by screw clamp terminals</b>						
17...25	32	50	50	D80 and D95	LR2 D3522	0.535
23...32	40	63	63	D80 and D95	LR2 D3553	0.535
30...40	40	100	80	D80 and D95	LR2 D3555	0.535
37...50	63	100	100	D80 and D95	LR2 D3557	0.535
48...65	80	125	100	D80 and D95	LR2 D3559	0.535
55...70	100	125	125	D80 and D95	LR2 D3561	0.535
63...80	100	160	125	D80 and D95	LR2 D3563	0.535

(1) Standard IEC 60947-4-1 specifies a tripping time for 7.2 times the setting current  $I_R$ :  
class 20: between 6 and 20 seconds

(2) BTR screws: hexagon socket head. In accordance with local electrical wiring regulations, a size 4 insulated Allen key must be used (reference LAD ALLEN4, see page 24511/9).

### Differential thermal overload relays

#### for use with fuses or magnetic circuit-breakers NSX

- b Compensated relays, with relay trip indicator,
- b for a.c.,
- b for direct mounting on contactor or independent mounting(1).

Relay setting range (A)	Fuses to be used with selected relay		For mounting beneath contactor LC1	Reference	Weight kg
	aM (A)	gG (A)			
<b>Classes 10 or 10A (2) for connection using bars or connectors</b>					
60...100	100	160	D115 and D150	<b>LR9 D5367</b>	0.885
90...150	160	250	D115 and D150	<b>LR9 D5369</b>	0.885
<b>Classes 20 (2) for connection using bars or connectors</b>					
60...100	125	160	D115 and D150	<b>LR9 D5567</b>	0.885
90...150	200	250	D115 and D150	<b>LR9 D5569</b>	0.885

### Electronic thermal overload relays for use with balanced or unbalanced loads

- b Compensated relays,
- b with separate outputs for alarm and tripping.

Relay setting range (A)	Fuses to be used with selected relay		For mounting beneath contactor LC1	Reference	Weight kg
	aM (A)	gG (A)			
<b>Classes 10 or 20 (2) selectable, for connection using bars or connectors</b>					
60...100	100	160	D115 and D150	<b>LR9 D67</b>	0.900
90...150	160	250	D115 and D150	<b>LR9 D69</b>	0.900

(1) Power terminals can be protected against direct finger contact by the addition of shrouds and/or insulated terminal blocks, to be ordered separately (see page 24511/8).


(2) Standard IEC 60947-4-1 specifies a tripping time for 7.2 times the setting current  $I_R$ :

- class 10: between 4 and 10 seconds,
- class 10 A: between 2 and 10 seconds,
- class 20 A: between 6 and 20 seconds


#### Other versions

Thermal overload relays for resistive circuits in category AC-1.  
Please consult your Regional Sales Office.




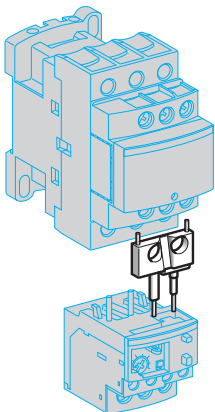

LAD 7Cp



LAD 7B106

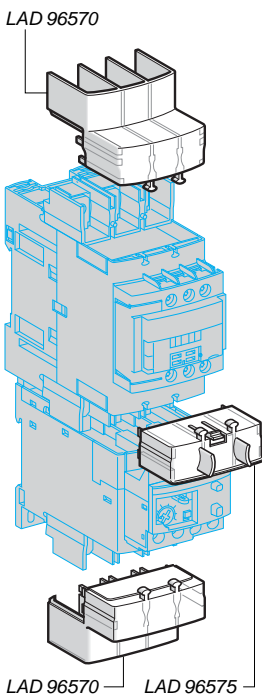

LAD 96570 — LAD 96575

### Separate components for relays

Description	For use with	Sold in lots of	Unit reference	Weight kg
<b>Pre-wiring kit</b> allowing direct connection of the N/C contact of relay LRD 01...35 or LR3 D01...D35 to the contactor	LC1 D09...D18	10	LAD 7C1 (1)	0.002
	LC1 D25...D38	10	LAD 7C2 (1)	0.003
<b>Terminal block (2)</b> for clip-on mounting on 35 mm rail (AM1 DP200) or screw fixing; for fixing centres, see pages 24534/2 to 24534/4	LRD 01...35 and LR3 D01...D35	1	LAD 7B106	0.100
	LRD 1508...32	1	LAD 7B105	0.100
<b>EverLink® terminal block</b> for independent mounting	LRD 33ppp, LR3 D33ppp, LR2 D35pp	1	LA7 D3064 (3)	0.370
	LRD 3pp, LRD 3ppL and LR3 D3pp	1	LAD 96560	0.087
<b>Size 4 Allen key, insulated, 1000 V</b>	LRD 3pp, LRD 3ppL and LR3 D3pp	5	LAD ALLEN4	0.026
<b>Terminal block adapter</b> for mounting a relay beneath an LC1 D115 or D150 contactor	LRD 3pp, LR3 D33ppp, LRD 35pp	1	LA7 D3058 (3)	0.080
<b>Mounting plates (4)</b> for screw fixing on 110 mm centres	LRD 01...35, LR3 D01...D35, LRD 1508...32	10	DX1 AP25	0.065
	LRD 3ppp, LR3 D33ppp, LR2 D35pp	1	LA7 D902	0.130
<b>Marker holders, snap-in 8 x 18 mm</b>	LRD 3pp	100	LAD 90	0.001
	All relays except LRD 01...35, LR3 D01...D35, LRD 3pp, LRD 3ppL and LR3 D3pp	100	LA7 D903	0.001
	All relays	1	LA9 D91	0.001
<b>Bag of 400 blank legends</b> (self-adhesive, 7 x 16 mm)	All relays	1	LA9 D91	0.001
<b>Stop button locking device</b>	All relays except LRD 01...35, LR3 D01...D35, LR9 D and LRD 313...LRD 365	10	LA7 D901	0.005
<b>Remote Stop or electrical reset device (5)</b>	LRD 01...35, LR3 D01...D35 and LRD 313...LRD 365	1	LAD 703p (6) (7)	0.090
<b>Remote tripping or electrical reset device (5)</b>	All relays except LRD 01...35, LR3 D01...D35, LRD 3pp, LRD 3ppL and LR3 D3pp	1	LA7 D03p (6)	0.090
<b>Block of insulated terminals</b>	LR9 D	2	LA9 F103	0.560
<b>IP 20 cover for lug type terminals</b> for independent mounting	LRD 3136...3656	1	LAD 96570	0.021
<b>IP 20 cover for lug type terminals</b> for mounting with contactor LC1 D40A6...D65A6	LRD 3136...3656	1	LAD 96575	0.010
<b>Terminal block for lug type terminals</b> for independent mounting	LRD 3136...3656	1	LAD 96566	0.010

### Remote control

#### "Reset" function

Description	For use with	Sold in lots of	Unit reference	Weight kg
<b>By flexible cable</b> (length = 0.5 m)	LRD 01...35, LR3 D01...D35 and LRD 313...LRD 365	1	LAD 7305 (7)	0.075
	All relays except LRD 01...35, LR3 D01...D35, LRD 3pp, LRD 3ppL and LR3 D3pp	1	LA7 D305	0.075

#### "Stop" and/or "Reset" functions

The terminal protection shroud must be removed and the following 3 products must be ordered separately:

<b>Adapter for door mounting</b>	LRD 33pp, LR2 D and LRD 15pp.	1	LA7 D1020	0.005	
<b>Operating heads</b> for spring return pushbutton	Stop	All relays	1	XB5 AL84101	0.027
	Reset	All relays	1	XB5 AA86102	0.027

(1) These pre-wiring kits cannot be used with reversing contactors.

(2) Terminal blocks are supplied with terminals protected against direct finger contact and screws in the open, "ready-to-tighten" position.

(3) To order a terminal block for connection by lugs, the reference becomes LA7 D30646.

(4) Remember to order the terminal block corresponding to the type of relay.

(5) The time for which the coil of remote tripping or electrical resetting device LA7 D03 or LAD 703 can remain energised depends on its rest time: 1 s pulse duration with 9 s rest time; 5 s pulse duration with 30 s rest time; 10 s pulse duration with 90 s rest time; maximum pulse duration 20 s with a rest time of 300 s. Minimum pulse time: 200 ms.

(6) Reference to be completed by adding the code indicating the control circuit voltage.

Standard control circuit voltages (for other voltages, please consult your Regional Sales Office):

Volts	12	24	48	96	110	220/230	380/400	415/440
50/60 Hz	—	B	E	—	F	M	Q	N
Consumption, inrush and sealed: < 100 VA								
C	J	B	E	DD	F	M	—	—

Consumption, inrush and sealed: < 100 W.

(7) Not compatible with 3-pole relays fitted with spring terminals.