


# CURRENT IN MULTIPLES OF TRIP CURRENT RATING

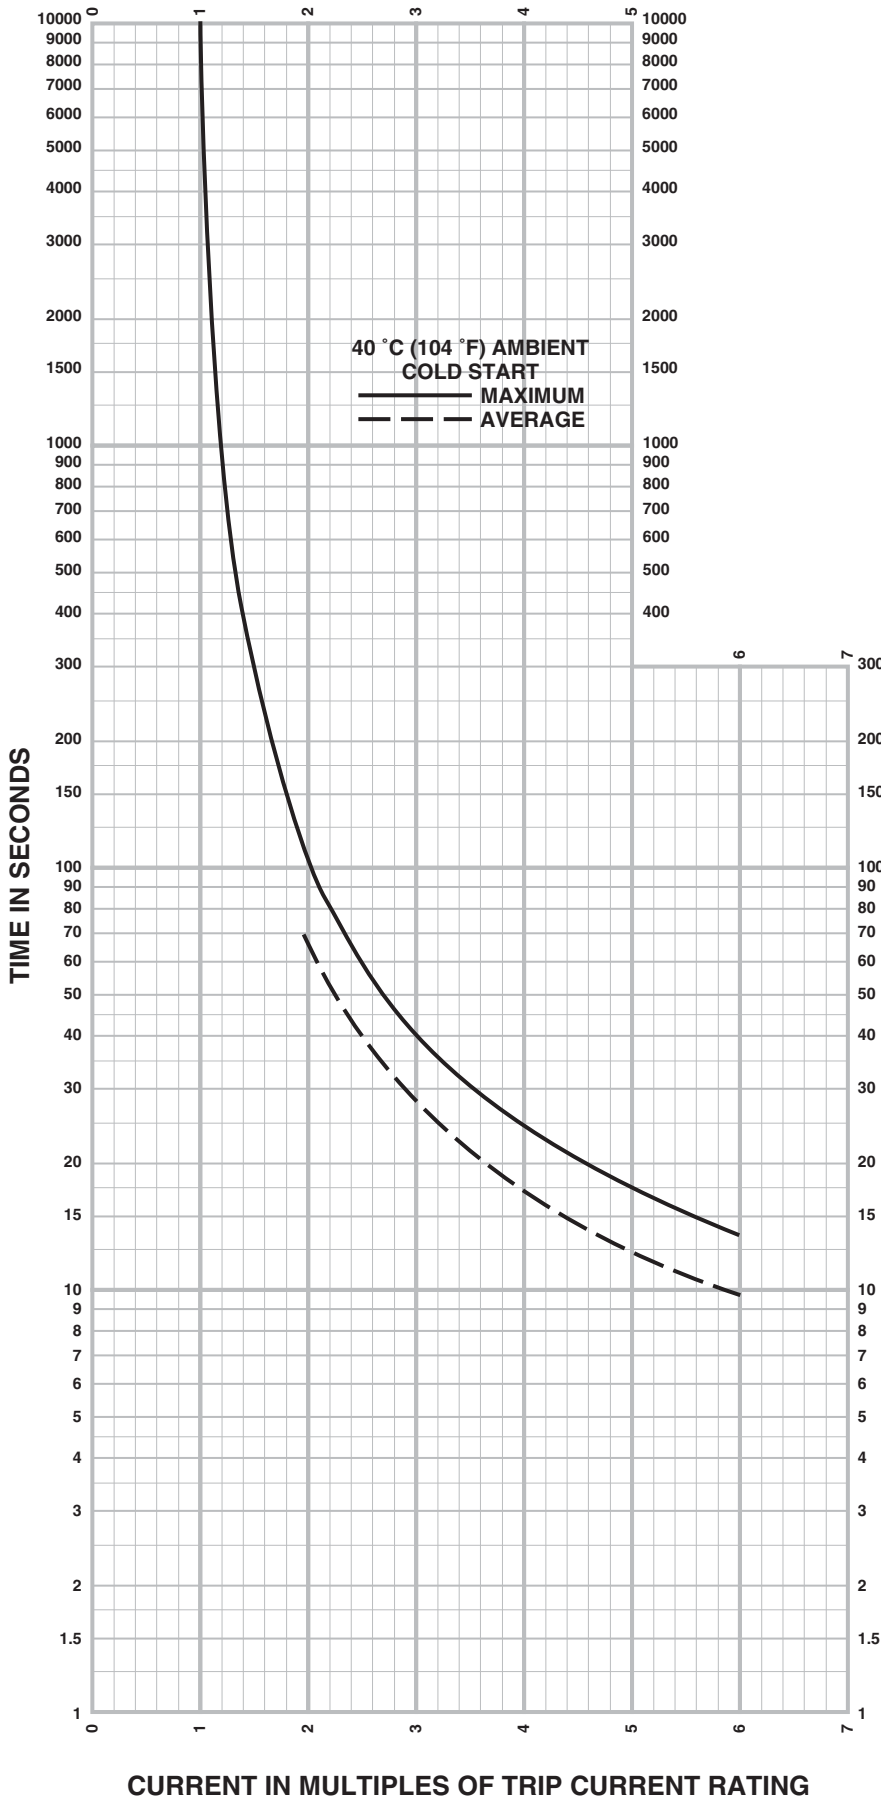

## OVERLOAD RELAY TIME-CURRENT CHARACTERISTICS REFERENCE DRAWING NO. 30068-273

Relay Design	Melting Alloy
Thermal Unit Types	DD112-DD340

40 °C ambient cold start trip time characteristics of:

Equipment	AC Magnetic Starter
Size	5
Type	SG
Qty. of Thermal Units	3

When installed in:

- Small enclosure (Class 8536 only)
- Motor Control Center (Class 8998, 8999, QMB, or I-Line®)

Trip current rating can be determined from the instructions given with appropriate thermal unit selection table. The characteristics shown do not necessarily apply to equipment manufactured before the date of the referenced drawing.