Flexible Pipe Kit Installation ACAC10011, ACAC10012, ACAC10013, ACAC10016, ACAC10017, ACAC10029

Flexible Pipe Kit Specifications

SKU	Inside Diameter	Length	Used On	
ACAC10011	1.25 in. (32 mm)	3 ft (0.9 m)		
ACAC10012	1.25 in. (32 mm)	6 ft (1.8 m)	InRow ACRC300 series	
ACAC10013	1.25 in. (32 mm)	8 ft (2.4 m)		
ACAC10016	1.50 in. (38 mm)	3 ft (0.9 m)	InRow ACRC500 series and ACRP500	
ACAC10017	1.50 in. (38 mm)	6 ft (1.8 m)	series	
ACAC10029	0.5 in. (13 mm)	9 ft (2.7 m)	InRow ACRD100 Series	


NOTE: Connections between equipment and piping are the same for all piping configurations. A top piping installation is shown. Refer to the submittal drawings for other configurations.

NOTE: ACAC10029 is only used in top piping applications.

NOTE: See the insulation thickness table for recommendations based on ambient conditions and coolant line temperatures.

Tools Required

Two 75-mm (3-in.) Adjustable Wrenches



Liquid Dish Soap



Inventory

Flex hoses

Schneider Electric

As standards, specifications, and design change from time to time, please ask for confirmation of the information given in this publication. © 2014 – 2018 Schneider Electric. All rights reserved.



.


NOTICE

DAMAGE TO EQUIPMENT


- Do not torque, over-bend, stretch, or compress hoses.
- Avoid sharp edges or rubbing. The braid is for hose strength, not protection.
- Ensure that the bends in flexible pipes are not under the minimum bend radius.
- Apply wrenches to the fittings only, not hose or weld ferrule.
- Do not alter pipe lengths: install at dimensions indicated on submittal drawings.
- For ACAC10029, exposure to temperatures greater than 538°C (1000°F) may damage internal expansion joints. Use cold strapping or other heat sink procedures to avoid exposure to temperatures exceeding 538°C (1000°F).

Failure to follow these instructions can result in equipment damage.


InRow RC 300 Series

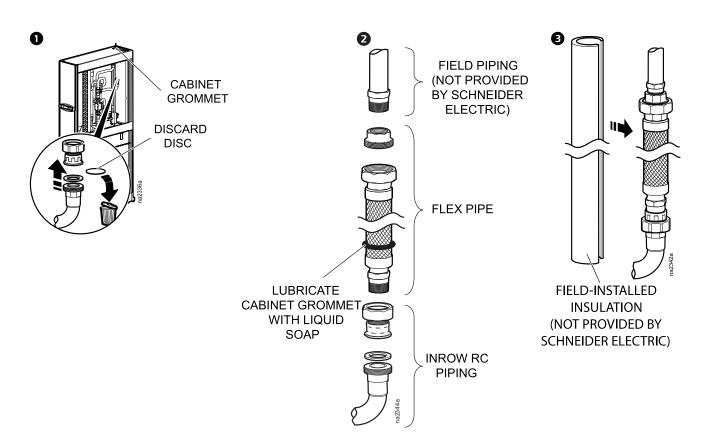


InRow RC/RP 500 Series

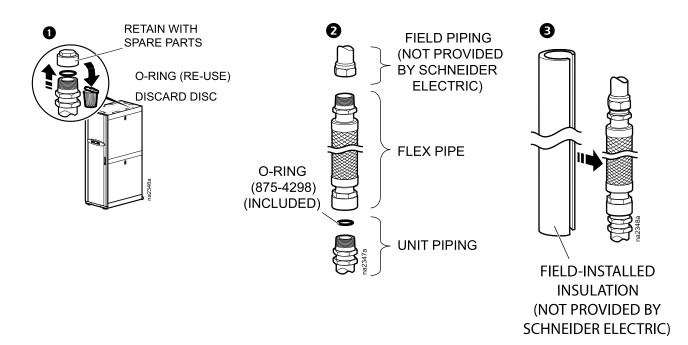

InRow RD 100 Series



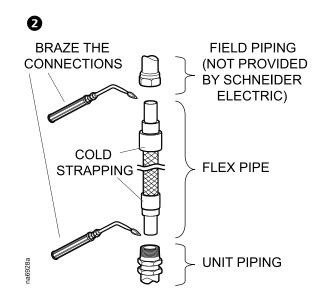

Proper Hose Installation Guidelines

- Ensure all hoses are connected as shown in the **Correct** column at right.
- · Install hoses so all bends are in the same plane.
- Install hoses so flexing takes place in the same plane as the bends.
- Observe the minimum center line bend radius for hoses: 15 in. (381 mm) for RC100 series, 18 in. (457 mm) for RC500 series or RP500 series.
- Provide dielectric coupling where applicable to protect dissimilar metals.
- Additional field-supplied components may be required for proper hose installation.
- After installation, insulate hoses (materials not provided by Schneider Electric). Follow insulation manufacturer recommendation for specific application.
- Use hangers as required to support the weight of hoses.
- Installation must comply with all national and local codes.

Insulation Thickness Recommendation to Control Condensation

	Thickness at Line Temperature		
	10°C (50°F)	2°C (35°F)	
Normal Conditions Maximum 29°C (85°F) at 70% RH	3/8 in. (10 mm)	1/2 in. (13 mm)	
Severe Conditions Maximum 32°C (90°F) at 80% RH	3/4 in. (19 mm)	1 in. (25 mm)	

*For 1-3/8 in. (35 mm) through 2-1/2 in. (64 mm) ID, Rubatex[®] "Insul-Tube[®] 180" pipe insulation (RBX Industries, Inc.) for indoor piping. Follow the respective insulation manufacturer recommendation for specific application.

NOTE: Insulation is not needed on ACAC10029 braided pipe. See the ACRD *Installation Manual* for insulation requirements on the return line.

