


REV	DESCRIPTION	BY	DATE						
---	---	---	---	---	---	---	---	---	---

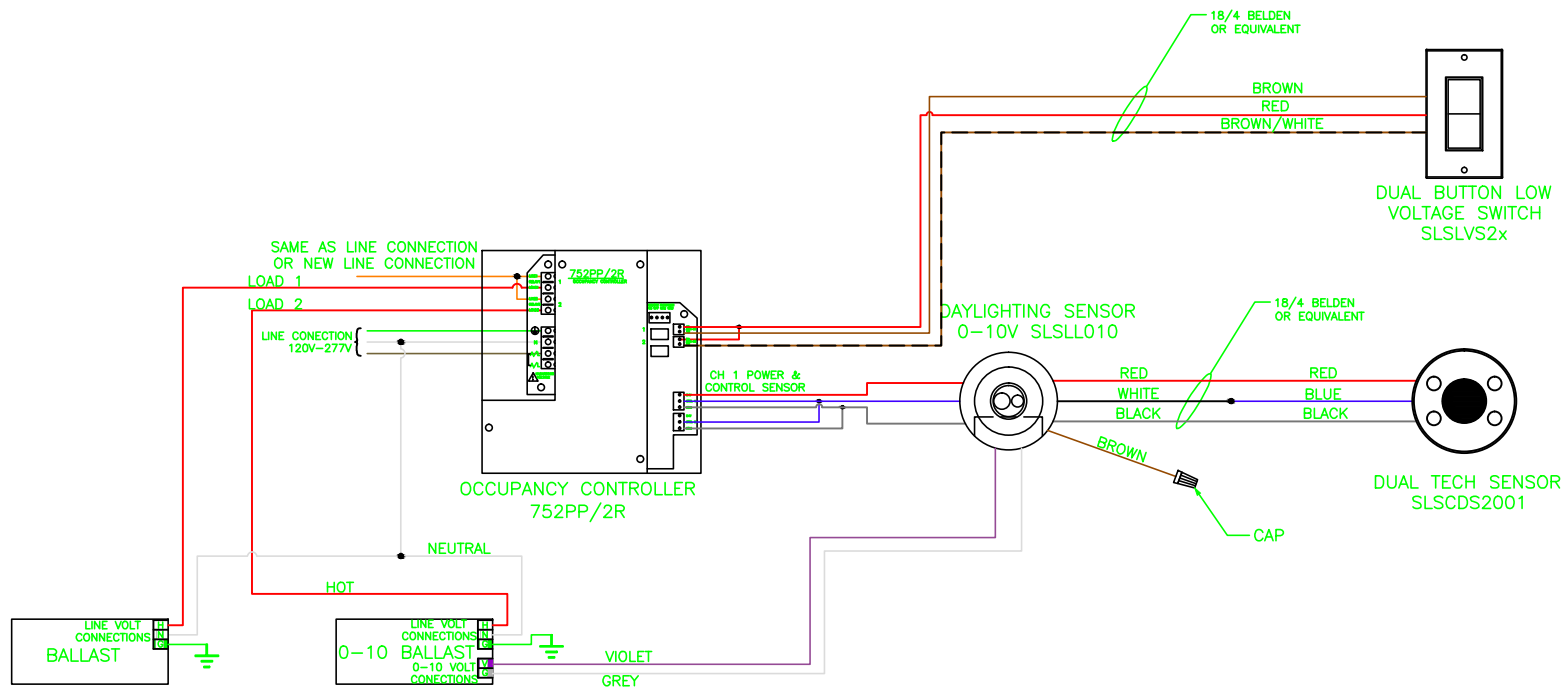

**NOTE:**  
DRAWING DEPICTS A TYPICAL NON-NETWORK APPLICATION FOR A LOBBY UP TO 2,000 SQ. FT. WITH TWO LIGHTING CHANNELS, ONE DAYLIGHT HARVESTING ZONE, AND NO RECEPTACLE-CONTROL REQUIREMENT. PROVIDES 360 DEGREE, DUAL TECHNOLOGY (PASSIVE INFRARED/PIR AND ULTRASONIC) OCCUPANCY SENSING, MANUAL ON/OFF CONTROL, AND OPTIONAL AUTO-ON SETTING PER CHANNEL. FOR THIS APPLICATION WITH AUTOMATIC OVERRIDE FOR EMERGENCY EGRESS LIGHTING, SEE SOLUTION 129E.

\*FOR TECHNICAL ASSISTANCE CONTACT SCHNEIDER ELECTRIC AT (855) 237-0788  
EMAIL:  
Quotations: Lightingcontrol.quotations@us.schneider-electric.com  
Tech Support: Lightingcontrol.support@us.schneider-electric.com

**NOTICE:**  
THIS DOCUMENT DOES NOT TAKE THE PLACE OF THE INSTRUCTION BULLETIN THAT IS PROVIDED WITH THE DEVICE. ANY ADDITIONAL INFORMATION CAN BE FOUND IN THE INSTRUCTION BULLETIN.

JOB NAME:	LIGHTING CONTROL APPLICATION
JOB LOCATION:	---
DRAWN BY:	JOHN PURVIANCE
ENGR:	HEATH MARTIN
DATE:	FEBRUARY 21, 2014
DRAWING STATUS:	---

EQUIPMENT DESIGNATION:	---
EQUIPMENT TYPE:	---
DRAWING TYPE:	LIGHTING CONTROL APPLICATION 129
DWG#	LCA129
PG1	OF1
REV-	