


REV	DESCRIPTION	BY	DATE						
---	---	---	---	---	---	---	---	---	---

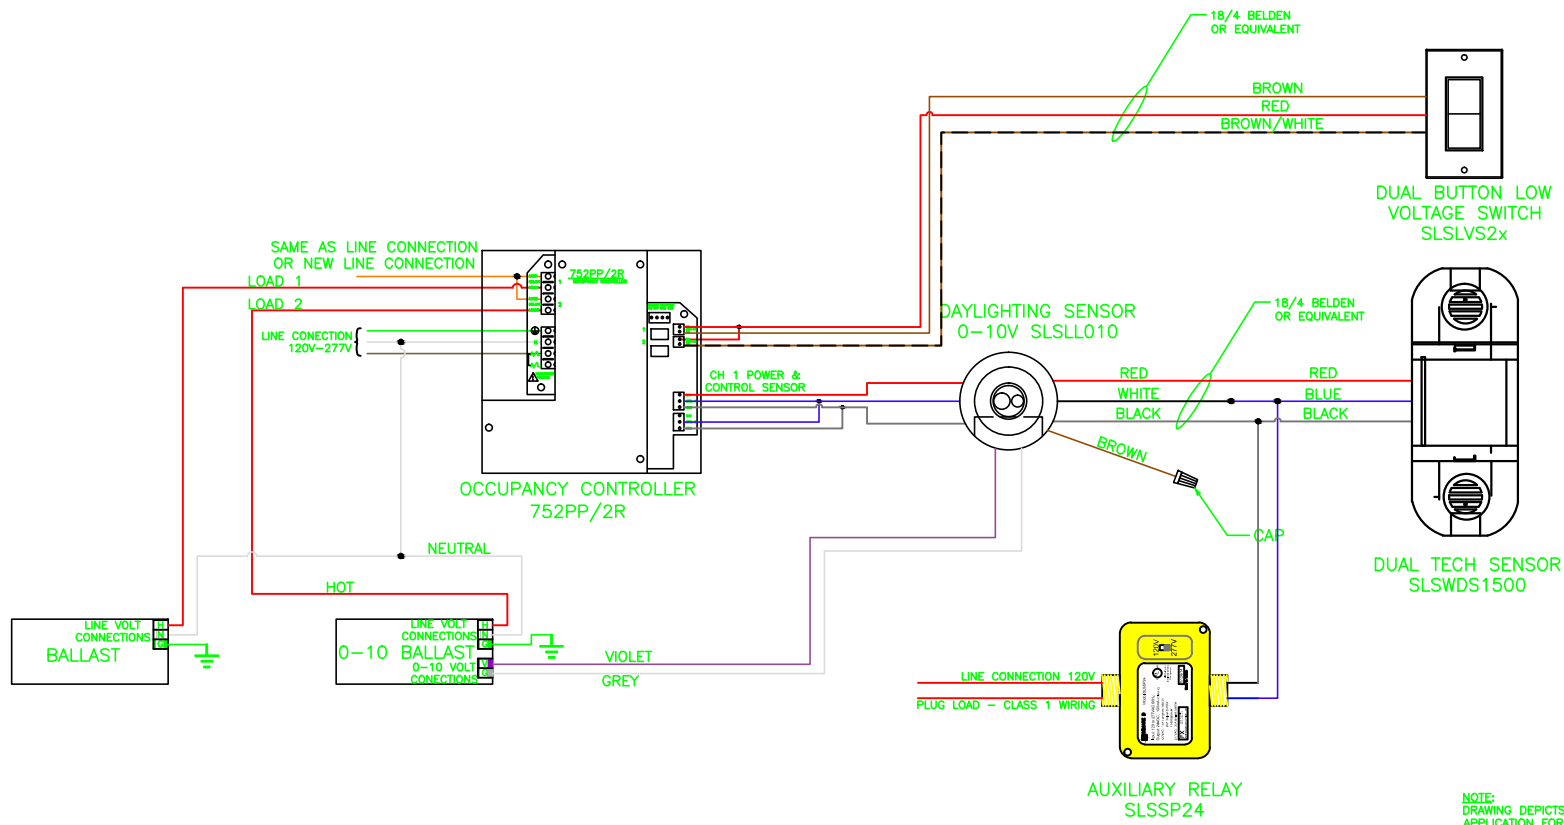

NOTE:
DRAWING DEPICTS A TYPICAL NON-NETWORK APPLICATION FOR A LOBBY UP TO 1,000 SQ. FT. WITH TWO LIGHTING CHANNELS, ONE DAYLIGHT HARVESTING ZONE, AND CONTROLLED RECEPTACLES. PROVIDES 110 DEGREE, DUAL TECHNOLOGY (PASSIVE INFRARED/PIR AND ULTRASONIC) OCCUPANCY SENSING, MANUAL ON/OFF CONTROL, AND OPTIONAL AUTO-ON SETTING PER CHANNEL. FOR THIS APPLICATION WITH AUTOMATIC OVERRIDE FOR EMERGENCY EGRESS LIGHTING, SEE SOLUTION 131E.

*FOR TECHNICAL ASSISTANCE CONTACT SCHNEIDER ELECTRIC AT (855) 237-0788
EMAIL:
Quotations: Lightingcontrol.quotations@us.schneider-electric.com
Tech Support: Lightingcontrol.support@us.schneider-electric.com

NOTICE:
THIS DOCUMENT DOES NOT TAKE THE PLACE OF THE INSTRUCTION BULLETIN THAT IS PROVIDED WITH THE DEVICE. ANY ADDITIONAL INFORMATION CAN BE FOUND IN THE INSTRUCTION BULLETIN.

JOB NAME:	LIGHTING CONTROL APPLICATION
JOB LOCATION:	---
DRAWN BY:	JOHN PURVIANCE
ENGR:	HEATH MARTIN
DATE:	FEBRUARY 21, 2014
DRAWING STATUS:	---

EQUIPMENT DESIGNATION:	---
EQUIPMENT TYPE:	---
DRAWING TYPE:	LIGHTING CONTROL APPLICATION 131
DWG#	LCA131
PG1	OF1
REV-	---