


REV	DESCRIPTION	BY	DATE						
---	---	---	---	---	---	---	---	---	---

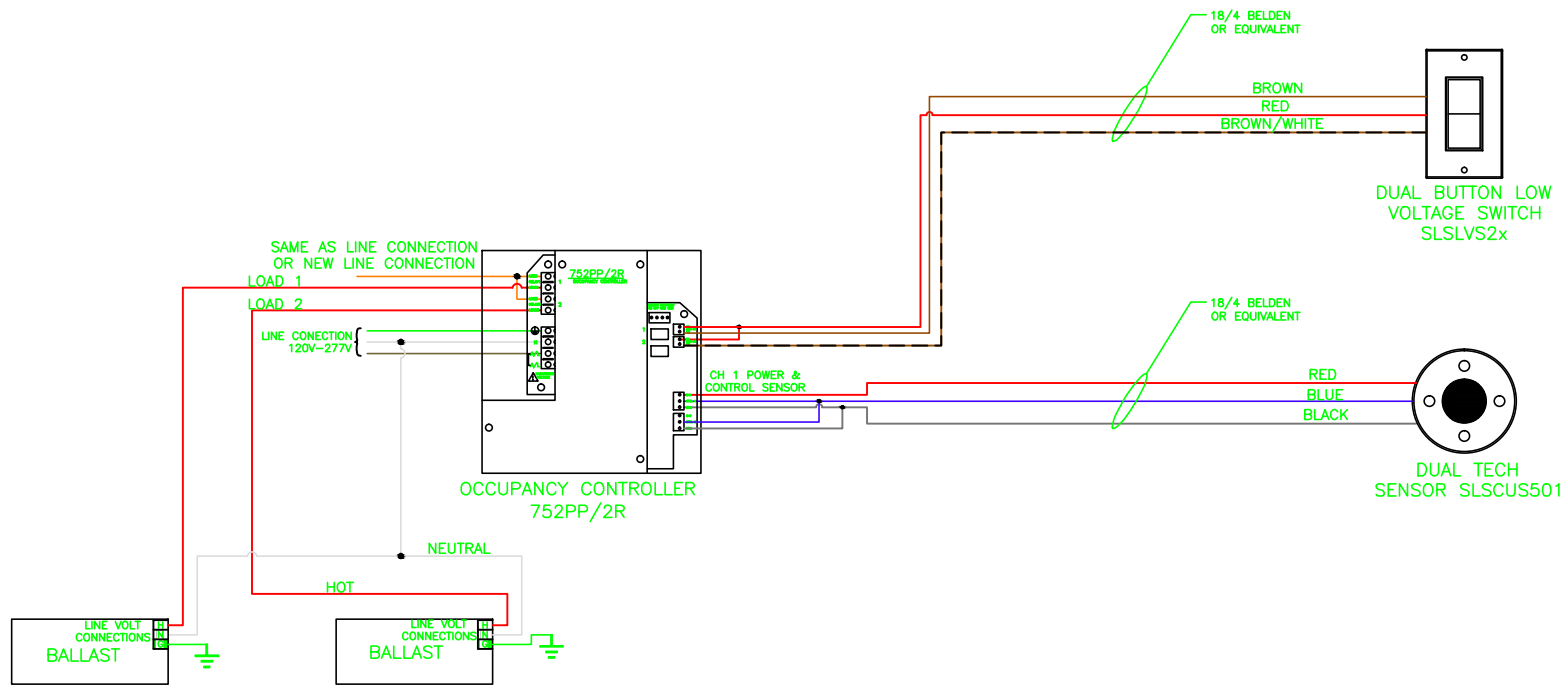

NOTE:
 DRAWING DEPICTS A TYPICAL NON-NETWORK APPLICATION FOR A ONE- TO TWO-STALL RESTROOM UP TO 500 SQ. FT. WITH TWO LIGHTING CHANNELS AND NO DAYLIGHT HARVESTING OR RECEPTACLE-CONTROL REQUIREMENTS. PROVIDES 360 DEGREE, ULTRASONIC OCCUPANCY SENSING; MANUAL ON/OFF CONTROL, AND OPTIONAL AUTO-ON SETTING PER CHANNEL. FOR THIS APPLICATION WITH AUTOMATIC OVERRIDE FOR EMERGENCY EGRESS LIGHTING, SEE SOLUTION 132E.

*FOR TECHNICAL ASSISTANCE CONTACT SCHNEIDER ELECTRIC AT (855) 237-0788
 EMAIL: Quotations: Lightingcontrol.quotations@us.schneider-electric.com
 Tech Support: Lightingcontrol.support@us.schneider-electric.com

NOTICE:
 THIS DOCUMENT DOES NOT TAKE THE PLACE OF THE INSTRUCTION BULLETIN THAT IS PROVIDED WITH THE DEVICE. ANY ADDITIONAL INFORMATION CAN BE FOUND IN THE INSTRUCTION BULLETIN.

JOB NAME:	LIGHTING CONTROL APPLICATION
JOB LOCATION:	---
DRAWN BY:	JOHN PURVIANCE
ENGR:	HEATH MARTIN
DATE:	FEBRUARY 21, 2014
DRAWING STATUS:	---

EQUIPMENT DESIGNATION:	---
EQUIPMENT TYPE:	---
DRAWING TYPE:	LIGHTING CONTROL APPLICATION 132
DWG#	LCA132
PG1	OF1
REV-	