


IEC SYSTEM FOR MUTUAL RECOGNITION OF TEST CERTIFICATES FOR ELECTRICAL EQUIPMENT  
(IECEE) CB SCHEME

## CB TEST CERTIFICATE


Product	Residual current operated circuit-breakers with integral overcurrent protection for household and similar uses (RCBOs)
Name and address of the applicant	SCHNEIDER ELECTRIC INDUSTRIES SAS 31 rue Pierre Mendès France, Eybens F-38050 Grenoble Cedex 9 France
Name and address of the manufacturer	SCHNEIDER ELECTRIC INDUSTRIES SAS 31 rue Pierre Mendès France, Eybens F-38050 Grenoble Cedex 9 France
Name and address of the factory	<input type="checkbox"/> Additional information on page 2 SCHNEIDER ELECTRIC ESPAÑA, S.A. Camino Barranquet, 57 46133 Meliana (Valencia) Spain
Note: When more than one factory, please report on page 2	
Ratings and principal characteristics	1P+N – Un = 230 V – Curve B or C – In = 4, 6, 10, 13, 16, 20, 25, 32 or 40 A type A, Asi or AC – IΔn = 10, 30 or 300 mA – Icn = 6000 A – IΔm = 3000 or 4500 A (see also Additional Sheet and pages 6, 8 and 9 of Test Report PB20-0052000-01-00)
Trademark (if any)	 Schneider Electric
Customer's Testing Facility (CTF) Stage used	
Model / Type Ref.	Series DPN Vigi (see also Additional Sheet and pages 8 and 9 of Test Report PB20-0052000-01-00)
Additional information (if necessary may also be reported on page 2)	<input type="checkbox"/> Additional information on page 2
A sample of the product was tested and found to be in conformity with	IEC 61009-1:2010, IEC 61009-1:2010/AMD1:2012, IEC 61009-1:2010/AMD2:2013, IEC 61009-2-1:1991  National differences: EU Group Differences
As shown in the Test Report Ref. No. which forms part of this Certificate	PB20-0052000-01-00 and from PB20-0052000-01-01 to PB20-0052000-01-31

This CB Test Certificate is issued by the National Certification Body

IMQ S.p.A.  
Via Quintiliano 43, IT-20138 Milano, Italy

**Description of the generic reference of the residual current operated circuit-breakers  
with integral overcurrent protection for household and similar uses (RCBOs) series DPN Vigi**

**P1B 6000**

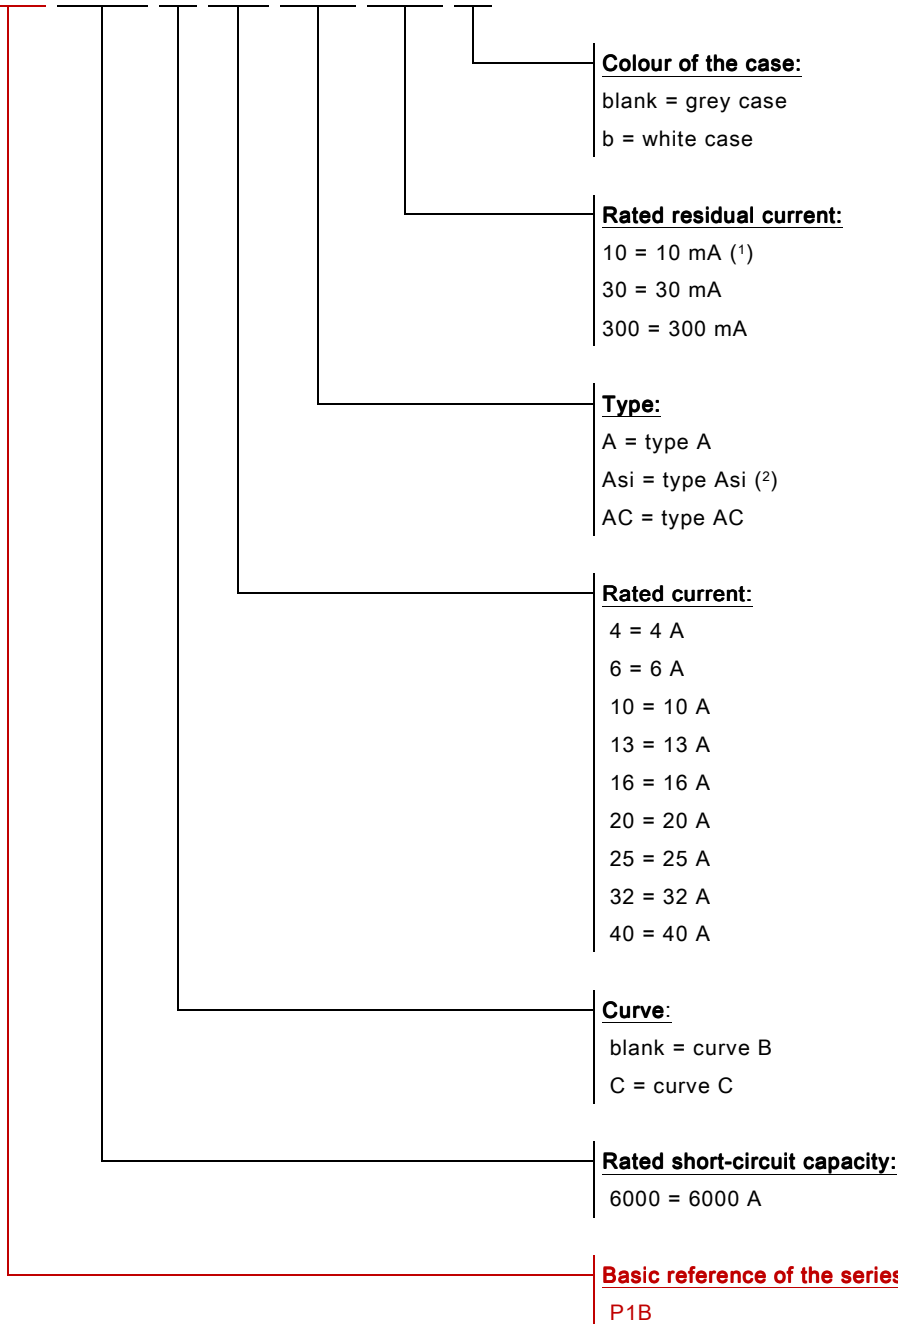

(1) – Available only for RCBOs:

- Curve B, rated current 16 A, type A
- Curve C, rated current 10 and 16 A, type A

(2) – Available for RCBOs curve C only.

“Asi”-type RCBOs are A-type RCBOs having an intentional short-time delay.