

DEMKO CERTIFICATE

Certificate No. D-06841
Page 1/3
Date of Issue 2018-10-11

Certificate Holder Schneider Electric Industries SAS
35 Rue Joseph Monier
Rueil Malmaison, 92500 France

Manufacturer Schneider Electric Industries SAS
35 Rue Joseph Monier
Rueil Malmaison, 92500 France

Production site ELDA-Eltra Elektrotechnika S.A.
ul. Bugno 1
Szczecinek, 78 400 Poland

Certified Product Model Installation female connector for fixed installation
S1B96391, S1B96570

Trademark



Rated Voltage / Frequency 250 V~, 20 A

Rated Current / Power -

Insulation Class -

Degree of protection (IP) 30

Tested acc. to EN 61535:2009/A1:2013, EN 61535:2009

Test Report No. 1811050 issued on 2018-08-16

Additional This Certificate replaces earlier issued Demko Certificate No.
D-04292.

Expire date 2023-08-16

Certification Manager
Jan-Erik Storgaard

This is to certify that representative sample(s) of the Product described herein ("Certified Product") have been investigated and found in compliance with the Standard(s) indicated on this Certificate, in accordance with the D Mark Requirements. The Designated Certificate holder is entitled to use the d or for cables <DEMKO> for the Certified Product manufactured at the production site(s) identified above, in accordance with the D Mark Service Agreement, including without limitation the D Mark Testing and Certification Services Service Terms. Only those Products bearing the D Mark should be considered as being covered by UL's D Mark Service. This Certificate shall remain valid through the expiration date, unless terminated earlier in accordance with the Service Agreement including without limitation if the Standard identified on this Certificate is amended or withdrawn prior to the expiration date.

Certification Body

UL International Demko A/S, Borupvang 5A, DK-2750
Ballerup, Denmark, Tel. +45 44 85 65 65,
info.dk@ul.com
www.ul-europe.com



Appendix DEMKO CERTIFICATE

Certificate No. D-06841
Page 2/3
Date of Issue 2018-10-11

Additional Information:

S1B96391:

With screwless terminals. Rated impulse voltage 4kV. Non-readily. Rewirable installation female connector 2P+E tested with cord rigid (solid and stranded) 1,5/2,5 mm² is intended to be use together with Schneider Electric socket-outlets (dedicated for trunking systems).

S1B96570:

With screw terminals. Rated impulse voltage 4kV. Non-readily. Rewirable installation female connector 2P+E tested with cord rigid (solid and stranded) and flexible 1,5/2,5 mm² is intended to be use together with Schneider Electric socket-outlets (dedicated for trunking systems).


Certification Body

UL International Demko A/S, Borupvang 5A, DK-2750
Ballerup, Denmark, Tel. +45 44 85 65 65, info.dk@ul.com
www.ul-europe.com



Appendix DEMKO CERTIFICATE

Certificate No. D-06841
Page 3/3
Date of Issue 2018-10-11

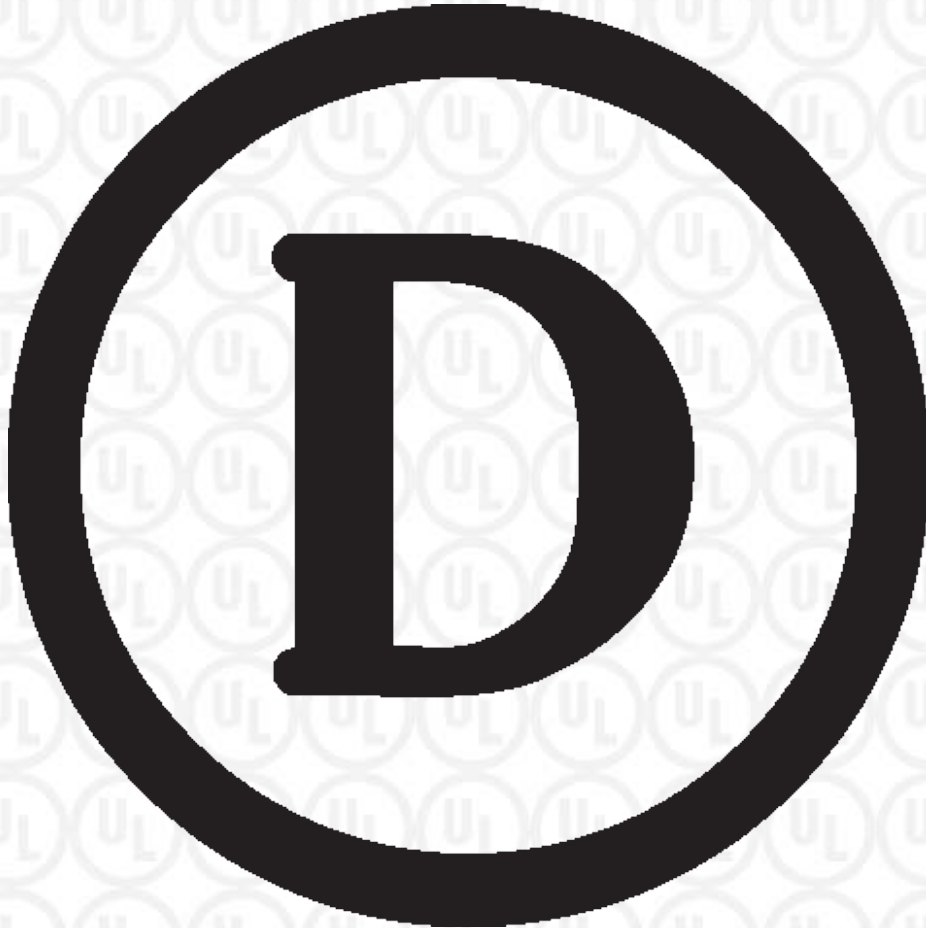

Certification Body

UL International Demko A/S, Borupvang 5A, DK-2750
Ballerup, Denmark, Tel. +45 44 85 65 65, info.dk@ul.com
www.ul-europe.com

