

# CENELEC CERTIFICATION AGREEMENT

ACCORD DE CERTIFICATION DU CENELEC

CENELEC-ZERTIFIZIERUNGS-ABKOMMEN



## STATEMENT OF TEST RESULTS

STR/2513/IMQ

Product	Circuit-breakers for overcurrent protection for household and similar installations
Tested by request of	SCHNEIDER ELECTRIC INDUSTRIES SAS Electropole 31 Rue Pierre Mendes France, Eybens 38050 GRENOBLE CEDEX 9 (France)
Manufactured at (name and place)	SCHNEIDER (THAILAND) LTD 10280 SAMUTPRAKARN (Thailand)
Preliminary visit carried out by	-
Rating and principal characteristics	1P - 1P+N - 2P (230 V); 3P - 3P+N - 4P (400 V); 50-60 Hz; In 6-10-13-16-20-25-32 A; Curve C; Icn 6000 A (see Additional Sheet and Test Report Ref. No. PB15S0483362-01-00)
Trade mark (if any)	
Model/Type Ref.	Series EASY9 6000A (See Additional Sheet)
Additional information (if necessary)	-
A sample of the product has been tested and found to be in conformity with (HD/EN and equivalent national standard)	
<b>EN 60898-1:2003 + A1:2004 + A11:2005 + A12:2008 + A13:2012</b>	
as shown in the test reports (reference No.)	<b>PB15S0483362-01-00;</b> <b>from PB15S0483362-01-01 to PB15S0483362-01-20</b>

This Statement of Test Results is the result of testing a sample of the product submitted, in accordance with the provisions of the above mentioned standard.

This Statement of Test Results has been established by a body which participates in the CENELEC Certification Agreement (CCA) of 11<sup>th</sup> September 1973 as amended on 29<sup>th</sup> March 1983 and September 3<sup>rd</sup>, 2004 (including addendum 1 dated July 1984, addendum 2 dated March 1987, addendum 3 dated September 1989 and addendum 4 dated March 1995). Any other body participating in the CCA may recognize this Statement as a basis for granting a national mark of conformity or a national approval, as specified in OD 6, List of current decisions of CCA Group, point 2.11.

**IMQ S.p.A**

Signature of the authorized person, \_\_\_\_\_

Name (and function of the authorized person),

**Mauro Casari**  
**Product Department**  
**Certification Unit – Voluntary Marks**  
**Unit Manager**


Milano, 2015-07-30

20138 MILANO – Via Quintiliano, 43 – ITALY

Tel.: (+39) 02-50731  
Fax.: (+39) 02-50991500  
e-mail: info@imq.it

### Description of the code of Series EASY9 6000A

Rated voltage: 230V (1P; 1P+N; 2P); 400V (3P; 3P+N; 4P)

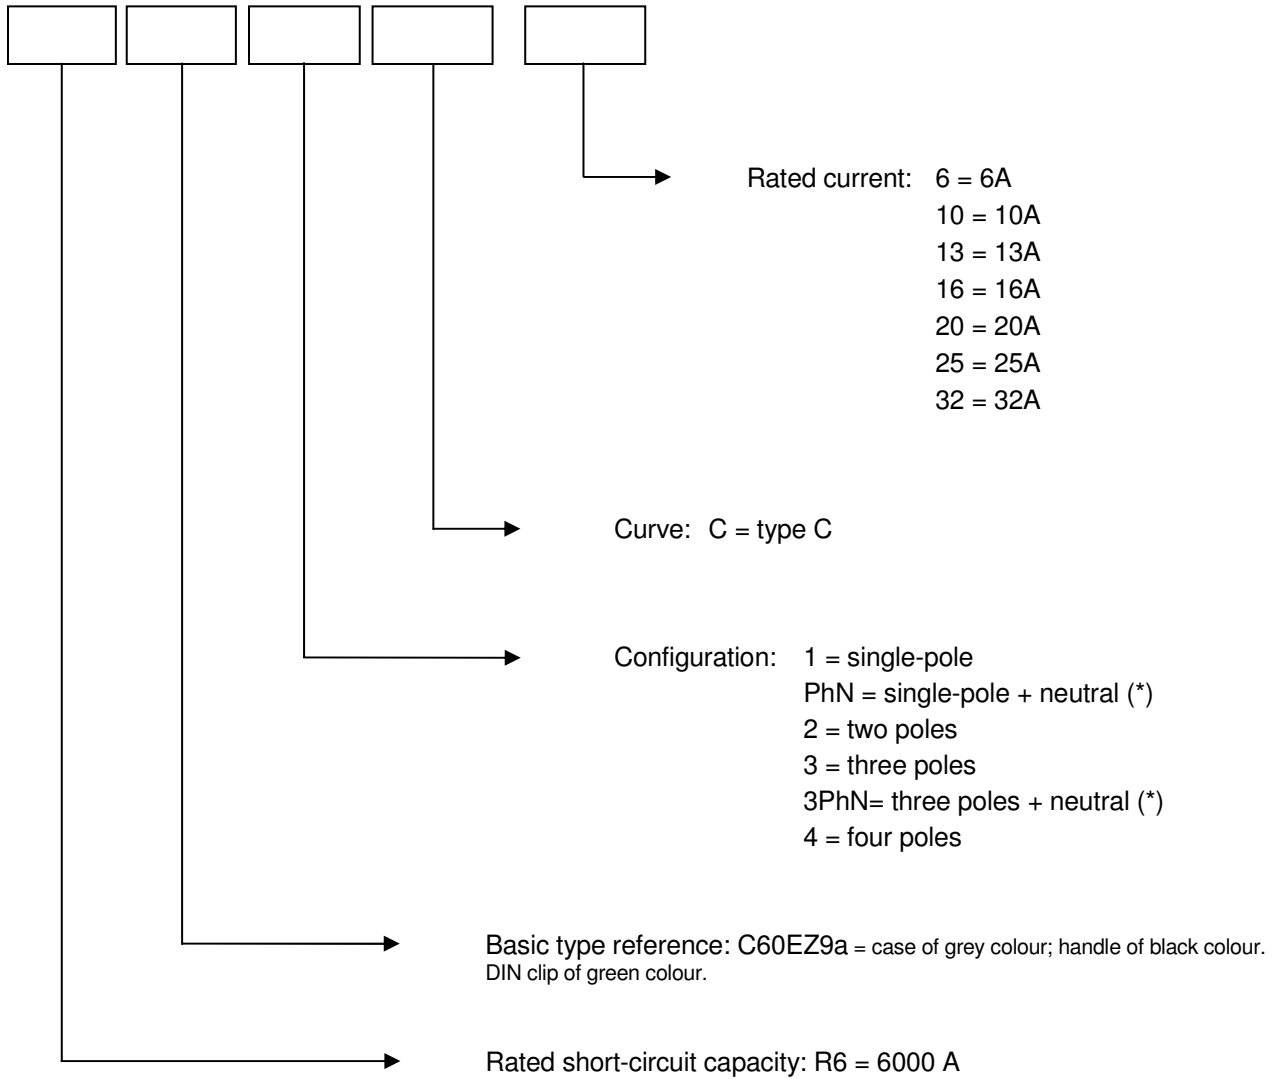

(\*) Version with the neutral pole on the left or on the right.