

# CENELEC CERTIFICATION AGREEMENT

ACCORD DE CERTIFICATION DU CENELEC

CENELEC-ZERTIFIZIERUNGS-ABKOMMEN



## STATEMENT OF TEST RESULTS

STR/2519/IMQ

Product	Circuit-breakers for overcurrent protection for household and similar uses
Tested by request of	SCHNEIDER ELECTRIC INDUSTRIES SAS Electropole 31, rue Pierre Mendes 38050 GRENOBLE CEDEX 9 - FRANCE
Manufactured at (name and place)	SCHNEIDER ELECTRIC THAILAND CO. LTD 509 Soi 9 Bangpoo Ind. Estate, Sukmvit Rd., Muang District 10280 SAMUTPRAKAM - Thailand
Preliminary visit carried out by	-
Rating and principal characteristics	1P - 1P+N - 2P (230V); 3P - 3P+N - 4P (400V); In 6-10-13-16-20-25-32 A; Curve C; Icn 4500 A; energy limiting class 3
Trade mark (if any)	
Model/Type Ref.	Series EASY 9 4500 A (see Additional Sheet)
Additional information (if necessary)	-
A sample of the product has been tested and found to be in conformity with (HD/EN and equivalent national standard)	
<b>EN 60898-1:2003 + A1:2004 + A11:2006 + A12:2008 + A13:2012</b>	
as shown in the test reports (reference No.) <b>from PB15S0491568-05-00 to PB15S0491568-05-19</b>	

This Statement of Test Results is the result of testing a sample of the product submitted, in accordance with the provisions of the above mentioned standard.

This Statement of Test Results has been established by a body which participates in the CENELEC Certification Agreement (CCA) of 11<sup>th</sup> September 1973 as amended on 29<sup>th</sup> March 1983 and September 3<sup>rd</sup>, 2004 (including addendum 1 dated July 1984, addendum 2 dated March 1987, addendum 3 dated September 1989 and addendum 4 dated March 1995). Any other body participating in the CCA may recognize this Statement as a basis for granting a national mark of conformity or a national approval, as specified in OD 6, List of current decisions of CCA Group, point 2.11.

**IMQ S.p.A**

Signature of the authorized person, \_\_\_\_\_

Name (and function of the authorized person),

**Mauro Casari**  
Product Department  
Certification Unit – Voluntary Marks  
Unit Manager


Milano, 2015-11-20

20138 MILANO – Via Quintiliano, 43 – ITALY

Tel.: (+39) 02-50731  
Fax.: (+39) 02-50991500  
e-mail: info@imq.it

Description of series EASY 9 4500 A

Description of the code

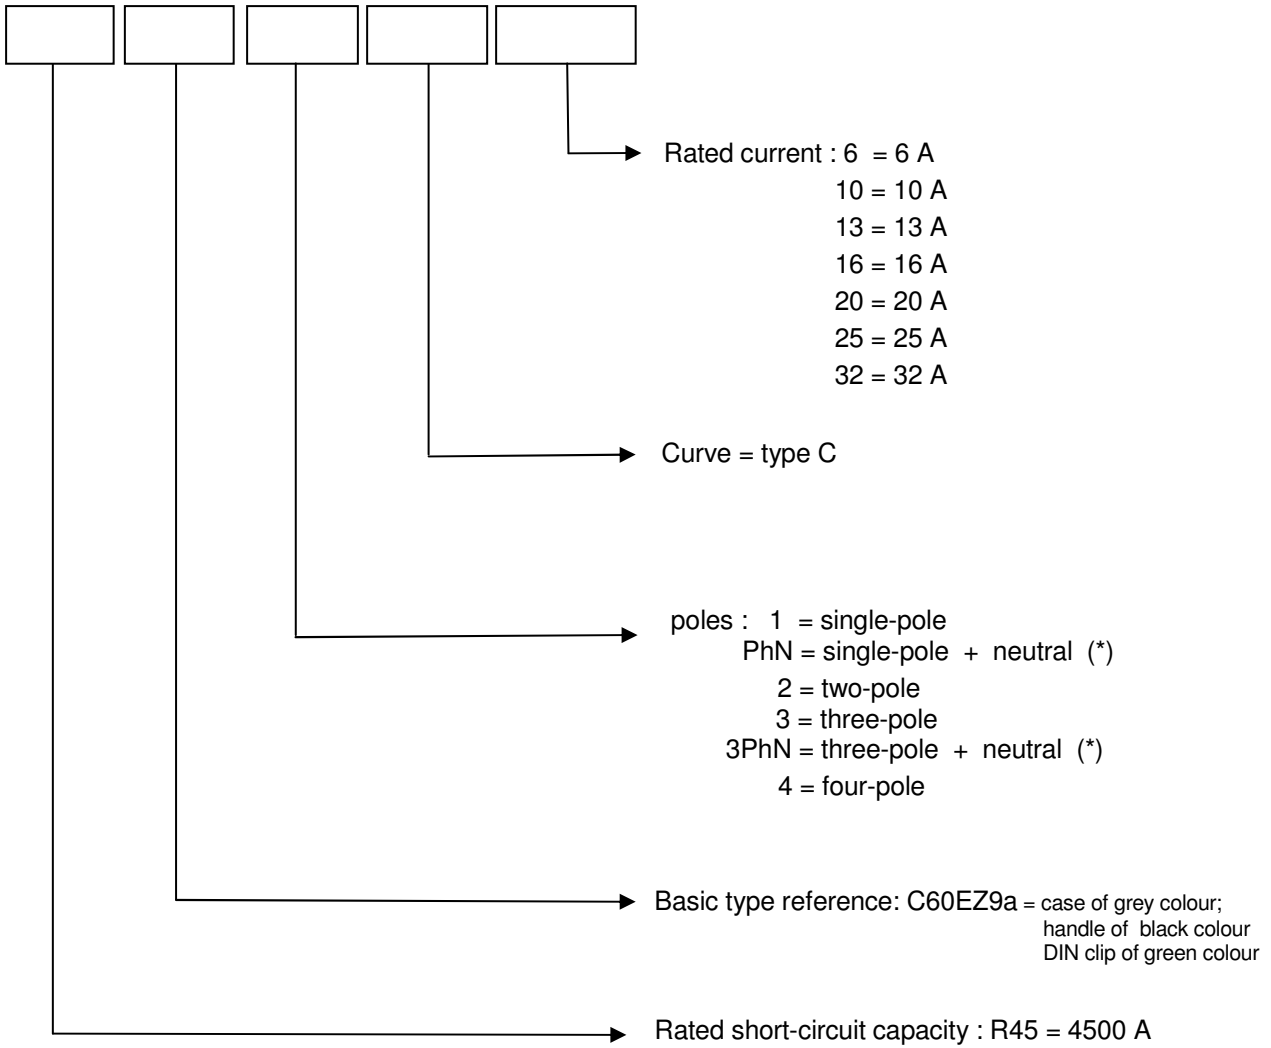

(\*) Version with the neutral pole on the left or with the neutral pole on the right