

CENELEC CERTIFICATION AGREEMENT

ACCORD DE CERTIFICATION DU CENELEC

CENELEC-ZERTIFIZIERUNGS-ABKOMMEN



STATEMENT OF TEST RESULTS

STR/2520/IMQ

Product	Circuit-breakers for overcurrent protection for household and similar uses
Tested by request of	SCHNEIDER ELECTRIC INDUSTRIES SAS Electropole 31, rue Pierre Mendes 38050 GRENOBLE CEDEX 9 - FRANCE
Manufactured at (name and place)	- SCHNEIDER ELECTRIC THAILAND CO. LTD 509 Soi 9 Bangpoo Ind. Estate, Sukmvit Rd., Muang District 10280 SAMUTPRAKAM - Thailand - SCHNEIDER ELECTRIC BULGARIA EOOD Plovdiv Plant 4202 RADINOVO - Bulgaria
Preliminary visit carried out by	-
Rating and principal characteristics	1P (230/400V); 1P+N (230V); 2P - 3P - 4P (400V); In 6-10-13-16-20-25-32 A; Curve C; Icn 6000 A; energy limiting class 3
Trade mark (if any)	
Model/Type Ref.	Series iK60N (see Additional Sheet)
Additional information (if necessary)	-
A sample of the product has been tested and found to be in conformity with (HD/EN and equivalent national standard)	
EN 60898-1:2003 + A1:2004 + A11:2006 + A12:2008 + A13:2012	
as shown in the test reports (reference No.) from PB15S0491568-06-00 to PB15S0491568-06-19	

This Statement of Test Results is the result of testing a sample of the product submitted, in accordance with the provisions of the above mentioned standard.

This Statement of Test Results has been established by a body which participates in the CENELEC Certification Agreement (CCA) of 11th September 1973 as amended on 29th March 1983 and September 3rd, 2004 (including addendum 1 dated July 1984, addendum 2 dated March 1987, addendum 3 dated September 1989 and addendum 4 dated March 1995). Any other body participating in the CCA may recognize this Statement as a basis for granting a national mark of conformity or a national approval, as specified in OD 6, List of current decisions of CCA Group, point 2.11.

IMQ S.p.A

Signature of the authorized person, _____

Name (and function of the authorized person),


Mauro Casari

**Product Department
Certification Unit – Voluntary Marks
Unit Manager**

Milano, 2015-11-20

Description of series iK60N

Description of the code

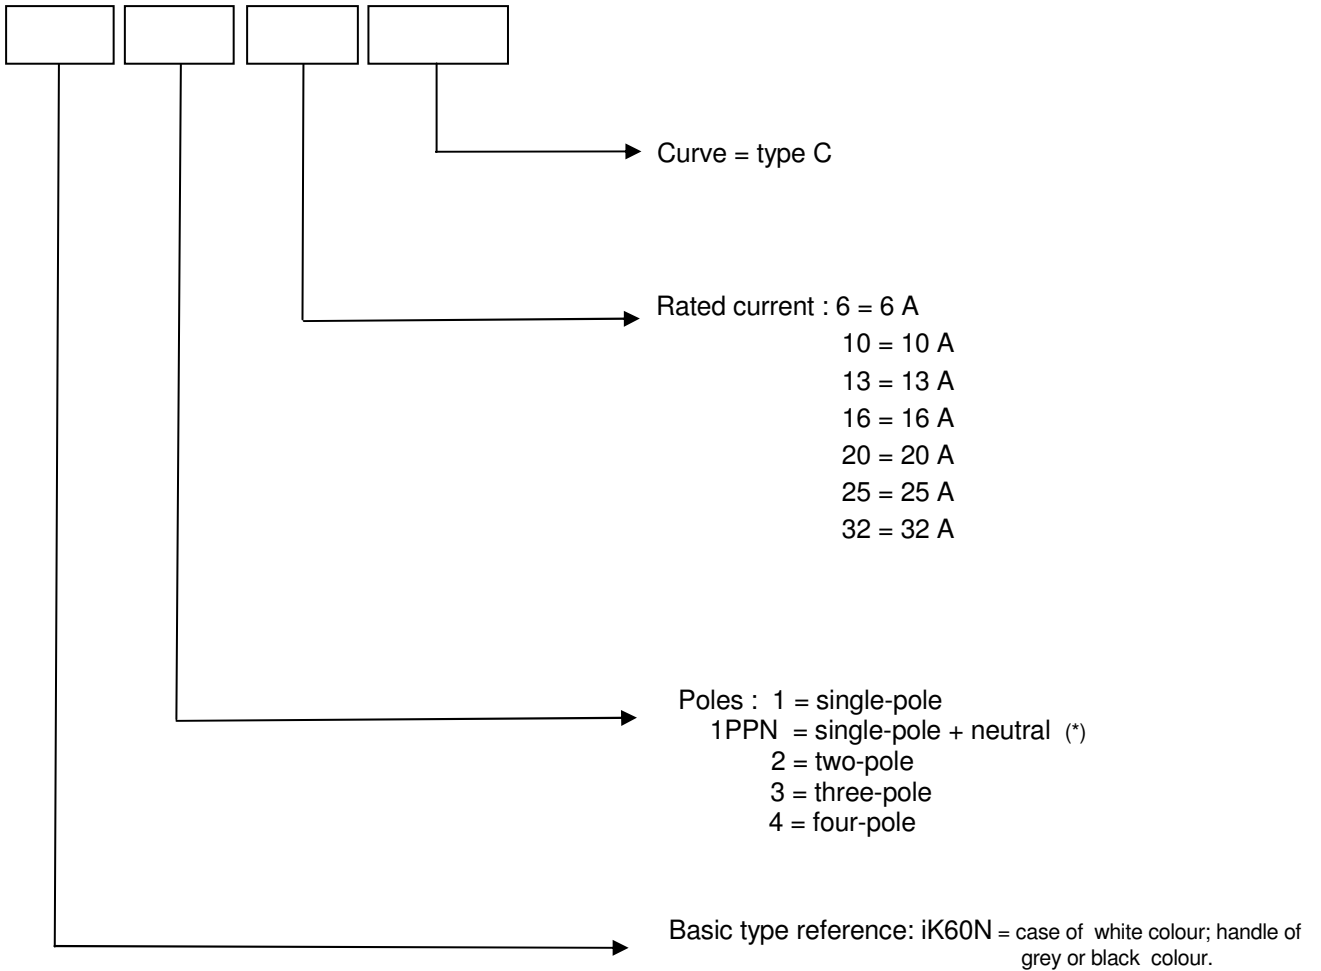

(*) neutral pole on the left