



CONTROL CIRCUIT

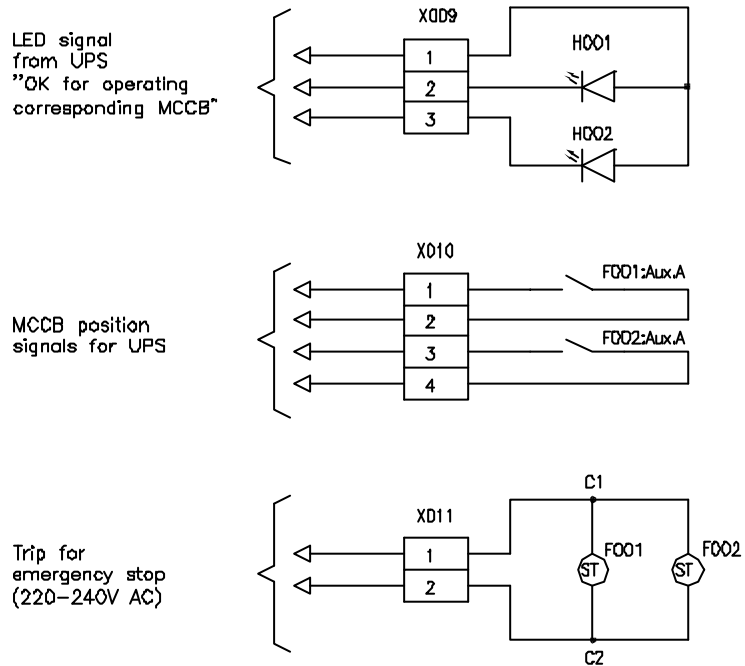

NOTE:
 ST : Shunt trip
 C1,C2 : Shunt trip coil connections

POWER CIRCUIT

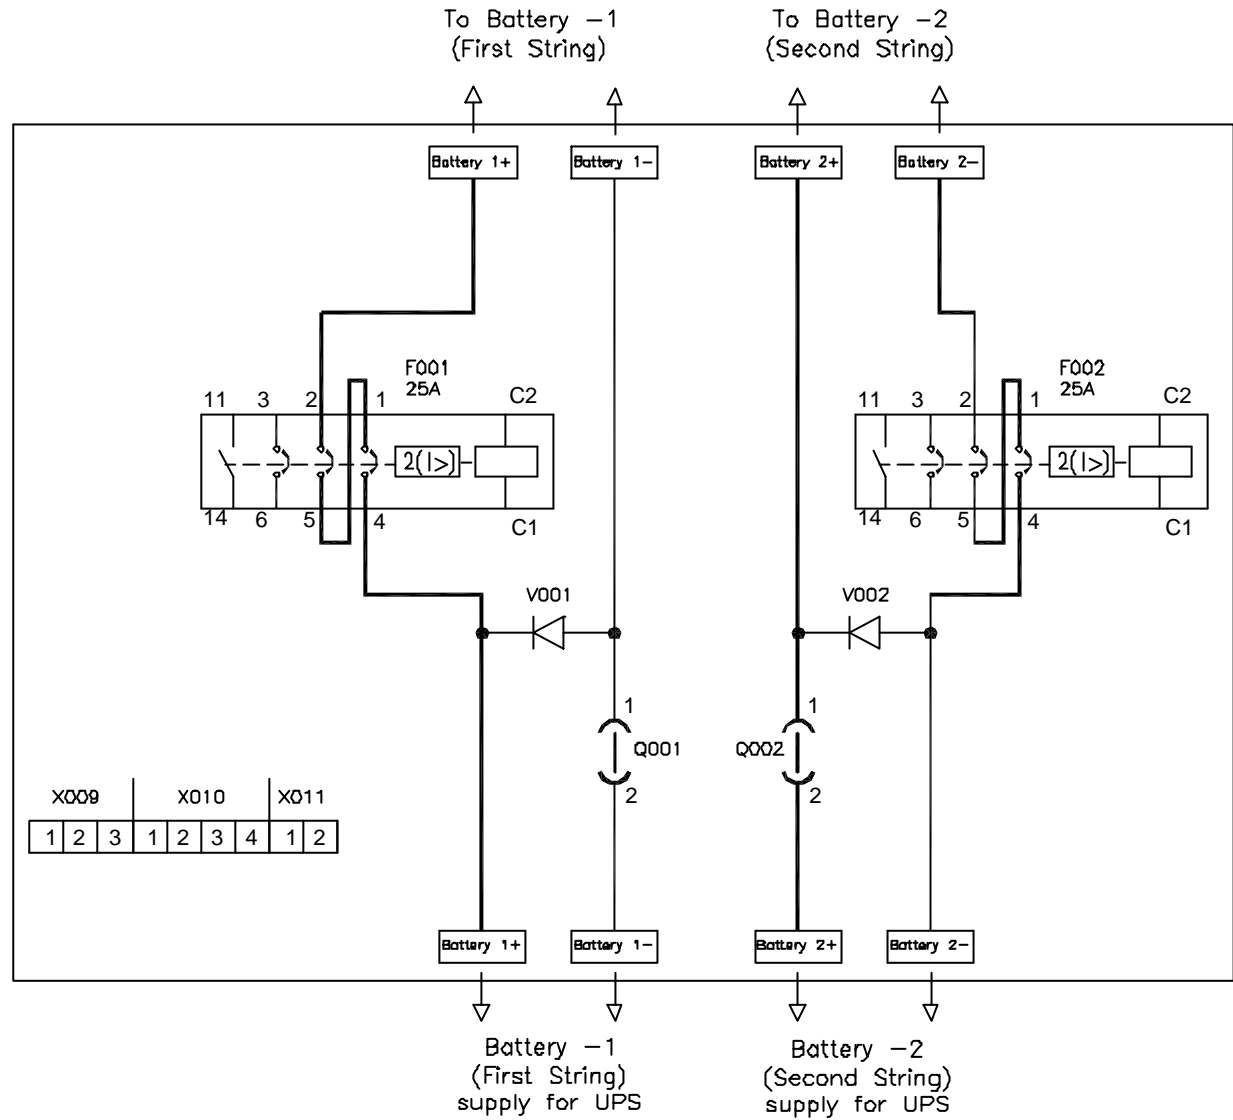


THIS DRAWING AND SPECIFICATIONS HEREIN ARE THE PROPERTY OF AMERICAN POWER CONVERSION AND SHALL NOT BE COPIED, REPRODUCED OR USED IN WHOLE OR IN PART, AS THE BASIS FOR THE MANUFACTURE OR SALE OF ITEMS WITHOUT WRITTEN PERMISSION FROM APC. THIS DRAWING IS BASED UPON LATEST AVAILABLE INFORMATION AND IS SUBJECT TO CHANGE WITHOUT NOTICE.

TITLE: SILCON 10KW UPS
 BATTERY BREAKER BOX -
 ELECTRICAL SCHEMATIC
 10kW, 48V
 PROJECT: SUBMITTAL DRAWINGS SHEET 1 OF 1


DWG NO: SBB10KH-ES
 DRAWN: B. Srinivasan 04/01/02
 CHECKED: M. Subrah 04/01/02
 ENGINEER: C. Raghav/S. Mohan 04/01/02

REV: -
 SCALE: NTS
 PRODUCTION




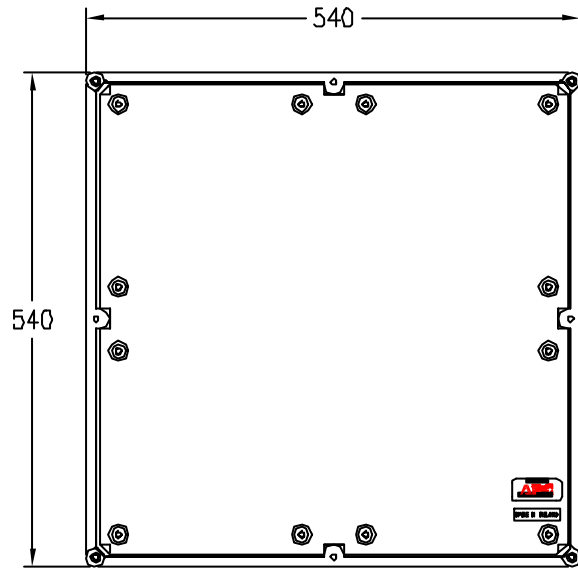


FRONT VIEW

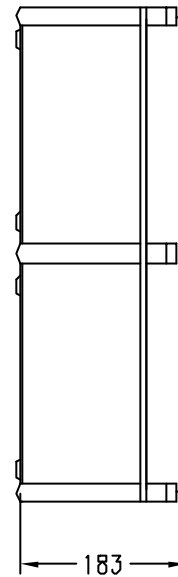

LEFT SIDE VIEW

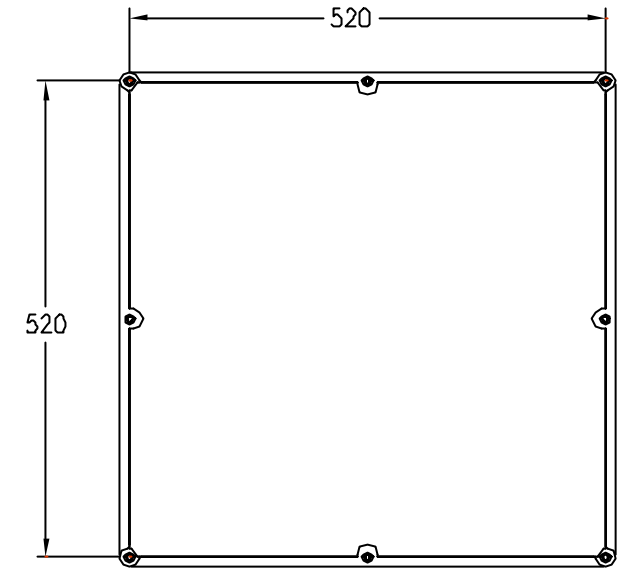

REAR VIEW
(MOUNTING LOCATIONS OF WALL FIXING LUGS)

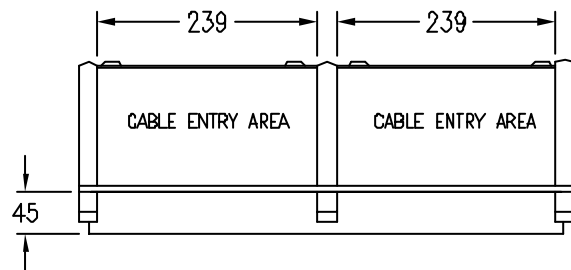

TOP VIEW

NOTES:

1. ALL DIMENSIONS ARE IN MILLIMETERS.
2. MINIMUM SERVICE CLEARANCE IS 914 FRONT.
3. CONDUIT ENTRY IS TOP OR BOTTOM OF UNIT.
4. UNIT WEIGHT IS 20 kg.
5. INSTALLATION MUST COMPLY WITH ALL APPLICABLE NATIONAL AND LOCAL STANDARDS.

THIS DRAWING AND SPECIFICATIONS HEREIN ARE THE PROPERTY OF AMERICAN POWER CONVERSION AND SHALL NOT BE COPIED, REPRODUCED OR USED IN WHOLE OR IN PART, AS THE BASIS FOR THE MANUFACTURE OR SALE OF ITEMS WITHOUT WRITTEN PERMISSION FROM APC. THIS DRAWING IS BASED UPON LATEST AVAILABLE INFORMATION AND IS SUBJECT TO CHANGE WITHOUT NOTICE.

TITLE: SILCON 10kW UPS
BATTERY BREAKER BOX -
MAIN MECHANICAL
10kW, 400V

DWG NO: SBB10KH-MM

REV. 1


DRAWN: Bakarmurjan 04/01/02 SCALE: 1:1

CHECKED: Yegiah 04/01/02 PROJECTION


PROJECT: SUBMITTAL DRAWINGS SHEET 1 OF 1

ENGINEER: G.Rodford 04/01/02




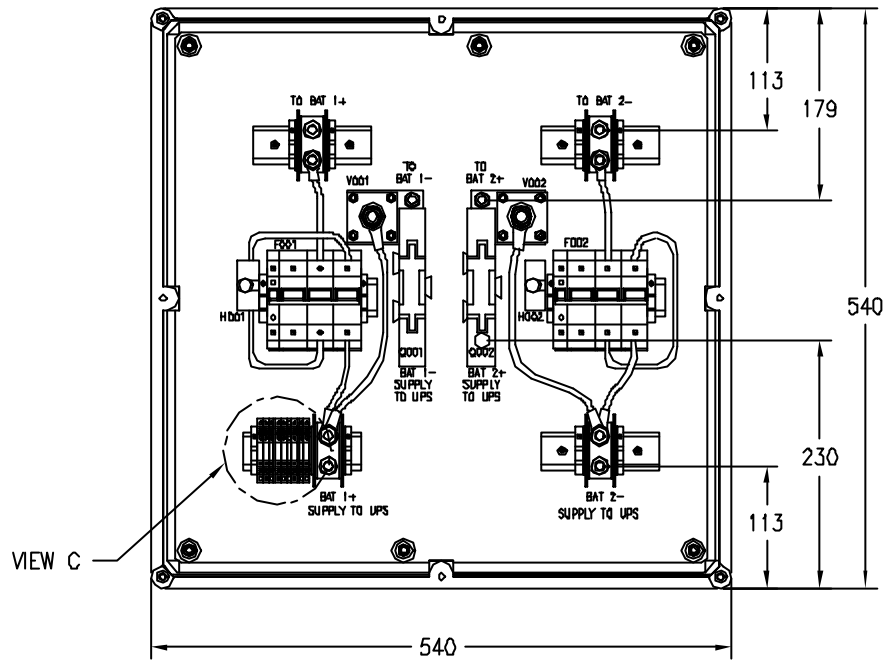


FRONT VIEW
(DOOR AND POLYCARBONATE COVER REMOVED)

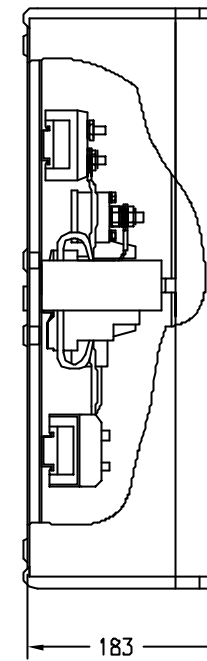

LEFT SIDE VIEW
(POLYCARBONATE COVER REMOVED)

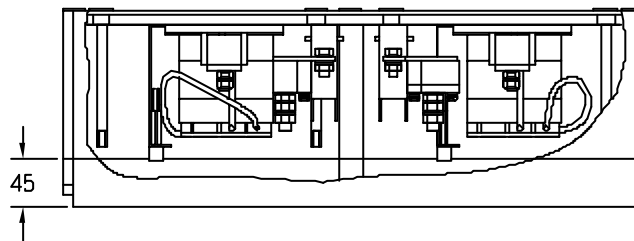

TOP VIEW
(POLYCARBONATE COVER REMOVED)

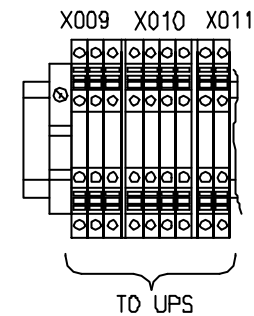

VIEW C (ENLARGED)
CONTROL WIRING

NOTES:

1. ALL DIMENSIONS ARE IN MILLIMETERS.
2. BATTERY CABLING VOLTAGE DRDP SHOULD NOT EXCEED 1%.
3. CIRCUIT BREAKERS FO01,FO02 ARE 25 AMP.
4. WIRING CONFIGURATION SHOWN IS FOR REFERENCE ONLY.
5. INSTALLATION MUST COMPLY WITH ALL APPLICABLE NATIONAL AND LOCAL CODES.

THIS DRAWING AND SPECIFICATIONS HEREIN ARE THE PROPERTY OF AMERICAN POWER CONVERSION AND SHALL NOT BE COPIED, REPRODUCED OR USED IN WHOLE OR IN PART, AS THE BASIS FOR THE MANUFACTURE OR SALE OF ITEMS WITHOUT WRITTEN PERMISSION FROM APC. THIS DRAWING IS BASED UPON LATEST AVAILABLE INFORMATION AND IS SUBJECT TO CHANGE WITHOUT NOTICE.

TITLE: SILCON 10KW UPS
BATTERY BREAKER BOX -
ELECTRO MECHANICAL
10kW, 400V
PROJECT: SUBMITTAL DRAWINGS SHEET 1 OF 1

DWG NO: SBB10KH-ME
REV: 1
DRAWN: B. Srinivasan 04/01/02 SCALE: 1:1
CHECKED: Yogesh 04/01/02 PRODUCTION
ENGINEER: C. Reddyford 04/01/02

