12	Pulling ears	Trous de halage
11	Head of tap changer	Commutateur de réglage hors-tension
10	Rating plate	Plaque signalétique
9	Oil drain plug A22 DIN 42551	Bouchon A22 DIN 42551
8	Locking Device	Dispositif de verrouillage
7	Lifting lugs	Anneaux de levage
6	LV cable box IP21	Capot BT IP21
5	LV bus bar 1/2500A (EN 50387)	Passe barre BT 1/2500A (EN 50387)
4	HV bushing K180AR-3/J 250A (EN 50180)	Borne HT K180AR-3/J 250A (EN 50180)
3	Earthing terminal M12	Borne de terre M12
2	DMCR	DMCR
1	Bi-directional rollers Ø125. TH: 40.	Galets de roulement orientable Ø125. EP: 40.
dx	Description (English)	Description (Français)

SEF MYSE CODE | MIN125020002014

Step down transformer	
Primary winding material:	Al.
Secondary winding material:	Al.
Maximum ambient temperature (°C):	40
Transformateur abaisseur	
Nature enroulement primaire:	Al.
Nature enroulement secondaire:	Al.
Température MAX. ambiante (°C):	40
Standard EN 50588-1/Norme EN 50588-1	
Power/Puissance:	1250 kVA
Frequency/Frequence:	50 Hz
Guaranted Ucc/Ucc garantie:	6 %
Hige voltage/HT:	20000 V (D)
Tappings/Reglage:	±2x2,5%
Low voltage (at no load)/BT (a vide):	410 V (yn)
Connection/Couplage:	Dyn11
Total weight/Masse totale:	3665 kg
Diel. weight/Masse dielectrique:	770 kg
Untanking weight/Masse a decuver:	2460 kg
Losses level/Niveau de pertes:	AA0Ak
No load losses P0 (W)/Pertes a vide P0 (W):	855 W
Load losses Pk (W)/Pertes dues a la charge Pk (W):	9500 W (75 °C)

Date	2020-12-18	Project Number	1250 kVA 20kV AA0Ak Ecodesign 2021	Mass [kg]
Department	AME-T	-	-	3665
Prepared	K.Sarecki	Description	DIMENSIONAL DRAWING PLAN D'ENCOMBREMENT	Class
Approved	R.Kwoska			-
				Scale
		Drawing Number	4-057770 rev.1	-
		CAD Model Name / Number	DIMENSIONAL DRAWING	Sheet 1 / 3

Schneider Electric

Drawing System

DESCRIPTION		
BLOCK		
DATE / NAME		
REVISION NO.		
INDEX		

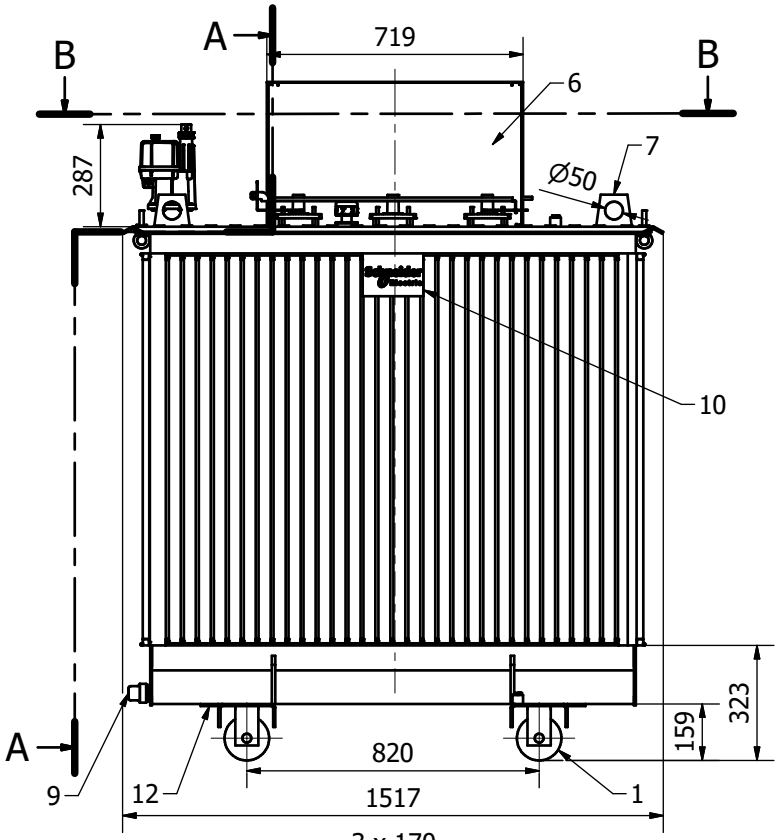

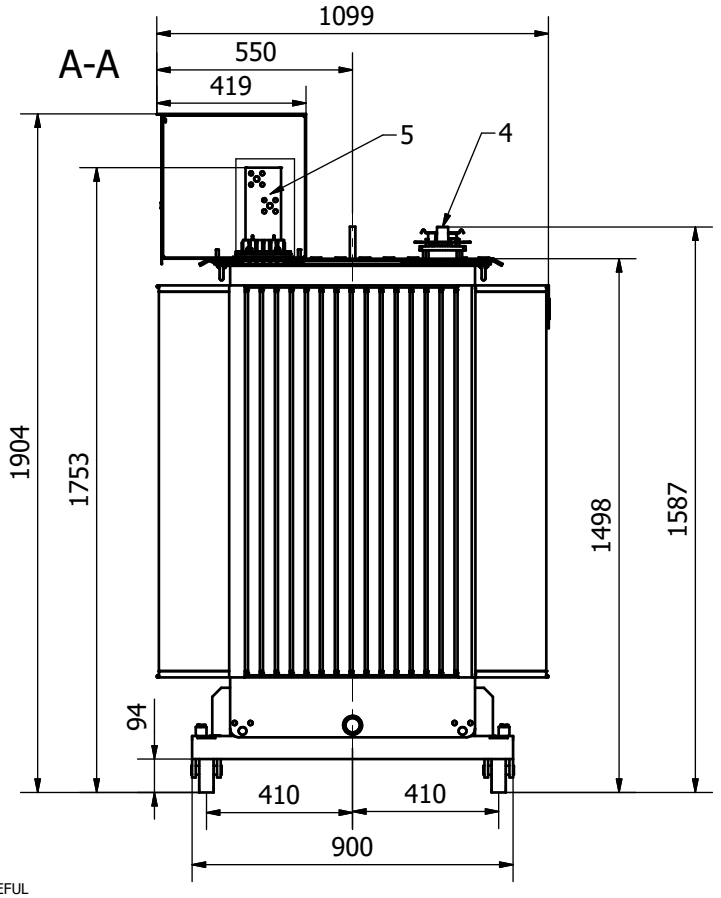

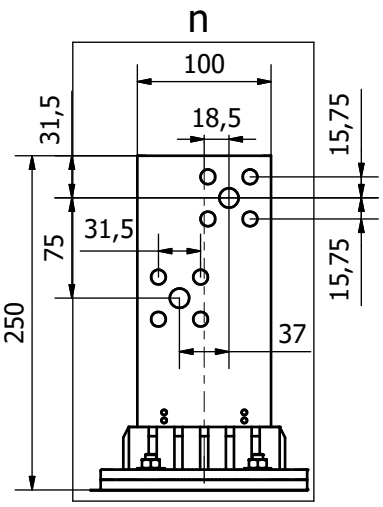

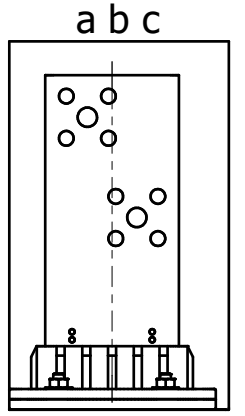

8 x Ø11 + 2 x Ø14,5

BUS BAR 1/2500 THICKNESS 12 mm
PASSE BARRE 1/2500 EPAISSEUR 12 mm

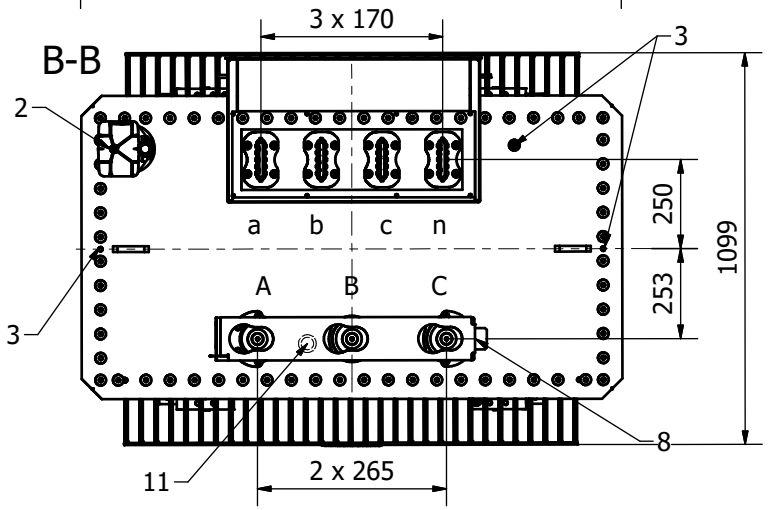

CAREFUL
The lv bus-bars must in no case bear the weight of the connections or of the set of cables.Provide supports free from the transformer,in case of a bar connection,it is absolutely necessary to provide a flexible link between the bus-bar and the extremity of the set of bars.Non-respect of above mentionned conditions frees the manufacturer from any guarantee in case of leakage.

ATTENTION
Les passe barres BT ne doivent en aucun cas supporter le poids des barres de connexions ou du faisceau de cables. Prévoir des supports indépendants du transformateur dans le cas d un raccordement par barre. Il est impératif de prévoir une liaison souple entre le passe barre et l'extrémité du jeu de barres.
Le non respect de ces conditions dégage la garantie du fabricant en cas de fuite.

TOLERANCES: +/- 20 mm ON DIMENSIONS
TOLERANCES: +/- 20 mm SUR DIMENSIONS

Tolerance on weight +/- 5%
Tolérance sur le poids +/- 5%

DESCRIPTION	
BLOCK	
DATE / NAME	
REVISION NO.	
INDEX	

SEF MYSE CODE | MIN125020002014

Date	2020-12-18	Project Number	1250 kVA 20kV AA0Ak Ecodesign 2021	Mass [kg]
Department	AME-T	-	-	3665
Prepared	K.Sarecki	Description	DIMENSIONAL DRAWING PLAN D'ENCOMBREMENT	Class
Approved	R.Kwoska			-
				Scale
		Drawing Number	4-057770 rev.1	1:15
		CAD Model Name / Number	DIMENSIONAL DRAWING	Sheet 2 / 3
				Drawing System

Schneider Electric

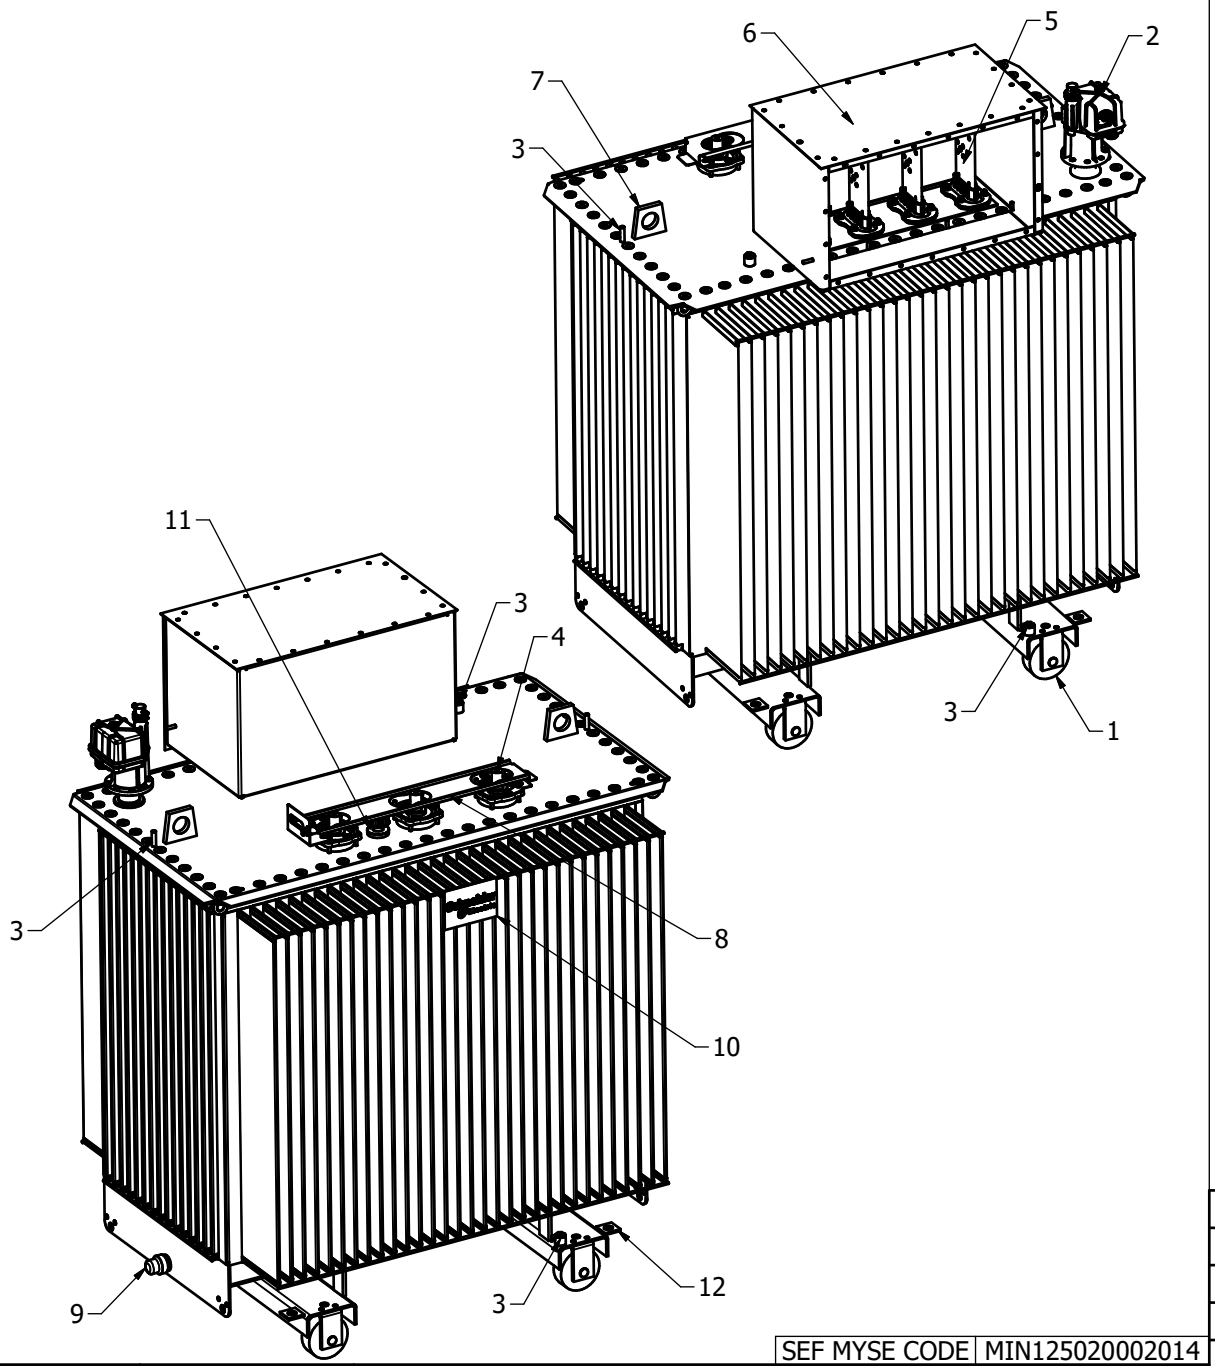

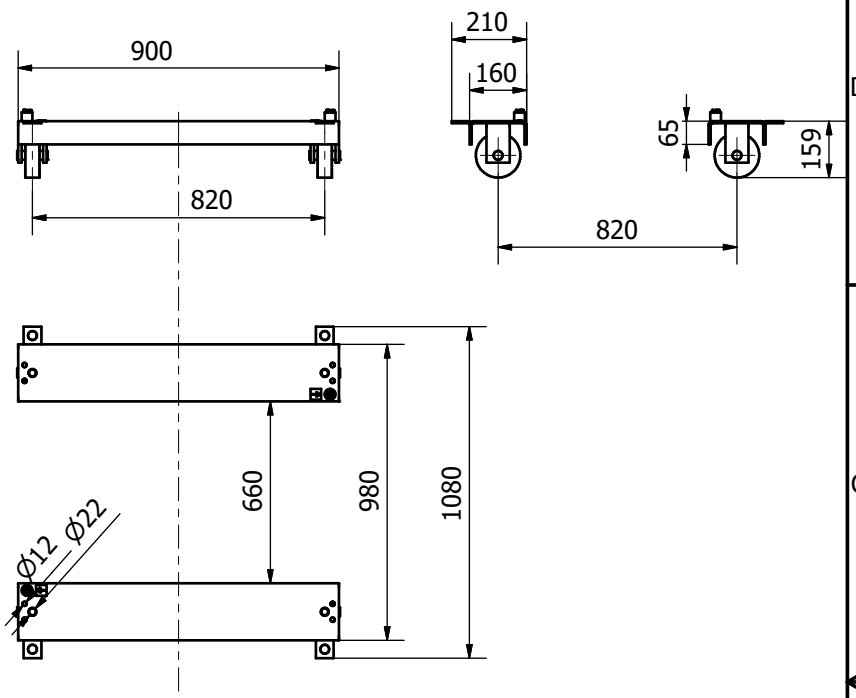

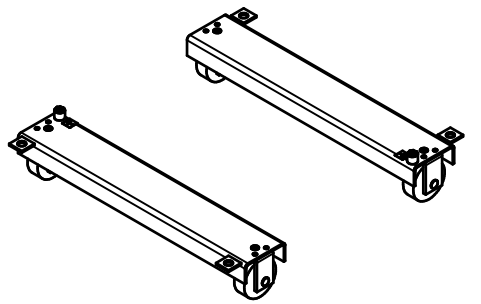

TOLERANCES: +/- 20 mm ON DIMENSIONS
TOLERANCES: +/- 20 mm SUR DIMENSIONS

SEF MYSE CODE | MIN125020002014

DESCRIPTION			
BLOCK			
DATE / NAME			
REVISION NO.			
INDEX			

Date	2020-12-18	Project Number	1250 kVA 20kV AA0Ak Ecodesign 2021	Mass [kg]
Department	AME-T	-	-	3665
Prepared	K.Sarecki	Description	DIMENSIONAL DRAWING PLAN D'ENCOMBREMENT	Class
Approved	R.Kwoska			-
				Scale
		Drawing Number	4-057770 rev.1	1:15
		CAD Model Name / Number	DIMENSIONAL DRAWING	Sheet 3 / 3
				Drawing System

Schneider Electric