

8 7 6 5 4 3 2 1

8 7 6 5 4 3 2 1



A B C D

A B C D

OPTIONAL
FLUSH COVER
ASCO NO.#FS361-290
1.00 TYP
ALL AROUND

TO PROTECT SWITCH DURING SHIPPING
PROTECTIVE INSERT(GM168528-177-E)
IS PLACED BETWEEN COVER AND SWITCH.

MOUNTED SWITCH
LOCATION

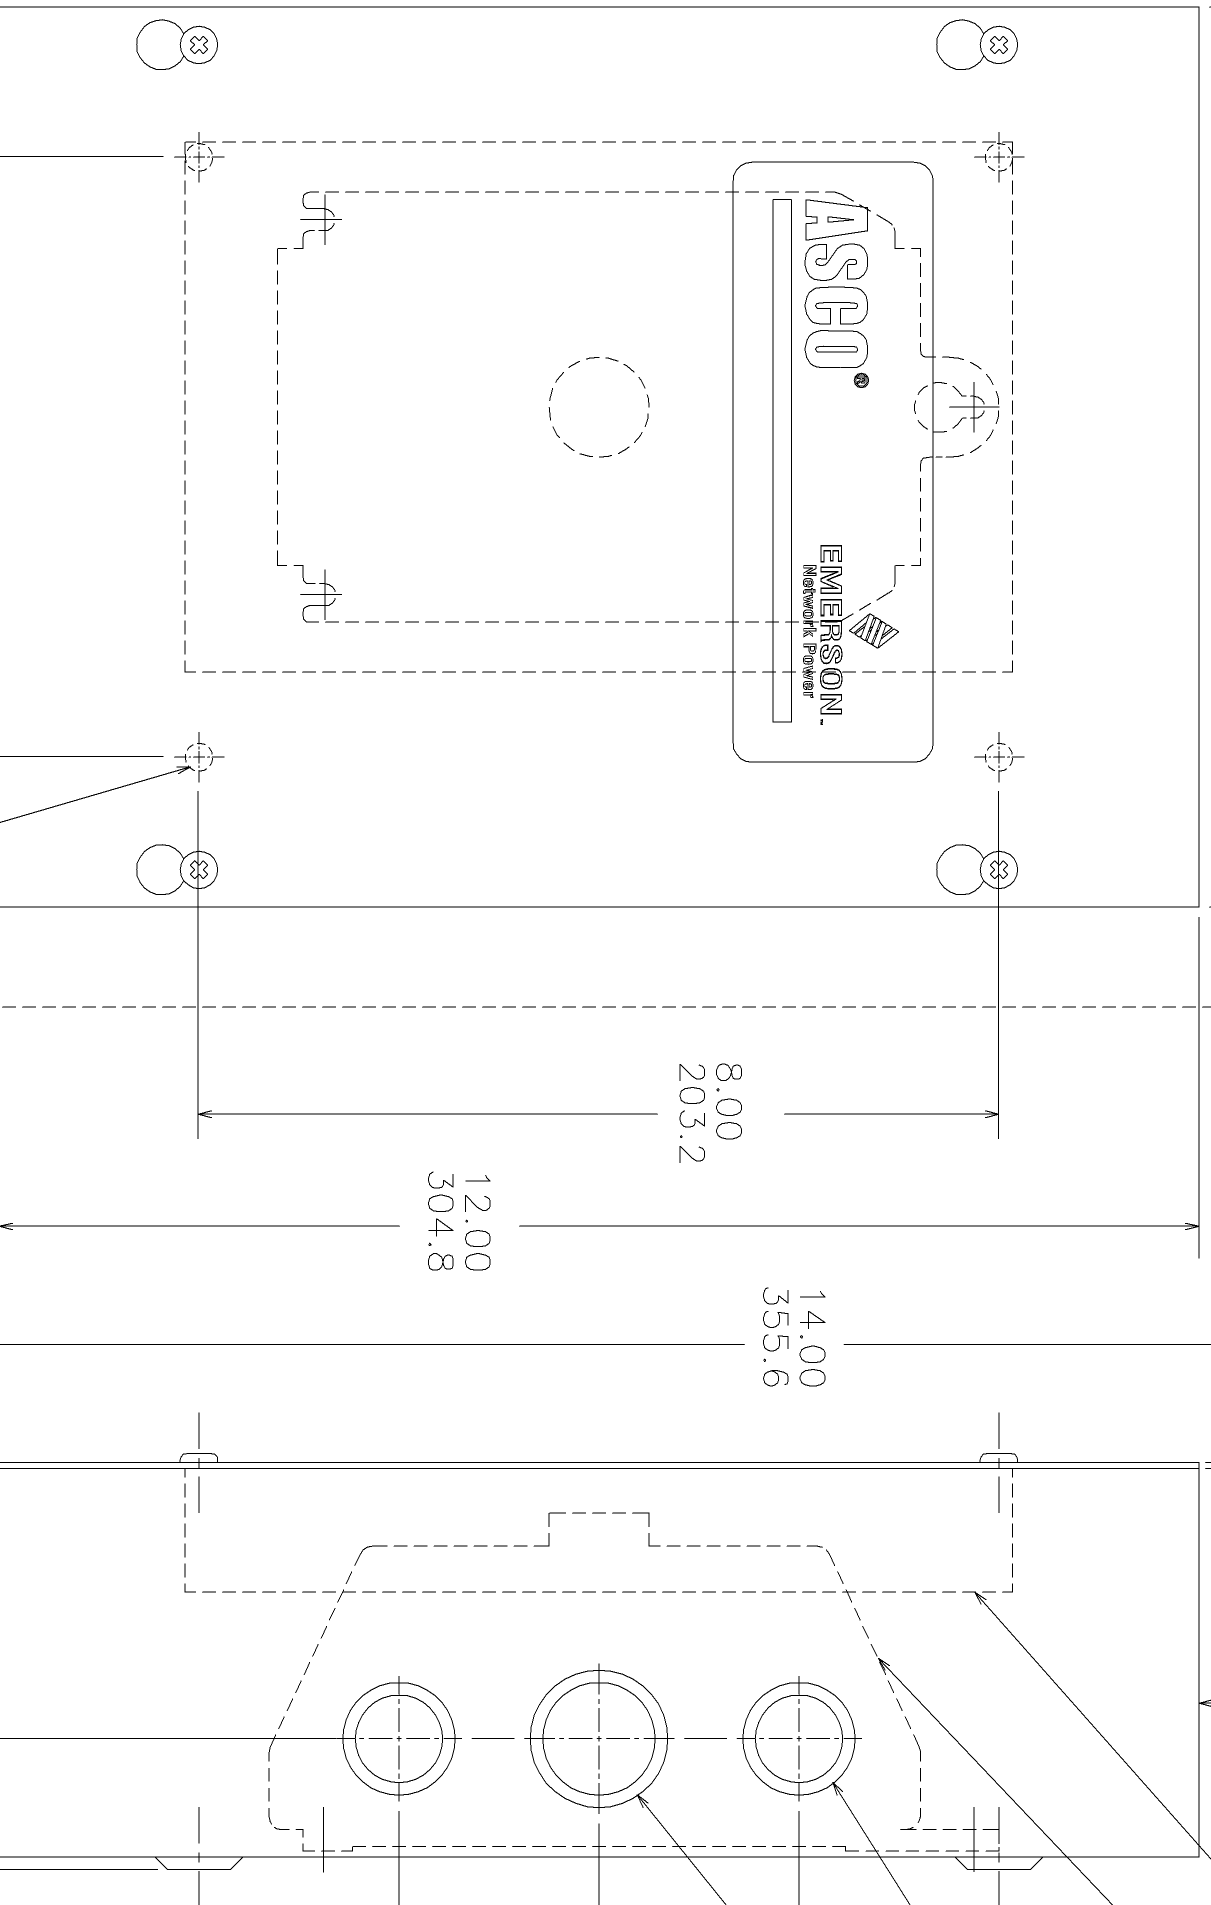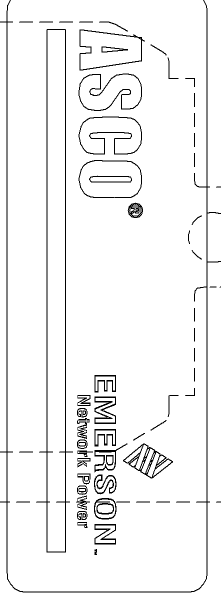

1/2 & 3/4 KNOCKOUTS
2 PLACES
ALL 4 SIDES

3/4 & 1.00 KNOCKOUTS
ALL 4 SIDES

SPECIFICATIONS:

- 1- NEMA TYPE 1 SCREW COVER, SURFACE MOUNTED CONSTRUCTED IN ACCORDANCE WITH UL-508.
- 2- MATERIAL: #16 (.060) GAUGE STEEL.
- 3- FINISH: ANSI #61 LIGHT GRAY.
- 4- NET WEIGHT 7 LBS, 3.2 KG WITHOUT SWITCH.
- 5- TOLERANCE OF MOUNTING DIMENSIONS ±.06.
- 6- TAPPED MOUNTING HOLES AND (3) 10-32 SCREWS FOR SWITCH MOUNTING ARE PROVIDED.
- 7- SWITCH MOUNTING & COVER SCREWS (7) TO BE TORQUED TO 20 ±4 IN.LBS.

PROJECT NAME: PROJECT		CATALOG NO. _____
COMPOSITE ENCLASURE		CERTIFIED _____
OUTLINE AND MOUNTING DIMENSIONS		TO ASCO S.O. _____
917/918 REMOTE CONTROL SWITCH		DATE _____ BY _____
BY	DATE	
MJH	10/13/06	
NBM	10/13/06	
JTW	10/13/06	
CHECKED	DRAWING APPROVAL	FINAL APPROVAL
-	-	-

MANUFACTURING TOLERANCES TO BE IN ACCORDANCE WITH ASCO PROCEDURE, MP-1-003. FOR FLUIG PARTS SEE MP-1-003.	ASSEM. REF. NO.
PROPERTY OF ASCO POWER TECHNOLOGIES. USE PERMITTED FOR OUR WORK ONLY. ALL RIGHTS OF DESIGN OR INVENTION ARE RESERVED.	
ASCO	ASCO Power Technologies, L.P. FLORHAM PARK, NEW JERSEY 07932 U.S.A.

CHANGE LETTER	E	210884	MJH	JTW	10/16/06
	D	131315	RNR	RJ	8/94
SUBSIDIARY DISTRIBUTION		PROTECTIVE INSERT #	DATE		
AE	AS	AM	AL	AP	AD
CH	AV	AA	PS	AP	AC
AG	AP	AC	AS	AX	AC

SCALE	1:1	ACAD	FILE
SIZE	363104		
CHANGE	DSI 363104		
LETTER	E	EEN	210884
			1 OF 1

INCHES
MM