


MULTIPLES OF TRIP CURRENT RATING

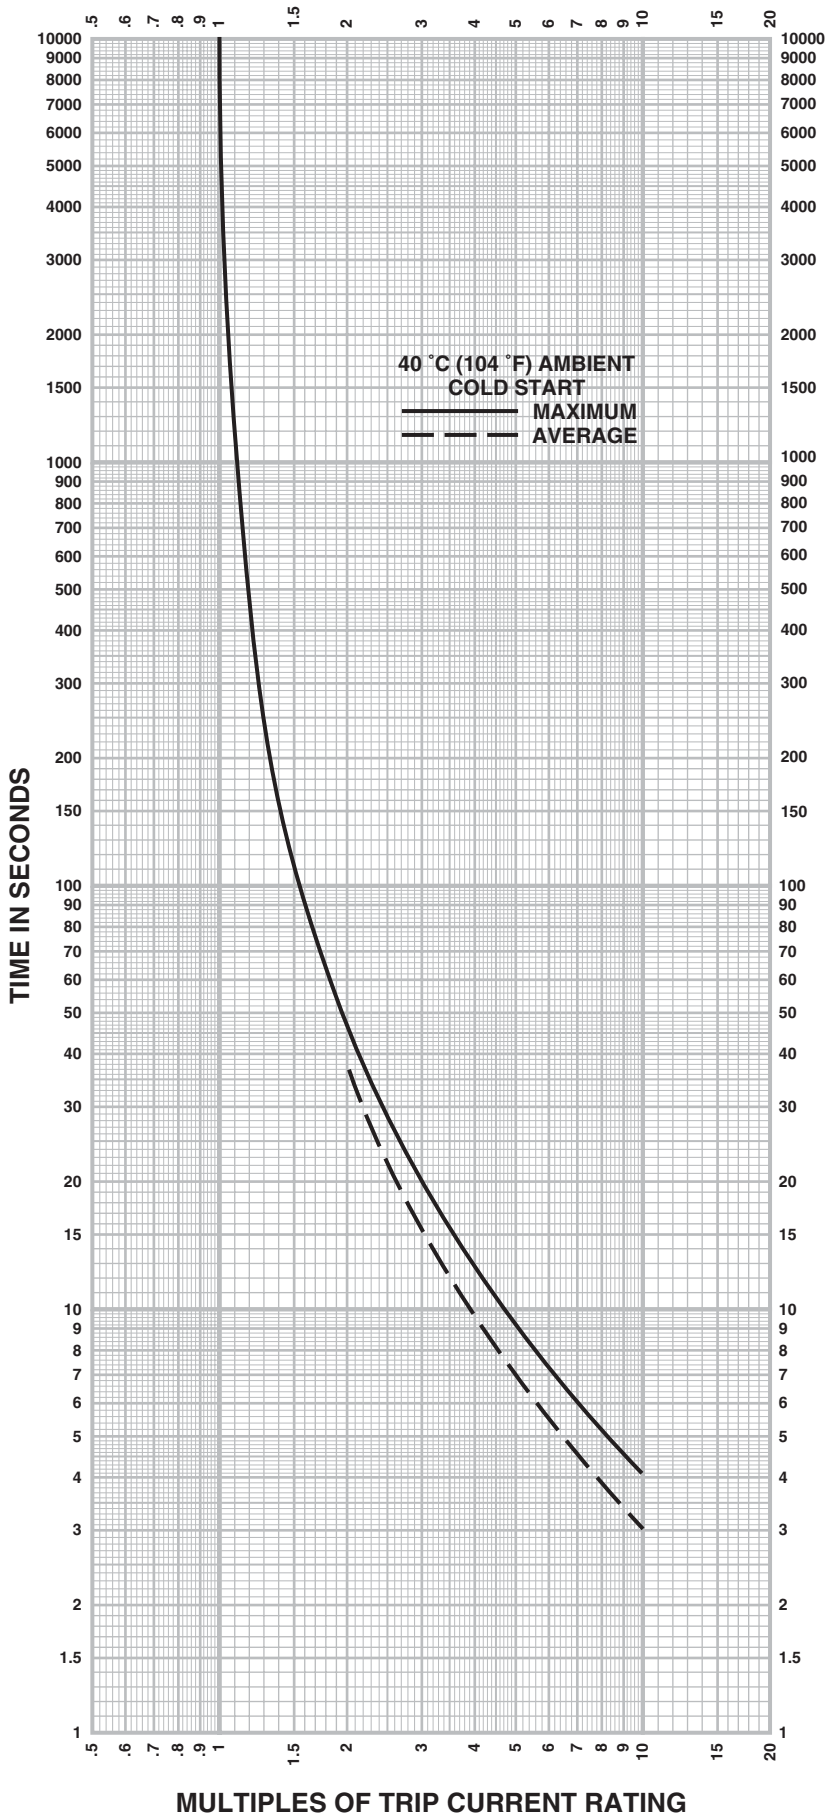

OVERLOAD RELAY TIME-CURRENT CHARACTERISTICS REFERENCE DRAWING NO. 30068-457

Relay Design	Melting Alloy
Thermal Unit Types	FB3.33–FB44

40 °C ambient cold start trip time characteristics of:

Equipment	AC Manual Starter
Size	M-0, M-1 & M-1P
Type	M & T
Series	A
Qty. of Thermal Units	1, 2, or 3

When installed in:

- Hinged door and all other (larger) enclosures

The trip current rating can be determined from the instructions given with the appropriate thermal unit selection table. The characteristics shown do not necessarily apply to equipment manufactured before the date of the referenced drawing.