

# MiCOM C434

Bay Unit for Control and Monitoring

C434/EN IN/Ba7  
(AFSV.10.10281 EN)

Version C434-304-404/405/406 -610ff

Supporting Documents

This document does not replace the Technical Manual.



## Warning

When electrical equipment is in operation dangerous voltage will be present in certain parts of the equipment. Failure to observe warning notices, incorrect use or improper use may endanger personnel and equipment and cause personal injury or physical damage.

Before working in the terminal strip area, the device must be isolated. Where stranded conductors are used, wire end ferrules must be employed.

The signals 'Main: Blocked/faulty' and 'SFMON: Warning (LED)' (permanently assigned to the LEDs labelled 'OUT OF SERVICE' and 'ALARM') can be assigned to output relays to indicate the health of the device. Schneider Electric strongly recommends that these output relays are hardwired into the substation's automation system, for alarm purposes.

Any modifications to this device must be in accordance with the manual. If any other modification is made without the express permission of Schneider Electric, it will invalidate the warranty, and may render the product unsafe.

Proper and safe operation of this device depends on appropriate shipping and handling, proper storage, installation and commissioning, and on careful operation, maintenance and servicing.

For this reason only qualified personnel may work on or operate this device.

For this reason only qualified personnel may work on or operate this device. The user should be familiar with the warnings in the Safety Guide (SFTY/4LM/G11 or later version), before working on the equipment.

### **Installation of the DHMI:**

A protective conductor (ground/earth) of at least 1.5mm<sup>2</sup> must be connected to the DHMI protective conductor terminal to link the DHMI and the main relay case; these must be located within the same substation.

To avoid the risk of electric shock the DHMI communication cable must not be in contact with hazardous live parts.

The DHMI communication cable must not be routed or placed alongside high-voltage cables or connections. Currents can be induced in the cable which may result in electromagnetic interference.

## CE Marking

This product complies with the essential requirements of the following European directives:


Electromagnetic Compatibility Directive (EMC) 2004/108/EC

Low Voltage Directive (LVD) 2006/95/EC


## Protective Conductor Terminal (PCT) / Case Grounding / Protective Earth

### Location of Protection Conductor Terminal


Surface-mounted case

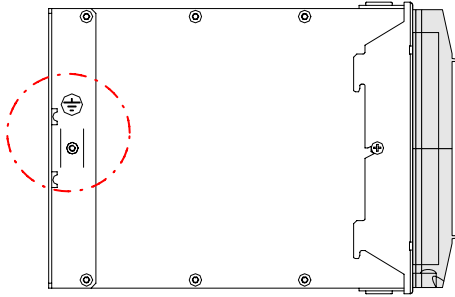


Flush-mounted case

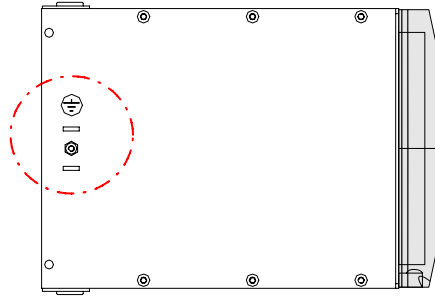

DHMI



### Assembly of Protection Conductor Terminal

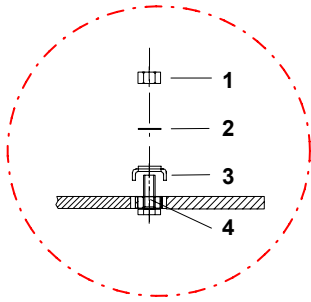

Pos.	Description
1	Nut M4
2	Tooth lock wash. A4.3
3	Clamp bracket
4	Bolt M4

The protective conductor must be permanently connected to the PCT (Protective Conductor Terminal) to maintain the safety features provided by the design.

The clamp bracket is marked with a PCT symbol: 

The cross-section of the ground conductor must conform to applicable national standards. A minimum cross-section of 2.5 mm<sup>2</sup> is required.

In addition, a protective ground connection at the terminal contact on the power supply module (identified by the letters "PE" on the terminal connection diagram) is required for proper operation of the device. The cross-section of this ground conductor must conform to applicable national standards. A minimum cross-section of 1.5 mm<sup>2</sup> is required.

If a detachable HMI is installed, a further protective conductor (ground/earth) of at least 1.5 mm<sup>2</sup> must be connected to the DHMI protective conductor terminal to link the DHMI and the main relay case; these must be located within the same substation.

All grounding connections must be low-inductance, i.e. they must be kept as short as possible.

# Location

## C434 in case 40 TE

- Pin-terminal connection (C434 -404)

01	02	03	04	05	06	07	08	09	10
<b>P</b>	<b>A</b>	<b>T</b>		<b>X</b>	<b>X</b>	<b>X</b>	<b>X</b>	<b>V</b>	<b>X</b>
CH1		-4J		6I	6I	6I	6I	4I	6O
CH2		-4V/5V		6O	6O	6O	6I	8O	6O
alt.				alt.	alt.	alt.	alt.	alt.	
<b>A</b>				6I	6I	6I	6I	8O	24I
ETH				8O	8O	8O	8O	alt.	<b>Y</b>
CH2				24I	24I	24I	alt.	4I	

## C434 in case 84 TE

- Pin-terminal connection (C434 -405)


01	02	03	04	05	06	07	08	09	10	11	12	13	14	15	16	17	18	19	20	21
<b>P</b>	<b>A</b>	<b>T</b>		<b>T</b>			<b>X</b>		<b>X</b>	<b>X</b>	<b>X</b>	<b>X</b>	<b>X</b>	<b>X</b>	<b>X</b>	<b>X</b>	<b>V</b>		<b>V</b>	
CH1		-4J		-4J			6I		6I	6I	6I	6I	6I	6I	6I	6I	4I		4I	
CH2		-4V/5V		-4V			alt.		6O	6O	6O	6O	6O	6O	6O	6O	8O		8O	
alt.							6I		alt.	alt.	alt.	alt.	alt.	alt.	alt.	alt.				
<b>A</b>							8O		6I	6I	6I	6I	6I	6I	6I	6I				
ETH							alt.		8O	8O	8O	8O	8O	8O	8O	8O				
CH2							24I		alt.	alt.	alt.	alt.	alt.	alt.	alt.	alt.				
							<b>Y</b>		24I	24I	24I	24I	24I	24I	24I	24I				
							4I													

## P434 in case 84 TE

- Ring-terminal connection (C434 -406)

01	02	03	04	05	06	07	08	09	10	11	12	13	14	15	16	17	18	19	20	21
<b>P</b>	<b>A</b>	<b>T</b>		<b>T</b>			<b>X</b>		<b>X</b>	<b>X</b>	<b>X</b>	<b>X</b>	<b>X</b>	<b>X</b>	<b>X</b>	<b>V</b>				
CH1		-4J		-4J			6I		6I	6I	6I	6I	6I	6I	6I	6I	4I		8O	
CH2		-4V/5V		-4V			alt.		6O	6O	6O	6O	6O	6O	6O	6O				
alt.							6I		alt.	alt.	alt.	alt.	alt.	alt.	alt.	alt.				
<b>A</b>							8O		6I	6I	6I	6I	6I	6I	6I	6I				
ETH							alt.		8O	8O	8O	8O	8O	8O	8O	8O				
CH2							24I		alt.	alt.	alt.	alt.	alt.	alt.	alt.	alt.				
							<b>Y</b>		24I	24I	24I	24I	24I	24I	24I	24I				
							4I													

# Connection

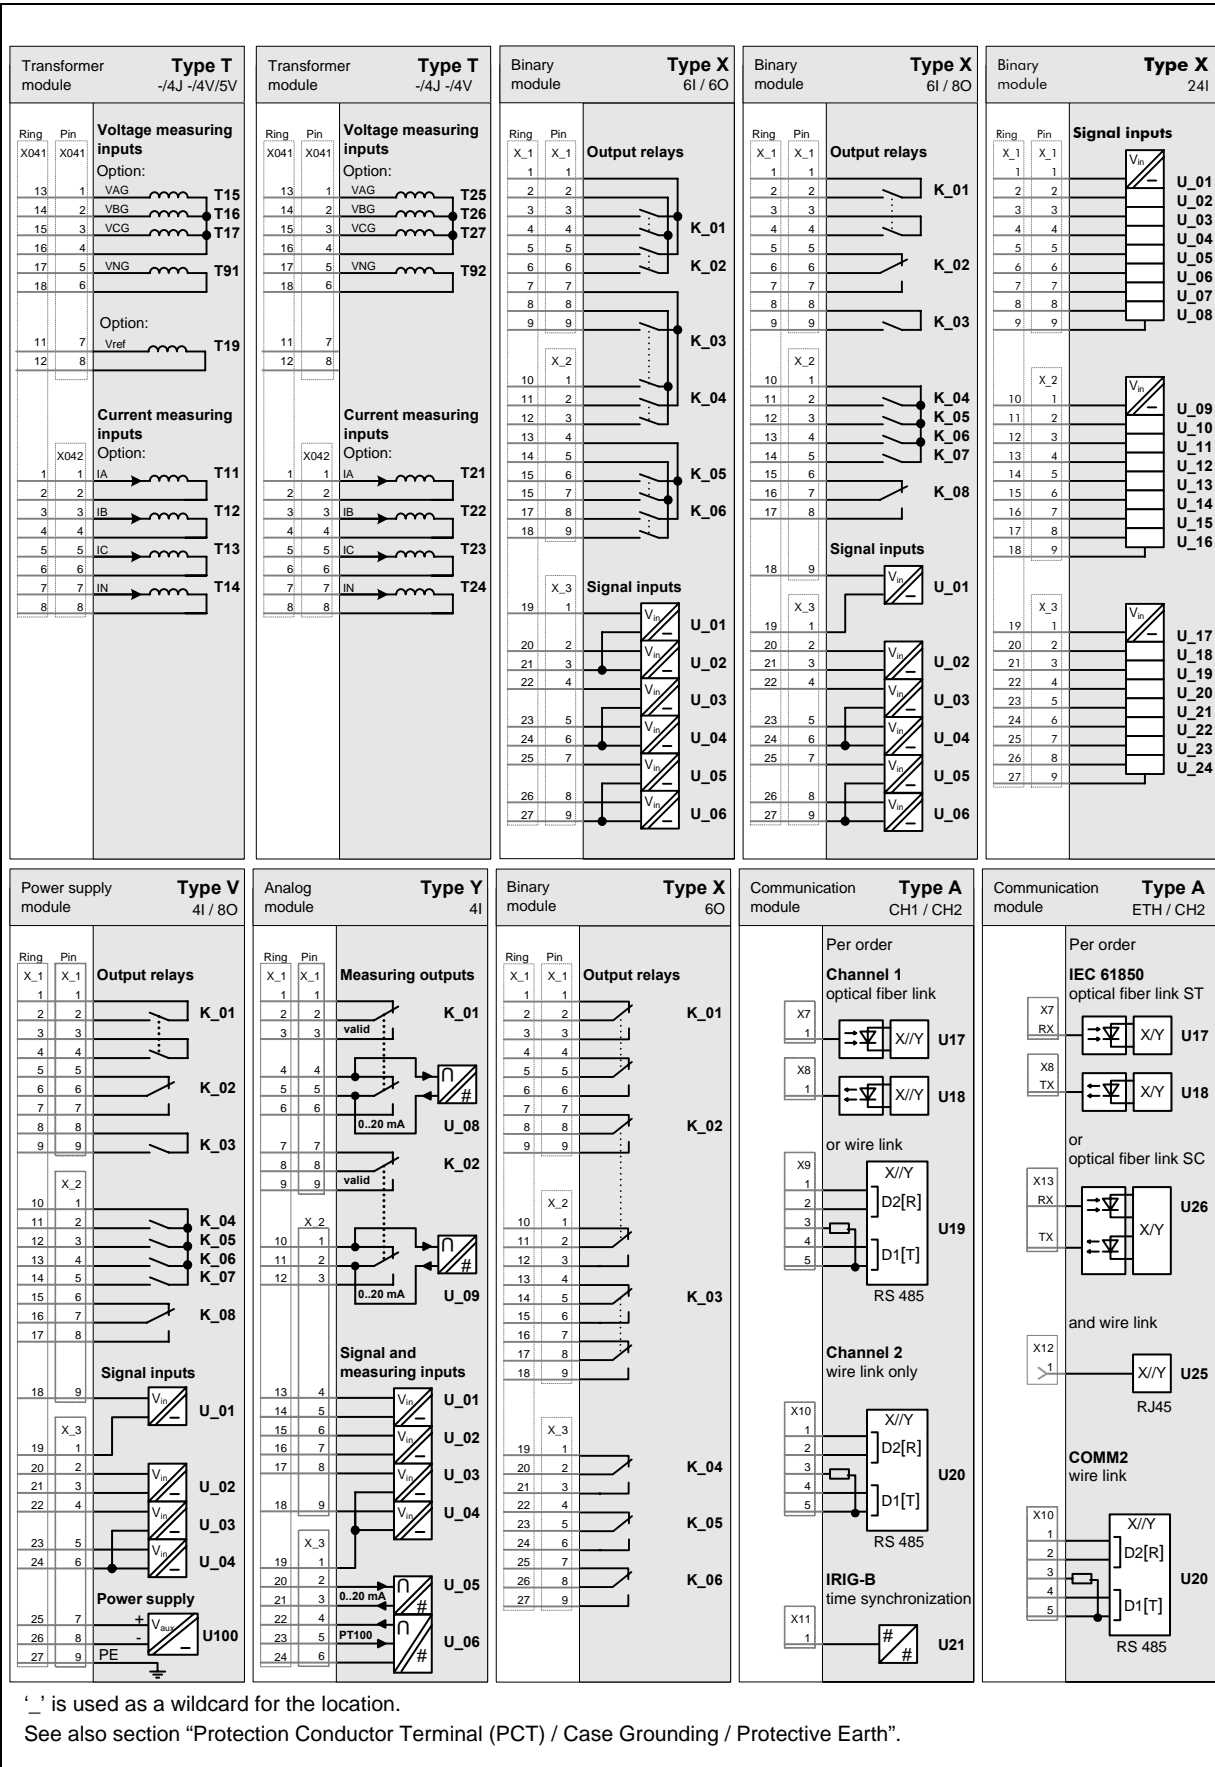



## Customer Care Centre

<http://www.schneider-electric.com/CCC>

### **Schneider Electric**

35 rue Joseph Monier  
92506 Rueil-Malmaison  
FRANCE

Phone: +33 (0) 1 41 29 70 00

Fax: +33 (0) 1 41 29 71 00

[www.schneider-electric.com](http://www.schneider-electric.com)

**Publication: MiCOM C434/EN IN/Ba7 // AFSV.10.10281 EN /// C434-304-404/405/406-610ff**

Publishing: Schneider Electric

05/2011