

**Presence/Monitoring 1336/1.0,
KNX movement/presence detector**

● **General**

Application 1336/1.0 was developed for the KNX movement detector. In the following the device will be referred to as the presence detector.

The distinctive feature of the presence detector function is the integrated sensor, which measures brightness continuously. This function is able to measure and evaluate changes in the external brightness (daylight) even when artificial lighting is switched on. Even when people are present, the presence detector function switches off the lighting when the external brightness is sufficient (above the brightness threshold set) for working and safe use of the rooms without additional artificial lighting. This feature reduces energy consumption. The presence detector will not switch the lighting on until it detects movement in front of the device when the ambient brightness is too low. If movement is no longer detected in the activated state, the integrated staircase timer will switch the lighting back off. In contrast to this, the movement block will only switch off when there is no more movement in front of the device - in other words, independently of the brightness. The switch-on condition is however the same as with the presence detector block. The ETS application includes five independent presence or movement blocks, with four output objects each.

The technical data for the presence detector may be found in the description of the device.

i Note:

All the settings described refer to ETS version 3, but you can use all the settings and functions with ETS version 2 as well. The application files (vd2 and vd3) are configured in such a way that the application loading time is considerably reduced. When you convert an ETS 2 project to ETS 3, you lose this time saving. If you are working with ETS 3, use the vd3 files. Total possible addresses and connections: 254 addresses; 255 connections

i Note:

If you switch back to the preset values in either ETS 2 or ETS 3 (by clicking "Standard"), all the values that you have changed so far will be deleted. Any group addresses which have been parameterised will be lost.

i Note:


Because various functions depend on other functions, these dependant functions are only visible and selectable in the ETS when the preceding function has been enabled. If you de-select functions or parameters, group addresses that have already been connected may be removed.

● **Getting started quickly**

When you insert the application in the ETS or click on the "Standard" button, the ETS application will switch automatically to minimum configuration.

In minimum configuration, it is possible to put the presence detector into operation. For some application cases, the minimum configuration is even adequate for practical use. We also recommend opening minimum configuration as a way of familiarising yourself with the application software for the presence detector. Here all of the extended or more complex parameters are disabled. In "Block configuration" only the first "Movement/presence" block is enabled for use. In the "Telegrams" tab only output object 1 is enabled. This is a 1 bit output object. At the start of movement this object sends a 1 telegram and when the internal staircase timer has elapsed it sends a 0 telegram. Each parameter can always be tuned to its individual requirements. The brightness threshold and the staircase timer always need to be adjusted to suit requirements. Check the "Brightness" and "Times" tabs.

In this way the corresponding objects are connected to a KNX switch actuator.

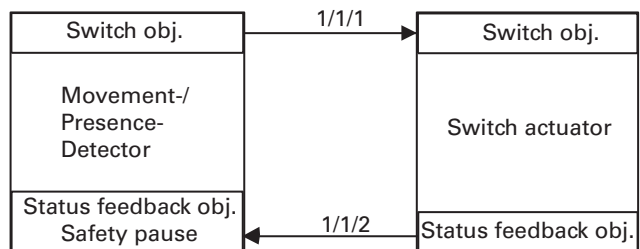

To familiarise yourself with the extended and more complex parameters see the following pages.

● **General functions**

The common safety pause

When lights installed in the area of detection of the presence detector are switched, optical feedback can occur. The temperature difference between the luminaires or the change in the infrared spectrum can be interpreted as a movement by passive infrared movement or presence detectors (optical feedback).

The application has a common safety pause system - in other words, a safety pause triggered by the presence detector will affect all blocks in the application. As specified in a parameter the safety pause can be triggered at the status feedback object (safety pause) when there is an OFF telegram or when there is an OFF and ON telegram.

The status feedback object of the switching/dimming actuator must be connected to the feedback safety pause object of the presence detector.

Once a safety pause has been started, signals from the movement sensor will no longer be evaluated for this period of time. An elapsed staircase timer cannot be started by a movement during an active safety pause and an ongoing staircase timer cannot be retriggered by a movement.

An ongoing staircase timer is not affected by a safety pause being activated. In other words, the staircase timer will run through in the usual way.

i Note: Optical feedback can only be avoided by selecting the right installation location for the presence detector and the lighting. The safety pause system and the safety pause object of the application cannot compensate for all planning mistakes.

Communication objects

You can select the following communication objects:

General:

Function	Object name	Type	Prio	Flags	Behaviour
Safety pause	Status feedback object	1 bit	Low	WC	Receive

Parameter

i Note: The parameter settings include various functions which depend on other functions. Depending on the parameter setting, some functions or objects may or may not be displayed in the ETS.

General	
Parameter	Setting
Safety pause via status feedback object	Disabled
	For OFF telegram
	For ON and OFF telegram
Safety pause (1 - 20) seconds	1 - 20; preconfiguration: 2

● **General brightness evaluation**

The current brightness can be determined by the internal brightness sensor, by an external communication object or by both dependencies. The relationship between internal and external values can be parameterised while doing this.

Communication objects

You can select the following communication objects:

General:

Function	Object name	Type	Prio	Flags	Behaviour
External sensor	Actual value input	2 byte	Low	WCT +	Transmit/receive/update


Parameter

General	
Parameter	Setting
Actual value (brightness)	From internal sensor
	From object, actual value input
	From internal sensor and object
Taking the separately measured lux value (0% - 100%) into account	0% - 100%, in 5% steps; preconfiguration 50%

Actual value correction

The measured brightness value (actual value) can be corrected. A distinction is drawn here between the installation location of the presence detector and the reference area (a desk surface, for example). The brightness value of the reference area is determined with the aid of actual value correction and taking the brightness value measured by the presence detector at the installation location and an internal adjustment curve into account.

For actual value correction you will need a luxmeter. The measured values are then input into the application software of the presence detector. When intense sunlight is shining onto the reference area or the installation site, the measurements should not be taken. Under certain circumstances darkening the room may improve the measurement results.

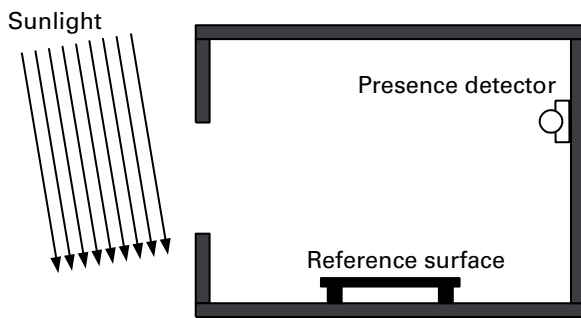

Optimal light conditions for actual value correction. Measurement results at the installation site or at the reference area are affected equally by natural light.

Four measurements are required for actual value correction:

- Artificial lighting is switched off, brightness is measured at the presence detector installation location.
- Artificial lighting is switched on (maximum brightness), brightness is measured at the presence detector installation location.
- Artificial lighting is switched off, brightness is measured at the reference area (desk, for example).
- Artificial lighting is switched on (maximum brightness), brightness is measured at the reference area (desk, for example).

The four lux values measured are entered in the application software. When "Actual value correction" is enabled, four fields are available on the "General" tab. "Light switched off" or "Light max. brightness" for the actual value at the installation site. The same applies to the actual value at the reference area.

The brightness value determined applies to all presence/movement blocks. This value can be transmitted cyclically to the bus.

Note: Should the situation in the room change due to

different furniture, floor coverings or ceiling, for example - in other words, when reflective surfaces in the room change - take a new measurement. The measured values are entered into the application software. The presence detector will then need to be reprogrammed.

Note: An actual value correction only makes sense in conjunction with a dimming actuator and an 8 bit status feedback object.

Communication objects

You can select the following communication objects:

General:

Function	Object name	Type	Prio	Flags	Behaviour
Transmit	Resulting actual value	2 byte	Low	CT	Transmit
Brightness value, dimming actuator	Status feedback	1 byte	Low	WCT +	Transmit/ receive/ update

Parameter

Note: The parameter settings include various functions which depend on other functions. Depending on the parameter setting, some functions or objects may or may not be displayed in the ETS.

General	
Parameter	Setting
Actual value correction	Enabled Disabled
Actual value (0 - 2000 lux) installation site	
Lamp switched off	0-2000; preconfiguration 50
Max. brightness of lamp	0-2000; preconfiguration 100
Actual value (0 - 2000 lux) reference area	
Lamp switched off	0-2000; preconfiguration 100
Max. brightness of lamp	0-2000; preconfiguration 350
Transmit actual value cyclically, reference area (or from installation site)	Enabled Disabled
Time base, send lux value	1 s 1 min 1 hr
Time factor, send lux value (1 - 255)	1-255; preconfiguration 30

● Presence / movement block

Basic function of a presence block

A staircase timer is "integrated" into a presence block. When the ambient brightness is too low **and** a movement is detected, the presence block sends an ON telegram on the bus. When movement is no longer detected, the staircase timer starts. An OFF telegram is transmitted to the bus after a parameterised time.

Should the brightness rise beyond a specific threshold, a parameterised time period will be started and when it has elapsed an OFF telegram will also be transmitted.

Basic function of a movement block

A staircase timer is "integrated" into both a movement block and a presence block. When the ambient brightness is too low **and** a movement is detected, the movement block transmits an ON telegram to the bus. When no further movement is detected the staircase timer starts. An OFF telegram is transmitted to the bus after a parameterised time.

In contrast to the presence block, brightness is measured **only** at the moment when the first movement is detected. If further movement is detected, an OFF telegram is **not** transmitted, irrespective of brightness changes. The staircase timer starts only when movement is no longer detected, and an OFF telegram is transmitted after the parameterised time period.

Block configuration


Up to five movement/presence blocks are available. In the default setting, block 1 is enabled.

Parameter


Block configuration	
Parameter	Setting
Movement/presence block X	Enabled
	Disabled

Movement detection

The device has a detection angle of 180°. The 180° detection angle is divided into two sectors. The sectors are each 90° and are designated by the letters A and B.

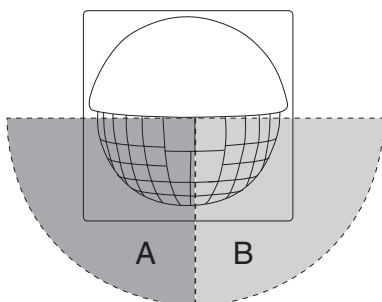


Two independent passive infrared sensors (sectors A and B) input into movement detection. Via the ETS it is possible to parameterise both sensors at the same time or each sector can be parameterised individually. In the "Movement sensors" tab, the settings "Enabled" or "Disabled" can be made. When the sector-orientated settings are disabled, sensitivity and range for both sensors will be changed to the same degree. When the sector-orientated settings are "Enabled," further tabs where sectors A and B can be parameterised individually appear. "Object range" and "Dead time, movement start" each relate to both sensors of the block in question. For each movement sensor the range and the sensitivity can be set for each block via parameters. Alternatively, depending on the parameterisation, the values can be set by means of a potentiometer on the device. Another option is setting the range via the Range communication object which can be enabled for each block. To suppress disturbance variables or if delayed activation is required, a dead time for the start of movement can be activated. The dead time is started after movement has been detected (start of movement). The start of movement action (transmitting a telegram to the bus) can take place if a movement is still detected within the movement time after the dead time has elapsed.

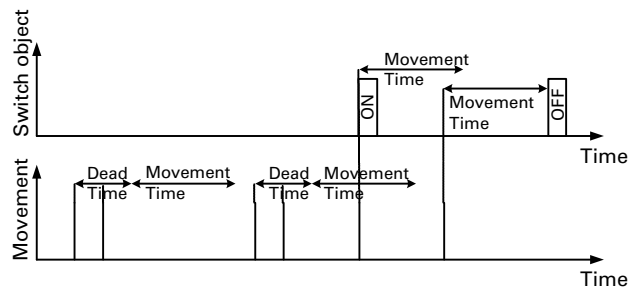

In master mode or normal mode the movement time corresponds to the staircase timer in the diagram above. In slave mode or monitoring mode the movement time corresponds to the cycle time. In practice a large number of applications can be implemented by means of the various blocks and sensors.


An example of practical application:

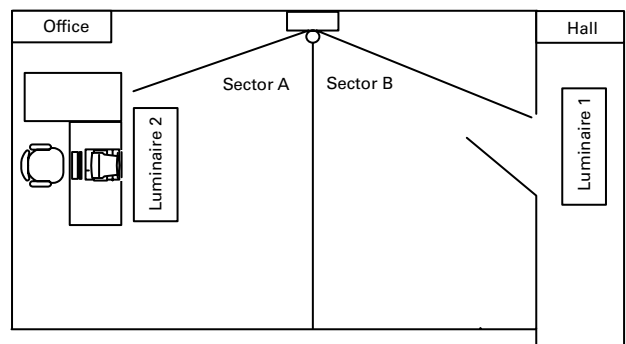

- Luminaire 1 should only switch on when there is a movement in the hall.
- Sector A is disabled for presence block 1, sector B is enabled and switches luminaire 1
- Luminaire 2 should only switch on when there are movements near the desk.
- Sector A is enabled for presence block 2 and switches luminaire 2, sector B is disabled.

Block diagram of presence/movement block

A block diagram clarifies the relationships between the individual dependencies:

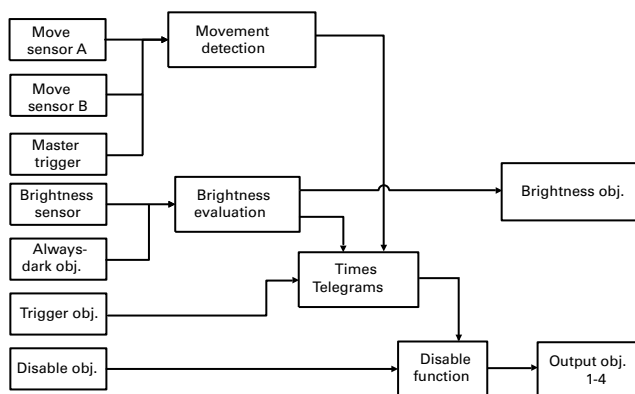

Movement evaluation

As has already been stated above, the two movement sensors input into movement detection. The master trigger object is brightness-dependent and with an ON telegram simulates a movement; an OFF telegram is ignored. The trigger object is brightness-independent and also simulates a movement for an ON telegram. Whether the trigger object can switch the lighting off early when there is an OFF telegram can be parameterised.

Note: The master trigger object and the trigger object do not appear in the ETS until the device operating mode has been set to "Master mode". See "Block X, general" tab, parameter: "Operating mode". The master/trigger object ignores the dead time (for Dead time, see above) and reacts without a delay. More detailed information about the master/trigger object may be found later on.

Communication objects

You can select the following communication objects:

Block X, general movement sensors:

Function	Object name	Type	Prio	Flags	Behaviour
Block X	Range	1 byte	Low	WC	Receive

Parameter


Note: The parameter settings include various functions which depend on other functions. Depending on the parameter setting, some functions or objects may or may not be displayed in the ETS.

Block X, general - movement sensors	
Parameter	Setting
Sector-orientated settings	Enabled
	Disabled
The following settings are only visible when "Sector-orientated settings" is "Disabled".	
Sensitivity (for all sensors)	High
	Medium
	Low
Range (for all sensors)	10% - 100% (in 10% steps) preconfiguration: 100%
The following settings are only visible when "Sector-orientated settings" is "Enabled".	
Range object (for all sensors)	Disabled
	Enabled
Dead time, start of movement (for all sensors)	Disabled
	Enabled
Time base	1 min , 1s
Time factor (1-255)	3 , (1-255)
Sector X	Enabled
	Disabled

Block X, general movement sensors sector X	
Parameter	Setting
Sensitivity	High
	Medium
	Low
Range adjustable via	Parameters Potentiometer
The following parameters are only visible when "Range adjustable" "via parameter" is set.	
Overwrite range during download	Enabled Disabled
Range	10% - 100% (in 10% steps) preconfiguration: 100%
Change range via object	Disabled Enabled


● **Brightness evaluation**

Brightness evaluation of a presence detector

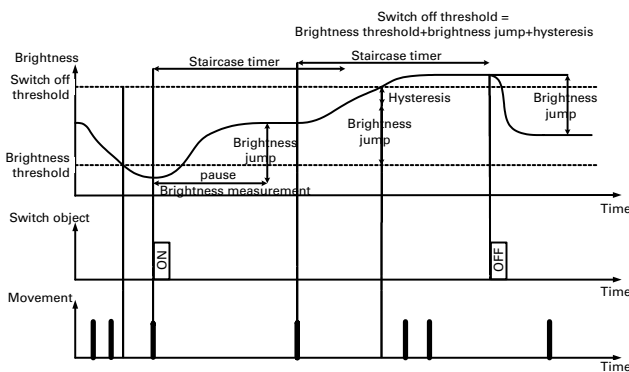

Once a movement has been detected below the set brightness threshold and the action carried out at the start of movement (here: transmitting an ON telegram), the brightness lock no longer has an effect. This means that a new movement can retrigger the staircase time. However, should the ambient brightness increase during this time to exceed the set brightness threshold + measured brightness jump + a hysteresis (with regard to the brightness threshold), an ongoing staircase timer period will not be retriggered. At the end of the staircase timer period an OFF telegram can be transmitted, depending on the parameterisation. A further option when the OFF threshold is exceeded is not to allow the remaining staircase timer period to elapse but instead to start a defined remaining running time.

Brightness evaluation of a movement detector:

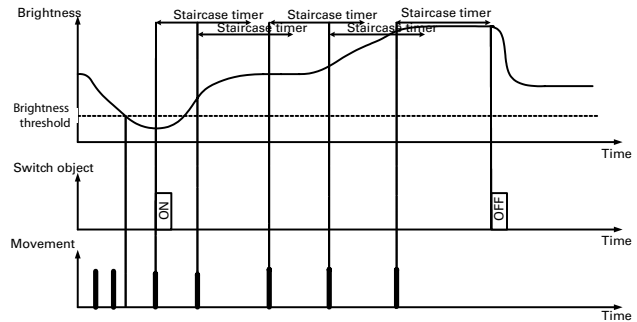

Where this differs from the presence detector is that the movement detector changes to non-brightness-dependent mode once the start of movement action (sending an ON telegram) has been carried out. Here freshly detected movements can retrigger the staircase timer. Unlike the presence detector, the movement detector cannot process the brightness jump and there is not even any setting of a hysteresis.

Brightness


The brightness threshold can be parameterised separately for each of the five movement/presence blocks. Each block has its own "Brightness" tab. A staircase timer be started (depending on parameterisation of the device) and an ON telegram transmitted to the bus only after the value is below the parameterised brightness threshold and the presence detector detects a movement. The brightness threshold can be set between 10 and 2000 lux. Alternatively, depending on the parameterisation, the values can be set by means of a potentiometer on the device.

Via the "Brightness" tab and the "Reaction with adequate brightness despite movement" parameter, you can specify whether the selected block functions as a presence detector or a movement detector. If you select "Presence detector" in the ETS, the hysteresis will also need to be specified as a percentage and the pause for brightness measurement set. This setting is disabled if "Movement detector" has been selected.

Via the parameter "Brightness threshold object" "Enabled" or "Disabled" you can select whether the brightness threshold should be changed via the bus. This can be useful when several presence detectors are installed in a building. The brightness threshold can be changed using the "Brightness threshold - Block X" object via the ETS or an IP touch panel, for example. The brightness threshold is set to the same level in all parts of the building.

Brightness object 1 bit

The brightness object sends a 1 bit value to the bus. If the parameterised brightness threshold is not reached, an ON telegram can be transmitted. If the parameterised brightness threshold is exceeded, an OFF telegram can be transmitted. Inverted transmission can also be set.

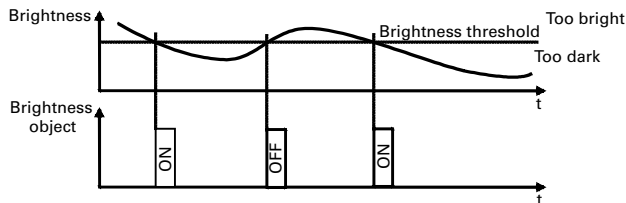

Always-dark object

In the case of an enabled "Always-dark object", darkness can be simulated internally in the presence detector depending on the object value. The "always-dark object" is used with master/slave circuits. Planning master/slave circuits is described further below.

Communication objects

You can select the following communication objects:

Block X, general brightness:

Function	Object name	Type	Prio	Flags	Behaviour
Block X	Brightness threshold	2 byte	Low	WC	Receive
Block X	Brightness object	1 bit	Low	CT	Transmit
Block X	Always-dark object	1 bit	Low	WC	Receive



Note:

The parameter settings include various functions which depend on other functions. Depending on the parameter setting, some functions or objects may or may not be displayed in the ETS.

Parameter

Block X, general brightness	
Parameter	Setting
Movement detection is	Brightness-dependent Not brightness-dependent
Brightness threshold adjustable via	Parameters Potentiometer
The following parameters are only visible when "Range adjustable" "via parameter" has been parameterised.	
Override brightness threshold during download	Enabled Disabled
Brightness threshold (10 - 2000 lux) see "General" tab	10 - 2000 lux; preconfiguration: 130
Brightness threshold object	Disabled Enabled
Reaction when brightness sufficient despite movement	Like presence detector Like movement detector
Hysteresis (10% - 50%)	10 - 50%; preconfiguration: 25
Pause for measuring the brightness (1 - 120) seconds	1 - 120 seconds; preconfiguration: 4
Brightness object 1 bit	Do not send Transmit Transmit inverted
Always-dark object (= not brightness-dependent)	Disabled Enabled
The following parameter is only visible when "Always-dark object" is "Enabled".	
Always-dark object is active	For object value "1" For object value "0"
The following parameter is only visible for "Master mode"	
Switch on at movement	Enabled Disabled

● Operating modes

The operating mode in which this block operates is specified in the application software for each block (movement/presence blocks 1 - 5). The following operating modes are available:

- Normal mode
- Master mode
- Slave mode
- Monitoring mode

Depending on the operating mode different parameters and communication objects will be displayed. Each operating mode can operate brightness-dependently or non-brightness-dependently.

Normal mode

In this operating mode the presence detector does not have any external trigger objects (master trigger object, trigger object). Telegrams cannot be sent

cyclically and this means a master-slave system cannot be set up. In the default setting, the presence detector transmits an ON telegram at the start of movement and transmits an OFF telegram when the movement time (staircase timer) has expired.

Note: Use the "Normal mode" setting when the movement/presence block is working for itself alone. In other words, one presence detector is used for each room and it switches one light or one light panel.

Master mode

With master mode all of the possible parameters and communication objects of the presence detector are available. A master-slave system can be set up with the aid of the master trigger object or the trigger object. In the default setting, the presence detector transmits an ON telegram at the start of movement and transmits an OFF telegram when the movement time (staircase timer) has expired.

Note: Use the "Master mode" setting when a master-slave system is to be set up. In other words, when, for example, several presence detectors are to be used in a room. One presence detector evaluates the brightness and functions as master, the other presence detectors work non-brightness-dependently as slaves and "activate" the master. Planning master/slave systems is described further below.

Slave mode

In slave mode the default setting is that ON telegrams are sent cyclically when a movement is detected. These telegrams are intended for the master trigger object or for the trigger object of the master.

Note: Use the "Slave mode" setting when a master-slave system is to be set up. In other words, when, for example, several presence detectors are to be used in a room. One presence detector evaluates the brightness and functions as master, the other presence detectors work non-brightness-dependently as slaves and "activate" the master. Planning master/slave systems is described further below.

Monitoring mode

In monitoring mode the default setting is that ON telegrams are sent cyclically when a movement is detected. At the end of the movement time (cycle time with movement) OFF telegrams are transmitted cyclically.

Note: Use the "Monitoring mode" setting when the presence detector is being used for room

monitoring and telegrams are to be sent cyclically on the bus.

Communication objects

You can select the following communication objects:

Block X, general:

Function	Object name	Type	Prio	Flags	Behaviour
The objects are only visible in operating mode: "Master mode"					
Block X	Master trigger object	1 bit	Low	WC	Receive
Block X	Trigger object	1 bit	Low	WC	Receive

Parameter

Block X, general	
Parameter	Setting
Operating mode	Normal mode
	Master mode
	Slave mode
	Monitoring mode

Note: When toggling between operating modes the "Brightness" and "Times" tabs change.

● Telegrams

For each presence/movement block the "Action at start of movement" can be set as a function of the operating mode.

Normal mode:

- "Send immediately"
- "Do not send"

Master mode:

- "Send immediately"
- "Send immediately and then cyclically"
- "Do not send"

Slave mode:

- "Send immediately and then cyclically" (is permanent setting in the background of the application software, is not displayed in the parameters)

Monitoring mode:

- "Send immediately and then cyclically" (is permanent setting in the background of the application software, is not displayed in the parameters)

The behaviour after the "End of movement time" can also be set as a function of the operating mode:

Normal mode:

- "Send after staircase timer/remaining time has elapsed"
- "Do not send"

Master mode:

- "Send after staircase timer/remaining time has elapsed"
- "Send after staircase timer has elapsed and then cyclically"
- "Do not send"

Slave mode:

- "Do not send" (is permanent setting in the background of the application software, is not displayed in the parameters)

Monitoring mode:

- "Send at end of cycle time when there is movement and then cyclically" (is permanent setting in the background of the application software, is not displayed in the parameters)

Four output objects are available for each of the five presence/movement blocks and they can be enabled via the application software. A transmission pause between the individual output objects can be set for each block.



Note:

Five presence/movement blocks and four output objects per presence detector means that 20 switching/value objects in all are available.

Parameter



Note:

The parameter settings include various functions which depend on other functions. Depending on the parameter setting, some functions or objects may or may not be displayed in the ETS.

Block X, general telegrams	
Parameter	Setting
Action at start of movement	Send immediately Do not send Send immediately and then cyclically
When movement time elapsed	Send after staircase timer/remaining time has elapsed Do not send "Send after staircase timer/remaining time has elapsed and then cyclically"
Output object X (1 - 4)	Enabled Disabled
Pause between two telegrams (3 - 255) x 100 ms	3 - 255; preconfiguration: 5

Output for switching/value object X

For each output object you can select between a 1 bit, 1 byte (0% - 100%), 1 byte (0 - 255) and 2 byte object.

The telegram values should be parameterised for the start of movement and for the end of the movement time. Here an object can transmit its current value or a defined value to the bus.



Note:

The current value can be transmitted by a time switch, for example. During the night a lower byte value is transmitted to the output object of the presence detector than in daytime hours.

Communication objects

You can select the following communication objects:

Block X general - telegrams - output for switching/value object X:

Function	Object name	Type	Prio	Flags	Behaviour
Block X	Switch object X	1 bit	Low	WCT	Transmit/receive
Block X	Value object X	1 byte	Low	WCT	Transmit/receive
Block X	Value object X	2 byte	Low	WCT	Transmit/receive

Parameter



Note:

The parameter settings shown below are **dependent** on the operating mode and the object settings (1 bit, 1 byte or 2 bytes). Depending on the parameterisation some parameters will not be displayed!
The parameter settings include various functions which depend on other functions. Depending on the parameter setting, some functions or objects may or may not be displayed in the ETS.

Block X general telegrams output switching/value object X	
Parameter	Setting
Object	1 bit
	1 byte 0% - 100%
	1 byte 0 - 255
	2 byte
At start of movement	Transmits defined value
	Transmits its value
Value or object value	ON telegram
	OFF telegram
	0% - 100%
	0 - 255
	Change value 0 - 65535 to floating point
	Change value -32768 - 32767 to floating point
	Floating point
	Value 0 - 65535
Value -32768 - 32767	

Block X general telegrams output switching/value object X	
Parameter	Setting
When movement time elapsed	Transmits defined value Transmits its value
Value or object value	ON telegram
	OFF telegram
	0% - 100%
	0 - 255
	Change value 0 - 65535 to floating point
	Change value -32768 - 32767 to floating point
	Floating point
	Value 0 - 65535
	Value -32768 - 32767

i Note regarding 2 byte parameter settings: Depending on the setting of the object type value there will be new parameters; depending on the parameterisation the values can be input immediately or are determined via sign x basic value x factor.

● **Staircase timer**

The staircase timer or cycle time can be parameterised via a time base x factor. With "Normal mode" and "Master mode" operating modes the "Staircase timer" is parameterised. With "Slave mode" and "Monitoring mode" operating modes the "Cycle time" is parameterised. Alternatively, depending on the parameterisation, the values can be set by means of a potentiometer on the device. (The potentiometer setting is only relevant for Master mode or normal mode.)

i The "Times" tab has some parameter displays and selectable objects which are **dependent** on the operating mode set.

i Note: In "Slave mode" and "Monitoring mode" operating modes no further objects are displayed by modification on the "Times" tab.

Self-adjusting staircase timer

The presence detector is equipped with a "self-adjusting staircase timer". When the "Self-adjusting staircase timer" is enabled, the presence detector can start a brief overshoot time when someone is in the room for a short time. If they remain in the room longer, a long overshoot time is started. The parameters "Time base", "Minimum time factor", "Time factor for learning step", "Maximum time factor" and "Sensitivity of the learning step" are available for the "Self-adjusting staircase timer." If there is only a brief movement in front of the presence detector, the overshoot time (until switch-off) will be close to the "Minimum time factor" x "Time basis". If movements last longer, a "Time factor for learning step" will be

added to the staircase timer up to the maximum, depending on what learning sensitivity has been set. Once the time set on the staircase timer has elapsed, a restart takes place with "Minimum time factor".

Communication objects

Operating mode: Normal mode

You can select the following communication objects:

Block X, general times:

Function	Object name	Type	Prio	Flags	Behaviour
Block X	Time factor, staircase timer	1 byte	Low	WC	Transmit

Parameter

Operating mode: Normal mode

i Note: The parameter settings include various functions which depend on other functions. Depending on the parameter setting, some functions or objects may or may not be displayed in the ETS.

Block X, general times	
Parameter	Setting
Via movement, time is	Retriggerable Not retriggerable
Staircase timer adjustable via	Parameters Potentiometer
The following parameters are only visible when "Staircase timer adjustable" "via parameter" has been parameterised.	
Overwriting staircase timer during download	Enabled Disabled
Self-adjusting staircase timer (always retriggerable)	Disabled Enabled
The following parameters are only visible when "Self-adjusting staircase timer" is "disabled".	
Time factor staircase timer object	Disabled Enabled
Time base for staircase timer	1 min 1 s 1 hr
Time factor for staircase timer (1 - 1 - 255; preconfiguration: 25)	25
The following parameters are only visible when "Self-adjusting staircase timer" is "enabled".	
Time base for staircase timer	1 min 1 s 1 hr
Minimum time factor (1 - 255) Staircase timer	1 - 255; preconfiguration: 5
Time factor for learning step (1 - 1 - 255; preconfiguration: 1 255) Staircase timer	1 - 255; preconfiguration: 1
Maximum time factor (1 - 255) Staircase timer	1 - 255; preconfiguration: 25

Block X, general times	
Parameter	Setting
Sensitivity of learning step	1 - 5; preconfiguration: 4 1 = slow 5 = sensitive

The following parameter is displayed for potentiometer and parameter setting.

On reaching the switch-off threshold	Staircase timer elapsed Remaining running time elapsed
Time base, remaining running time	1 min 1 s 1 hr
Time factor, remaining running time (1 - 255)	1 - 255; preconfiguration: 4

Communication objects

Operating mode: Master mode

You can select the following communication objects:

Block X, general times:

Function	Object name	Type	Prio	Flags	Behaviour
Block X	Master trigger object	1 bit	Low	WC	Transmit
Block X	Trigger object	1 bit	Low	WC	Transmit
Block X	Time factor, staircase timer	1 byte	Low	WC	Transmit

Parameter

Operating mode: Master mode



Note:

The parameter settings include various functions which depend on other functions. Depending on the parameter setting, some functions or objects may or may not be displayed in the ETS.

Block X, general times	
Parameter	Setting
Master triggering is (brightness-dependent)	Enabled Disabled
Via movement/master trigger object, time is	Retriggerable Not retriggerable
Master trigger object includes the safety pause	Enabled Disabled
Triggering is (not brightness-dependent)	Enabled Disabled
Switch off staircase timer via trigger object	Enabled Disabled
Via trigger object, time is	Retriggerable Not retriggerable
Trigger object includes the safety pause	Enabled Disabled

Block X, general times	
Parameter	Setting
Overwriting staircase timer during download	Enabled Disabled
Self-adjusting staircase timer (always retriggerable)	Disabled Enabled
The following parameters are only visible when "Self-adjusting staircase timer" is "disabled".	
Time factor staircase timer object	Disabled Enabled
Time base for staircase timer	1 min 1 s 1 hr
Time factor for staircase timer (1 - 255)	1 - 255; preconfiguration: 25
The following parameters are only visible when "Self-adjusting staircase timer" is "enabled".	
Time base for staircase timer	1 min 1 s 1 hr
Minimum time factor (1 - 255) Staircase timer	1 - 255; preconfiguration: 5
Time factor for learning step (1 - 255) Staircase timer	1 - 255; preconfiguration: 1
Maximum time factor (1 - 255) Staircase timer	1 - 255; preconfiguration: 25
Sensitivity of learning step	1 - 5; preconfiguration: 4 1 = slow 5 = sensitive
On reaching the switch-off threshold	Staircase timer elapsed Remaining running time elapsed
Time base, remaining running time	1 min 1 s 1 hr
Time factor, remaining running time (1 - 255)	1 - 255; preconfiguration: 4

Communication objects

Operating mode: Slave mode



Note:

No objects for "Time factor" or objects for "Triggering" are displayed. Exception: Slave as presence detector (brightness-dependent) - here a trigger object is offered.

Parameter

Operating mode: Slave mode

Block X, general times	
Parameter	Setting
Cyclic interval during movement	
Time base	1 min 1 s 1 hr
Time factor (1-255)	1 - 255; preconfiguration: 5

Communication objects

Operating mode: Monitoring mode



Note:
No objects for "Time factor" or objects for "Triggering" are displayed.

Parameter

Operating mode: Monitoring mode

Block X, general times	
Parameter	Setting
Cyclic interval during movement	
Time base	1 s 1 min 1 hr
Time factor (1-255)	1 - 255; preconfiguration: 5
Cyclic interval when movement time has elapsed	
Time base	1 s 1 min 1 hr
Time factor (1-255)	1 - 255; preconfiguration: 5

● Disable function

The presence detector can be disabled with the aid of the disable object; here the activation time point can be download / bus voltage recovery or reception of a disable telegram. The activation telegram for the disable function can be an ON telegram or an OFF telegram. At the start of disablement (if enabled via parameter) a telegram can be sent via the corresponding output object. Cyclic transmission makes sense with, for example, monitoring since certain bus devices require a cyclically transmitted OFF telegram. When the disable function is disabled, the current status of the presence detector is restored (an ongoing staircase timer is not stopped/start of movement actions or action when movement time elapses is transmitted).

Communication objects

You can select the following communication objects:

Block X, general:

Function	Object name	Type	Prio	Flags	Behaviour
Block X	Disable object	1 bit	Low	WC	Receive

Parameter

Block X, general	
Parameter	Setting
Disable function	Disabled Enabled

Block X, general - disable function	
Parameter	Setting
Activation time for disable function	Active during telegram reception After download / bus voltage recovery
Block	For object value "1" For object value "0"
Behaviour at the start of Telegrams block on output object 1-4 tab	Do not send a telegram Transmit telegram
Behaviour at the start of Telegrams block on output object 1-4 tab (only visible in master mode or monitoring mode)	Send telegram cyclically
Time base	1 s 1 min 1 hr
Time factor (1-255)	1 - 255; preconfiguration: 30

Block X general telegrams output switching/value object X	
Parameter	Setting
At start of block	OFF telegram ON telegram 1 byte 0% - 100% 1 byte 0 - 255 2 byte floating point or value



Note regarding 2 byte parameter settings:
Depending on the setting of the object type value there will be new parameters; depending on the parameterisation the values can be input immediately or are ascertained via sign x basic value x factor.

● Changing specific parameters via the bus

The following parameters can be modified via the bus:

- "Time factor, staircase timer"
- "Range"
- "Brightness threshold"



Note:
Following bus voltage failure and recovery the modified values will be retained.

Communication objects

You can select the following communication objects:

Block X, general times:

Function	Object name	Type	Prio	Flags	Behaviour
Block X	Time factor, staircase timer	1 byte	Low	WC	Receive

Block X, general movement sensors:

Function	Object name	Type	Prio	Flags	Behaviour
Block X	Range	1 byte	Low	WC	Receive

Block X, general brightness:

Function	Object name	Type	Prio	Flags	Behaviour
Block X	Brightness threshold	2 byte	Low	WC	Receive

Parameter

Block X, general times	
Parameter	Setting
Time factor staircase timer object	Disabled
	Enabled

Block X, general movement sensors	
Parameter	Setting
Range object (for all sensors)	Disabled
	Enabled

Block X, general brightness	
Parameter	Setting
Brightness threshold object	Disabled
	Enabled

● **Master/slave planning via the trigger object or master trigger object**

General information regarding the trigger object and master trigger object

The trigger object acts on the staircase timer **without** brightness measurement. Object value "1" starts the staircase timer (start of movement action) while further "1" telegrams retrigger the staircase timer, if enabled.


Object value "0" can switch the staircase timer off (end of movement time action), if enabled.

The master trigger object acts on the staircase timer **with** brightness measurement. Object value "1" starts the staircase timer (start of movement action) while further "1" telegrams retrigger the staircase timer, if enabled.

Object value "0" has no meaning as regards the master trigger object.


The parameters "Trigger object includes the safety pause" (enabled/disabled) and "Master trigger object includes the safety pause" (enabled/disabled) determine the effect of the safety pause on the two external trigger objects.

**Application example 1:
Slave as movement detector (not brightness-dependent) and master as movement detector (not brightness-dependent)**

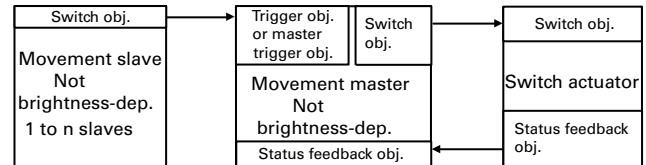


- System not brightness-dependent
- Slave transmits ON telegrams cyclically after movement
- Master switches on actuator when movement detected or trigger
- Master retriggers staircase timer when movement detected or trigger
- Master switches off when staircase timer elapses
- Cycle time slave maximum staircase timer / 2
- Staircase timer retriggerable via movement / master trigger / trigger

**Application example 2:
Slave as movement detector (not brightness-dependent) and master as movement detector (brightness-dependent)**

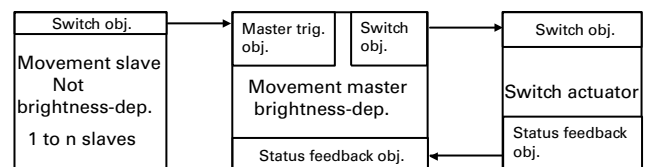


- Master evaluates brightness locally
- Slave transmits ON telegrams cyclically after movement
- Master switches on actuator upon movement detection or master trigger if it is too dark
- Master retriggers staircase timer upon movement detection or trigger, if previously switched on
- Master switches off when staircase timer elapses
- Cycle time slave maximum staircase timer / 2
- Staircase timer retriggerable via movement / master trigger / trigger

**Application example 3:
Slave as movement detector (brightness-dependent) and master as movement detector (brightness-dependent)**

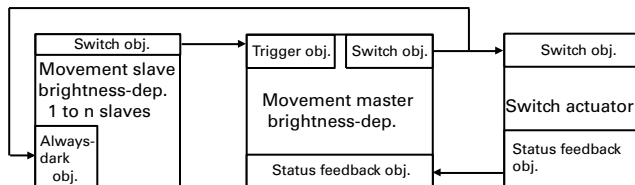


- Master and slave evaluate the brightness
- Slave sends ON telegrams cyclically upon movement detection if it is too dark or "Always-dark object" is "1"
- Master switches on actuator upon movement detection, if it is too dark
- Master switches on actuator upon trigger
- Master retriggers staircase timer upon movement detection or trigger, if previously switched on
- Master switches off when staircase timer elapses (always-dark object again "0")
- Cycle time slave maximum staircase timer / 2
- Staircase timer retriggerable via movement / master trigger / trigger

**Application example 4:
Slave as movement detector (not brightness-dependent) and master as presence detector (brightness-dependent)**

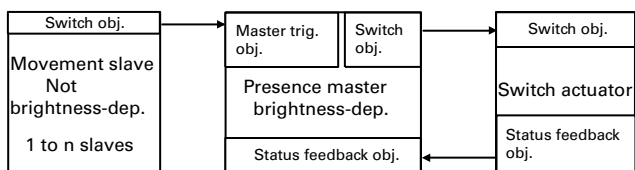

- Master evaluates brightness locally
- Slave transmits ON telegrams cyclically after movement
- Master switches on actuator upon movement detection or master trigger if it is too dark
- Master retriggers staircase timer upon movement detection or trigger, if previously switched on and the ambient brightness is not too high
- Master switches off when staircase timer elapses or ambient brightness is high enough
- Cycle time slave maximum staircase timer / 2
- Staircase timer retriggerable via movement / master trigger / trigger

**Application example 5:
Slave as presence detector (brightness-dependent) and master as presence detector (brightness-dependent)**

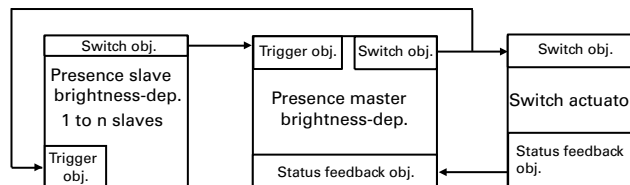

- Master and slave evaluate the brightness
- Slave sends ON telegrams cyclically upon movement detection if it is too dark and the ambient brightness in the activated state is not too high
- Master switches on actuator upon movement detection, if it is too dark
- Master switches on actuator upon trigger
- Master retriggers staircase timer upon movement detection if previously switched on and the ambient brightness is not too high
- Master retriggers staircase timer with trigger
- Master switches off when staircase timer elapses or ambient brightness is high enough
- Cycle time slave maximum staircase timer / 2
- Staircase timer retriggerable via movement / master trigger / trigger

● **Behaviour on application/recovery of the bus voltage**

Behaviour on application/recovery of the bus voltage

The actual value input (external sensor), the status feedback object (brightness value dimming actuator) can transmit read requests depending on the parameterisation. The brightness object can be transmitted depending on the parameterisation.

Behaviour when bus voltage fails

No reaction

● **Own notes:**